


OIL ANALYSIS REPORT

DF8 PLUS [9838]

KAESER 0221 - GRECIAN DELIGHT

Component Compressor

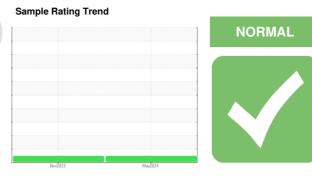

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000257	UCH06005764	
Sample Date		Client Info		16 May 2024	02 Nov 2023	
Machine Age	hrs	Client Info		77672	31521	
Oil Age	hrs	Client Info		1000	1246	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	J	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	<1	
Nickel	ppm	ASTM D5185m	>3	<1	<1	
Titanium	ppm	ASTM D5185m	>3	<1	<1	
Silver	ppm	ASTM D5185m	>2	1	<1	
Aluminum	ppm	ASTM D5185m	>10	1	2	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	1	2	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	<1	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0	0	
Barium	ppm	ASTM D5185m	0.3	0	0	
Molybdenum	ppm	ASTM D5185m	0	<1	<1	
Manganese	ppm	ASTM D5185m	0	<1	0	
Magnesium	ppm	ASTM D5185m	0	2	2	
Calcium	ppm	ASTM D5185m	0.5	0	0	
Phosphorus	ppm	ASTM D5185m	536	211	247	
Zinc	ppm	ASTM D5185m	0.2	14	12	
Sulfur	ppm	ASTM D5185m	649	1333	1166	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	<1	1	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	0.18	0.16	




OIL ANALYSIS REPORT










GRAPHS













Laboratory Sample No.

: UDI0000257 Lab Number : 06194213 Unique Number : 11056336

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 29 May 2024

Tested : 30 May 2024 Diagnosed : 31 May 2024 - Angela Borella

DELTA INDUSTRIES - DOWNERS GROVE

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: DARRELL WHITLEDGE

darrellwhitledge@deltaind.net T: (630)960-3900

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCDELDOW [WUSCAR] 06194213 (Generated: 05/31/2024 10:39:04) Rev: 1

Contact/Location: DARRELL WHITLEDGE - UCDELDOW

F: (630)960-3931