


OIL ANALYSIS REPORT

Area S-460







DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000228	UCH05995730	
Sample Date		Client Info		15 May 2024	10 Oct 2023	
Machine Age	hrs	Client Info		5997	3267	
Oil Age	hrs	Client Info		2728	3267	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	1	0	
Aluminum	ppm	ASTM D5185m	>10	1	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	13	15	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	19	17	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	4	0	
Zinc	ppm	ASTM D5185m	0	2	2	
Sulfur	ppm	ASTM D5185m	23500	17458	15888	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	
Sodium	ppm	ASTM D5185m		6	12	
Potassium	ppm	ASTM D5185m	>20	3	6	
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.38	0.35	





OIL ANALYSIS REPORT

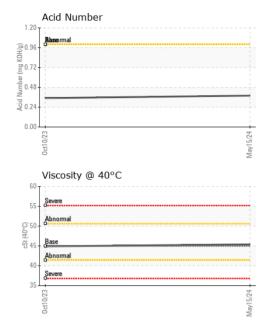





GRAPHS













Certificate 12367

Laboratory Sample No.

: UDI0000228 Lab Number : 06194218 Unique Number : 11056341

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 29 May 2024 **Tested** Diagnosed

: 31 May 2024 : 31 May 2024 - Jonathan Hester

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact/Location: MICHAEL FERRIS - UCDELDOW

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931

Report Id: UCDELDOW [WUSCAR] 06194218 (Generated: 05/31/2024 20:02:52) Rev: 1