




OIL ANALYSIS REPORT

Sample Rating Trend

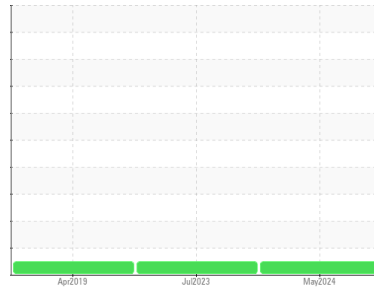

NORMAL



Machine Id
KOHLER 2284399

Component
Genset

Fluid
AMSOIL (PCO) SYN HD DIESEL15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0944532	WC0835977	WC0336492
Sample Date	Client Info			18 May 2024	09 Jul 2023	07 Apr 2019
Machine Age	hrs	Client Info		1150	1100	170
Oil Age	hrs	Client Info		50	100	130
Oil Changed	Client Info			Not Changed	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>0.1		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4	4	6
Chromium	ppm	ASTM D5185m	>4	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	<1	<1	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>5	1	0	0
Aluminum	ppm	ASTM D5185m	>12	2	2	2
Lead	ppm	ASTM D5185m	>17	<1	<1	<1
Copper	ppm	ASTM D5185m	>70	1	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	7.2	87	45	41
Barium	ppm	ASTM D5185m	0.0	0	0	0
Molybdenum	ppm	ASTM D5185m	0.0	15	59	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	460	754	987	15
Calcium	ppm	ASTM D5185m	2996	1120	935	2229
Phosphorus	ppm	ASTM D5185m	1076	1007	1020	876
Zinc	ppm	ASTM D5185m	1208	1178	1214	1049
Sulfur	ppm	ASTM D5185m	4236	3980	3275	4515




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	10	12	23
Sodium	ppm	ASTM D5185m		3	0	3
Potassium	ppm	ASTM D5185m	>20	3	2	6

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	6.9	8.2	7.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.9	20.0	19.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	13.6	18.2	18.1
Base Number (BN)	mg KOH/g	ASTM D2896	12.1	10.43	11.67	7.71











OIL ANALYSIS REPORT

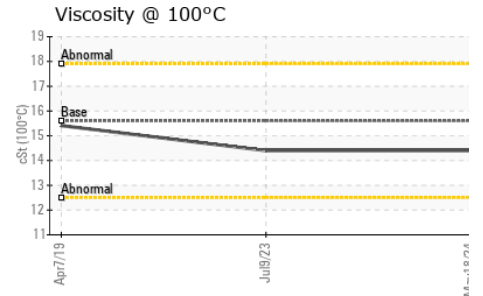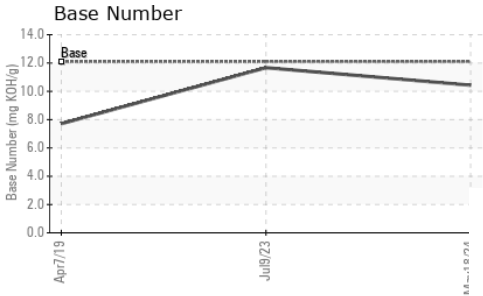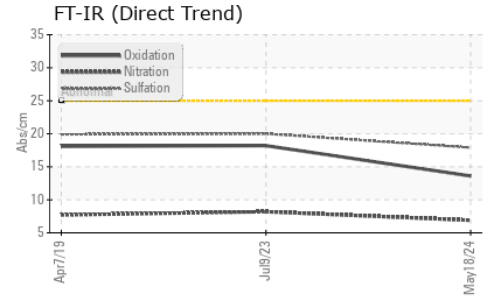

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.6	14.4	14.4

GRAPHS

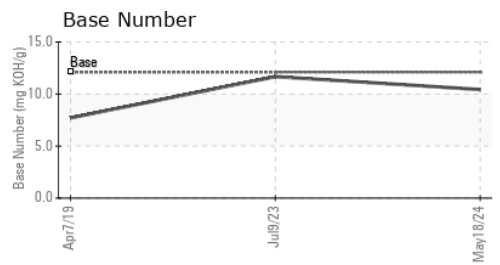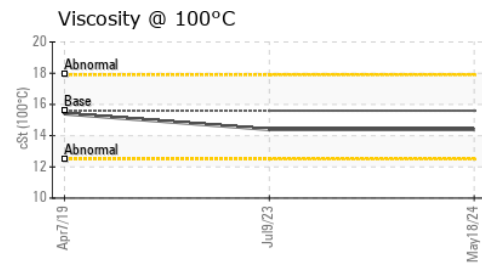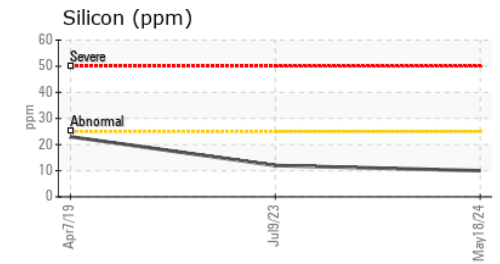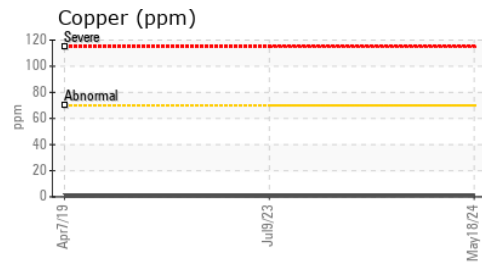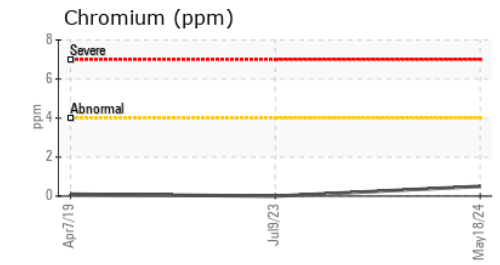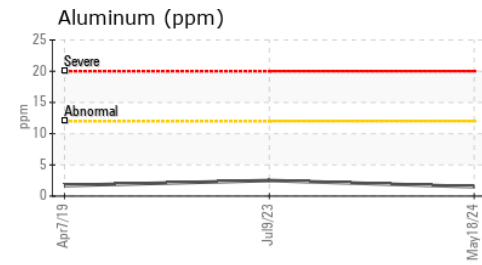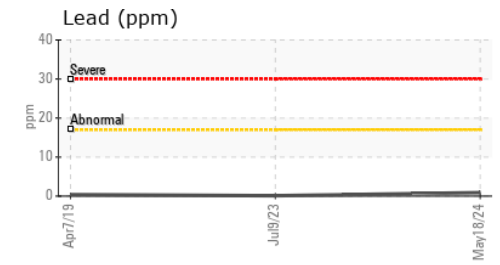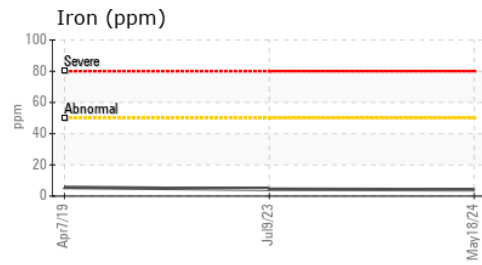

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0944532 **Received** : 29 May 2024
Lab Number : 06194234 **Tested** : 30 May 2024
Unique Number : 11056357 **Diagnosed** : 31 May 2024 - Angela Borella
Test Package : MOB 2

DELOITTE & TOUCHE LLP
 4501 SW 192ND TER
 SOUTHWEST RANCHES, FL
 US 33332
 Contact: JAMES MINESSALE
 jminessale@deloitte.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)