




# FUEL REPORT

Sample Rating Trend

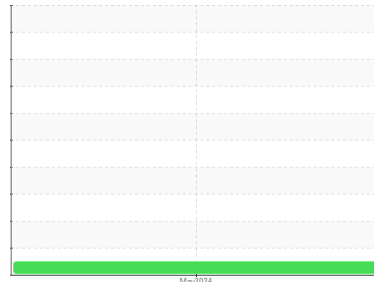

**NORMAL**



Area

[W156265]

Machine Id

**BACK TANK GEN 4 BACK TANK GEN 4**

Component

**Diesel Fuel**

Fluid

**DISESEL FUEL No. 2 (--- GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0911336</b>	---	---
Sample Date	Client Info			<b>15 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Sample Status				<b>NORMAL</b>	---	---



PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		<b>L4.5</b>	---	---
Visc @ 40°C	cSt	ASTM D445	4.1	<b>2.37</b>	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur (UVF)	ppm	ASTM D5453		<b>12</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<0.1	<b>2</b>	---	---
Potassium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Water	%	ASTM D6304	<0.05	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304	<500	<b>31</b>	---	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	---	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	---	---


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---

## SAMPLE IMAGES


method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image



# FUEL REPORT

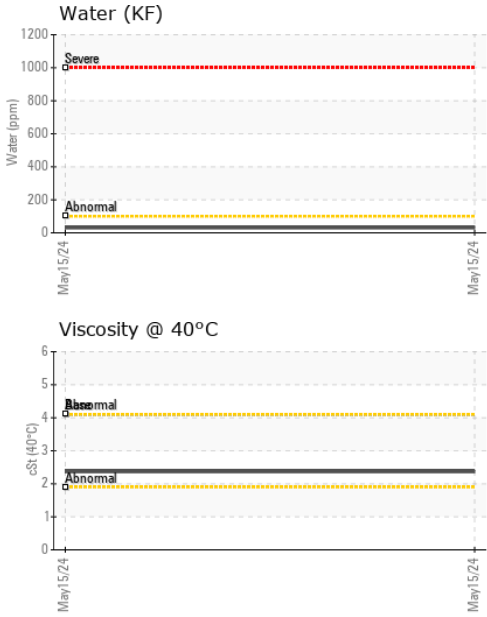

## GRAPHS

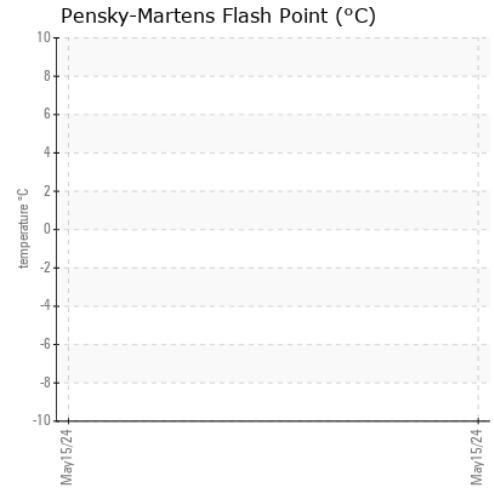

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0911336 **Received** : 29 May 2024  
**Lab Number** : 06194545 **Tested** : 11 Jun 2024  
**Unique Number** : 11056668 **Diagnosed** : 11 Jun 2024 - Doug Bogart  
**Test Package** : DF-5 ( Additional Tests: PriCount, Screen )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**NATIONAL POWER CORP**

4541 PRESLYN DR

RALEIGH, NC

US 27616

Contact: Brandon Daniels

Brandon.Daniels@natpow.com

T:

F: (919)790-9714