



FUEL REPORT

Sample Rating Trend

WATER



Area

[W156260]

Machine Id

IAD2-B-GEN-01 IAD2-B-GEN-01

Component

Diesel Fuel

Fluid

DIESEL FUEL No. 2 (--- GAL)



DIAGNOSIS

▲ Recommendation

We advise that you follow the water drain-off procedure for this component, and use off-line filtration to improve the cleanliness of the system fluid. We recommend you service and check the fuel filters for mucous-like deposits. Check with fuel supplier for biocides available to destroy the microorganisms in the fuel system.

Corrosion

All metal levels are normal indicating no corrosion in the system.

▲ Contaminants

Appearance is unacceptable. Excessive free water present. Light concentration of visible dirt/debris present in the fuel. There is a light concentration of water present in the fuel. There is a light concentration of Bacteria, Yeast and/or Fungus present in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0911271	---	---
Sample Date	Client Info			07 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				SEVERE	---	---



PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L4.5	---	---
Visc @ 40°C	cSt	ASTM D445	4.1	2.49	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		66	---	---
Sulfur (UVF)	ppm	ASTM D5453		100	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	---	---
Sodium	ppm	ASTM D5185m	<0.1	2	---	---
Potassium	ppm	ASTM D5185m	<0.1	<1	---	---
Water	%	ASTM D6304	<0.05	▲ 0.069	---	---
ppm Water	ppm	ASTM D6304	<500	691	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---


MICROBIAL		method	limit/base	current	history1	history2
Bacteria	CFU/ml	WC-Method	>=100000	0	---	---
Yeast	CFU/ml	WC-Method	>=100000	▲ 100	---	---
Mold	Colonies	WC-Method	MODER	---	---	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	<1	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<1	---	---
Iron	ppm	ASTM D5185m	<0.1	<1	---	---
Calcium	ppm	ASTM D5185m	<0.1	0	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<1	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	1	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---


SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image



FUEL REPORT

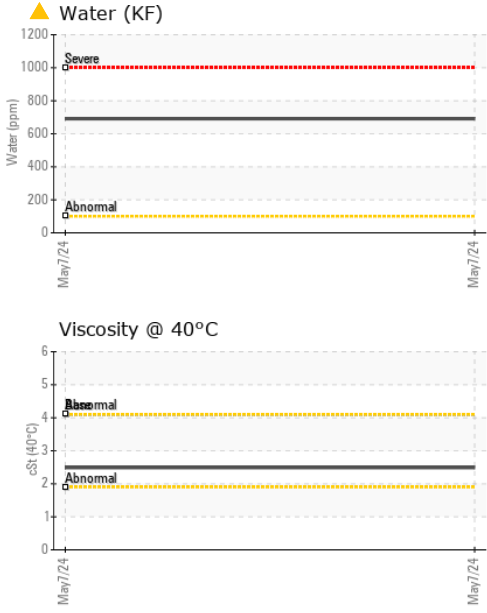

GRAPHS

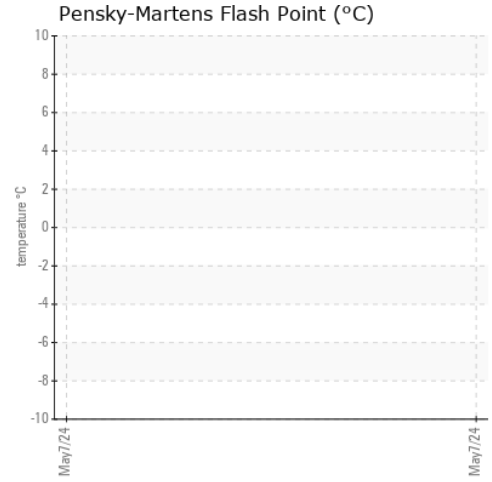

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0911271 **Received** : 29 May 2024
Lab Number : 06194564 **Tested** : 12 Jun 2024
Unique Number : 11056687 **Diagnosed** : 12 Jun 2024 - Doug Bogart
Test Package : DF-5 (Additional Tests: Bacteria, PrtCount, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616

Contact: Brandon Daniels
 Brandon.Daniels@natpow.com

T:
 F: (919)790-9714