

COOLANT REPORT

Sample Rating Trend

NORMAL

Area [W156272] IAD2-B-GEN-08 IAD2-B-GEN-08 Component

Component Coolant Fluid

{not provided} (--- GAL)

DIAGNOSIS


Recommendation The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.








SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0931792		
Sample Date		Client Info		06 May 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR				
Specific Gravity		*ASTM D1298		1.064		
рН	Scale 0-14	ASTM D1287		9.71		
Nitrites	ppm	AP-053:2009		2404		
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321		47.6		
Freezing Point	°F	ASTM D3321		-28		
Total Dissolved Solids				619.0		
Carboxylate				n/a		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Green		
Coolant Appearance		*Visual	Clear	normal		
Color				a.	no image	no image
Bottom					no image	no image



COOLANT REPORT



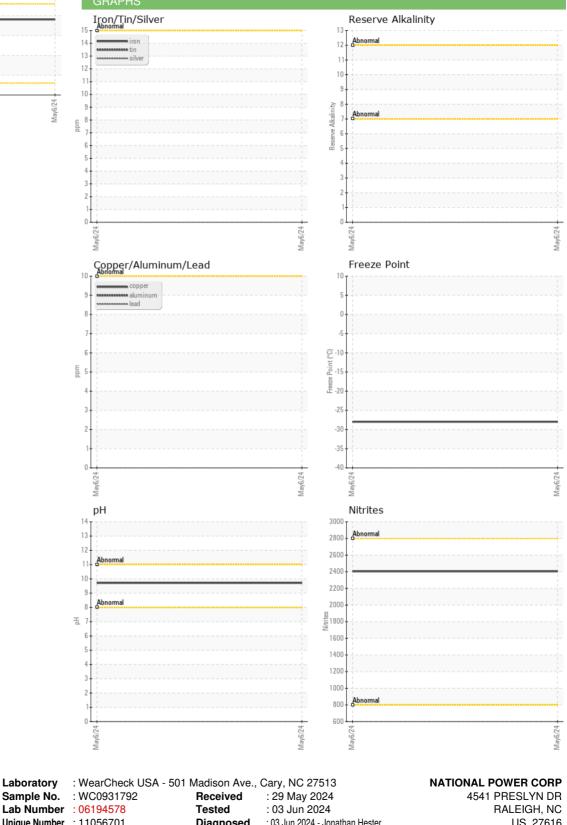



4541 PRESLYN DR RALEIGH, NC US 27616 Contact: Brandon Daniels Brandon.Daniels@natpow.com T: 06:2012) F: (919)790-9714

Report Id: NATRAL [WUSCAR] 06194578 (Generated: 06/03/2024 22:37:45) Rev: 1

۵3

Contact/Location: Brandon Daniels - NATRAL Page 2 of 2