




COOLANT REPORT

Sample Rating Trend

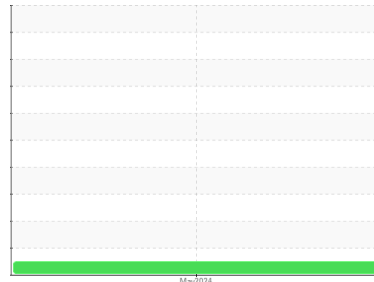

NORMAL



Machine Id
NOT GIVEN WC0931787 NOT GIVEN
 Component
Coolant
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.



SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0931787	---	---
Sample Date	Client Info		08 May 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

PHYSICAL TEST RESULTS


	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.065	---	---
pH	Scale 0-14 ASTM D1287		8.15	---	---
Nitrites	ppm AP-053:2009		1388	---	---
Reserve Alkalinity	Scale 0-20 *ASTM D1121		---	---	---
Percentage Glycol	% ASTM D3321		48.0	---	---
Freezing Point	°F ASTM D3321		-31	---	---
Total Dissolved Solids			449.5	---	---
Carboxylate			n/a	---	---

VISUAL







	method	limit/base	current	history1	history2
Coolant Color	*Visual		Red	---	---
Coolant Appearance	*Visual	Clear	normal	---	---
Color				no image	no image
Bottom				no image	no image



COOLANT REPORT

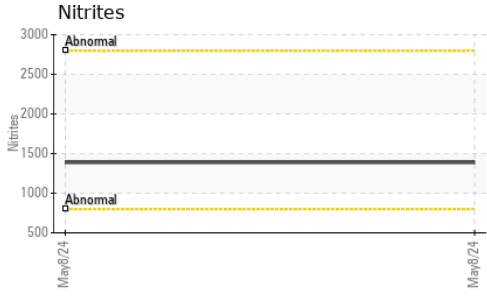

GRAPHS

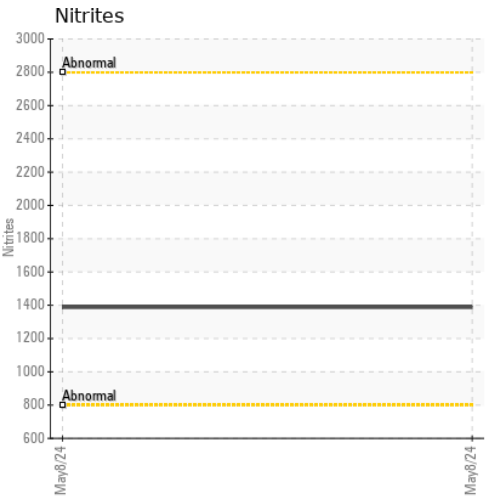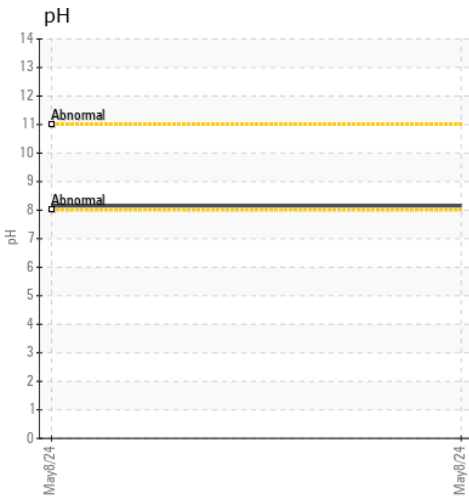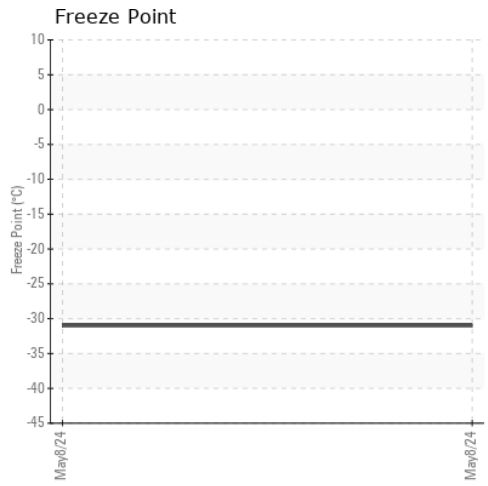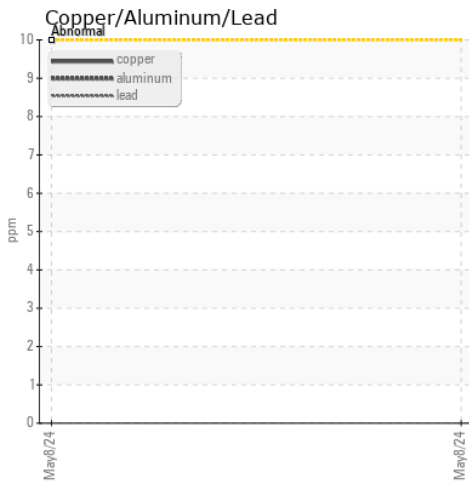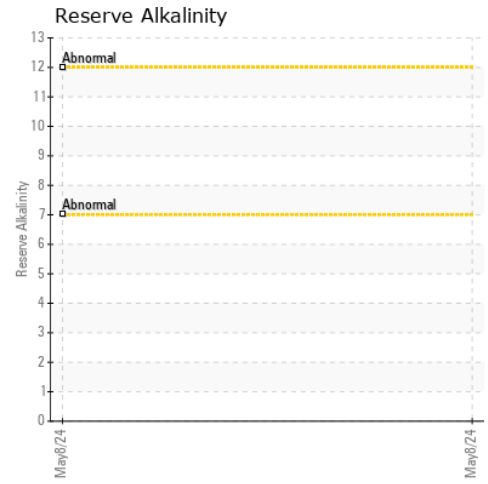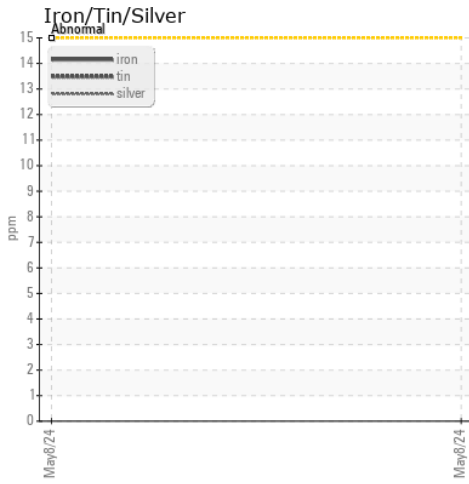

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0931787
Lab Number : 06194579
Unique Number : 11056702
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType)

Received : 29 May 2024
Tested : 03 Jun 2024
Diagnosed : 03 Jun 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616

Contact: Brandon Daniels
 Brandon.Daniels@natpow.com

T:
 F: (919)790-9714