

## **COOLANT REPORT**

Sample Rating Trend



### Area [30040] 82228-2 Component Coolant Fluid CONVENTIONAL COOLANT (--- GAL)

#### DIAGNOSIS

## Recommendation

The fluid is suitable for further service.

### Contaminants

There is no indication of any contamination in the coolant.

#### **Coolant Condition**

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0911520		
Sample Date		Client Info		24 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR				
Specific Gravity		*ASTM D1298		1.063		
рН	Scale 0-14	ASTM D1287		7.96		
Nitrites	ppm	AP-053:2009		1164		
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321		46.4		
Freezing Point	°F	ASTM D3321		-26		
Total Dissolved Solids				264.0		
Carboxylate				n/a		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Clear		
Coolant Appearance		*Visual	Clear	normal		
Color					no image	no image


Color	a.	no image	no image
Bottom		no image	no image



# **COOLANT REPORT**



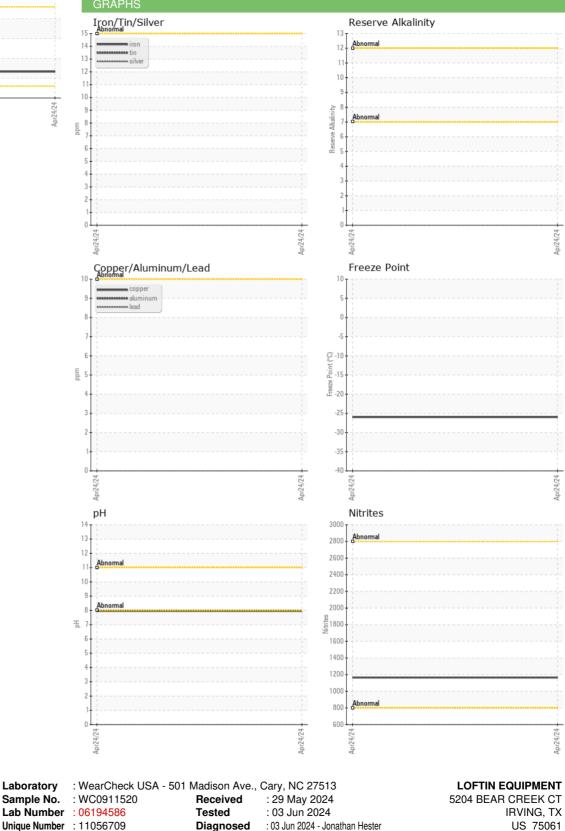



Laboratory

Sample No.

Contact/Location: Service Manager - LOFIRV Page 2 of 2

Contact: Service Manager

T:

F:

servicemid@loftinequip.com