


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

7044486 (S/N 1228)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May202	1 May2022	May2023 Ma	y2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012900	KCP53754	KCP40718
Sample Date		Client Info		20 May 2024	15 May 2023	31 May 2022
Machine Age	hrs	Client Info		14884	11541	8234
Oil Age	hrs	Client Info		0	1	3000
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	1	0	<1
Aluminum	ppm	ASTM D5185m	>10	1	<1	1
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	8	5	8
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	100	2	4	4
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	2	24
Zinc	ppm	ASTM D5185m	0	7	0	26
Sulfur	ppm	ASTM D5185m	23500	21401	24083	17469
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		0	2	3
Potassium	ppm	ASTM D5185m	>20	<1	1	0
Water	%	ASTM D6304	>0.05	0.009	0.007	△ 0.524
ppm Water	ppm	ASTM D6304	>500	99	74.6	<u>▲</u> 5240
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1934	1636	
Particles >6µm		ASTM D7647	>1300	509	511	
Particles >14μm		ASTM D7647	>80	27	27	
Particles >21µm		ASTM D7647	>20	6	5	
Particles >38μm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	18/16/12	
FLUID DEGRADA	TION_	method	limit/base	current	history1	history2

0.37



OIL ANALYSIS REPORT

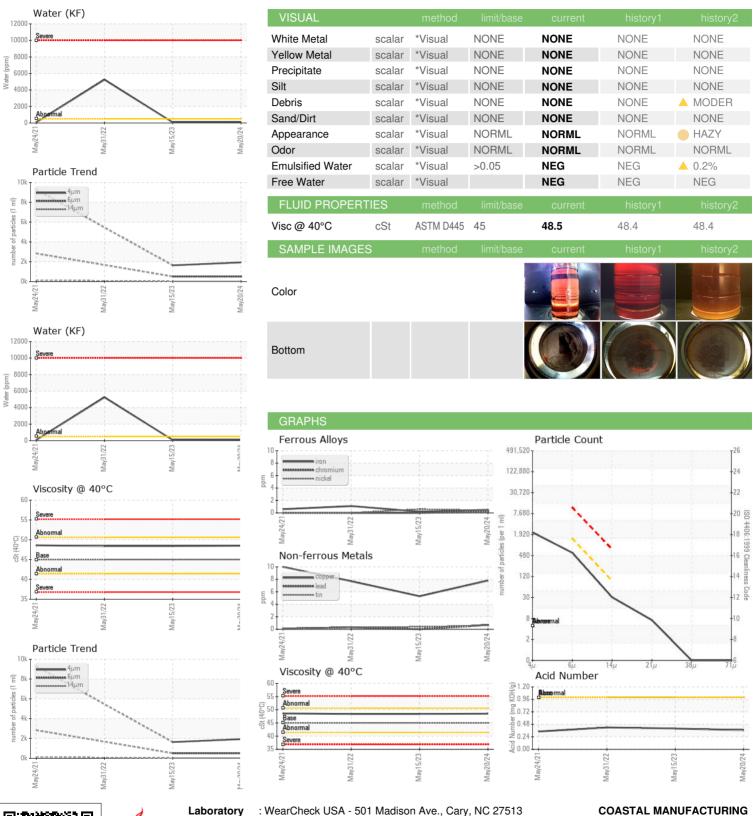





Certificate 12367

Laboratory Sample No. Lab Number

Unique Number : 11056744

: KCPA012900 : 06194621

Received **Tested**

: 31 May 2024 Diagnosed

: 31 May 2024 - Don Baldridge

: 29 May 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 95076 Contact: GENE

gene@coastalmanufacturing.net

T: F:

355 HARVEST DR

WATSONVILLE, CA