




# OIL ANALYSIS REPORT

Sample Rating Trend

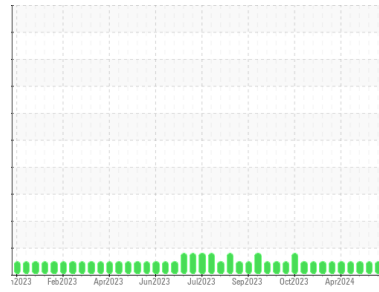

**NORMAL**



Machine Id  
**CAPTIS ENERGY ENG 3 (S/N 1251399)**  
 Component  
**Natural Gas Engine**  
 Fluid  
**MAHLER Q8 Mahler G8 SAE 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0944701</b>	WC06178986	WC0914340
Sample Date	Client Info	<b>28 May 2024</b>	13 May 2024	03 May 2024
Machine Age	hrs	<b>25050</b>	51574	24524
Oil Age	hrs	<b>758</b>	0	232
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	<b>3</b>	17	3
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >15	<b>2</b>	3	1
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	1
Copper	ppm	ASTM D5185m >15	<b>&lt;1</b>	1	1
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>&lt;1</b>	0	3
Barium	ppm	ASTM D5185m	<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>2</b>	<1	2
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>13</b>	7	12
Calcium	ppm	ASTM D5185m	<b>2181</b>	2455	2165
Phosphorus	ppm	ASTM D5185m	<b>494</b>	427	487
Zinc	ppm	ASTM D5185m	<b>543</b>	487	522
Sulfur	ppm	ASTM D5185m	<b>2514</b>	2779	3029

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >200	<b>2</b>	19	3
Sodium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	3

## INFRA-RED

method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844 >2	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.2</b>	7.6	6.1
Sulfation	Abs/.1mm	*ASTM D7415 >20	<b>15.4</b>	16.6	14.8


## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >20	<b>11.0</b>	12.1	9.8
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.639</b>	0.35	1.226
Base Number (BN)	mg KOH/g	ASTM D2896 8.0	<b>7.31</b>	7.33	9.18




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

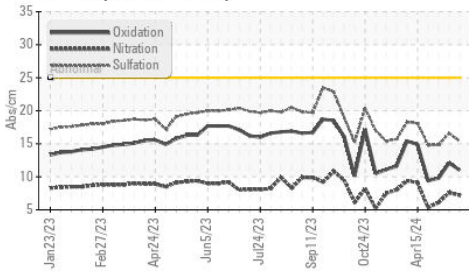


Acid Number

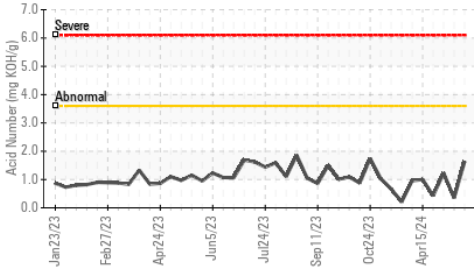

Base Number

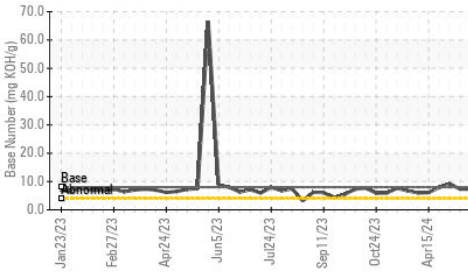









Viscosity @ 100°C

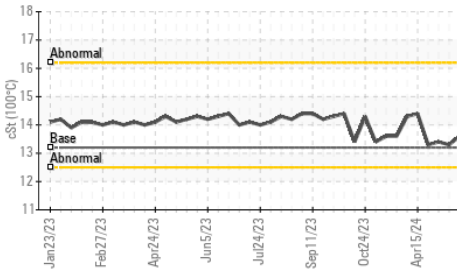

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	13.6	13.3

GRAPHS

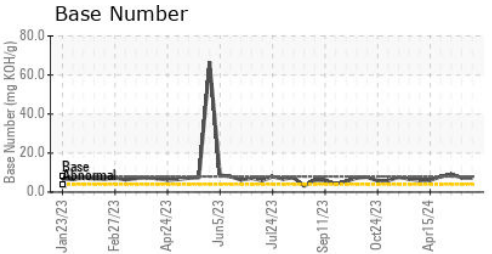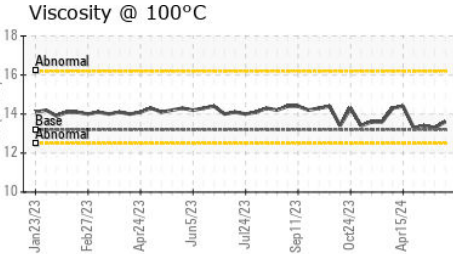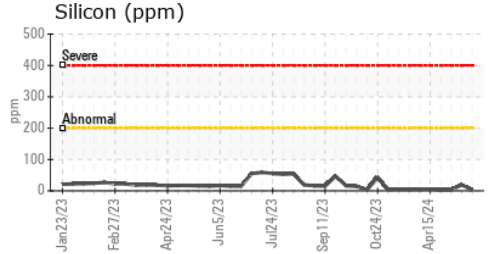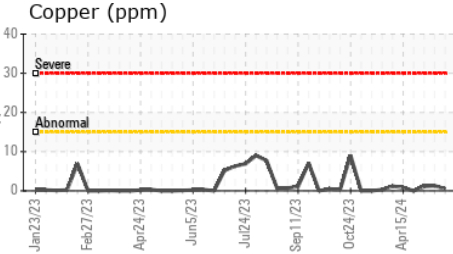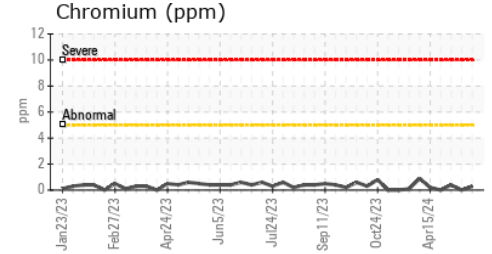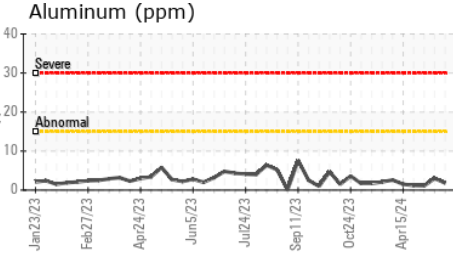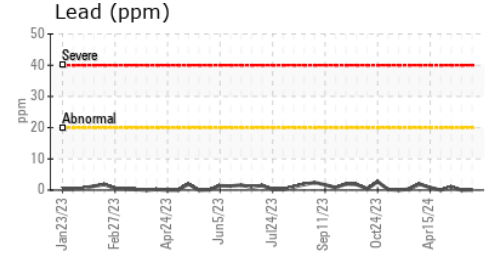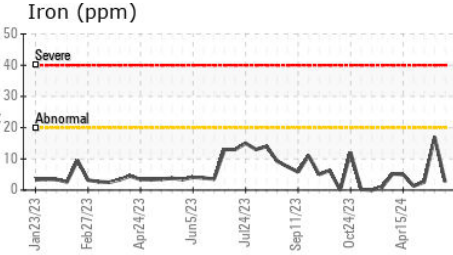

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0944701  
 Lab Number : 06194687  
 Unique Number : 11056810  
 Test Package : MOB 2

Received : 29 May 2024  
 Tested : 31 May 2024  
 Diagnosed : 31 May 2024 - Wes Davis

**CUBE DISTRICT ENERGY**  
 1000 WINDWARD CONCOURSE SUITE 150  
 ALPHARETTA, GA  
 US 30005  
 Contact: ED LEWIS  
 ed.lewis@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: