




GREASE ANALYSIS

Sample Rating Trend

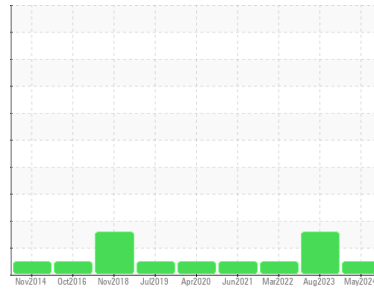

NORMAL



Machine Id
TURBINA 10 - REAR BREAIING
 Component
Grease
 Fluid
KLUBER KLUBERPLEX BEM 41-141 (--- LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Grease Condition

The condition of the grease is acceptable for the time in service.

Contaminants

There is no indication of any contamination in the grease.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0881146	WC0419927	WC05582751
Sample Date	Client Info		05 May 2024	13 Aug 2023	26 Mar 2022
Machine Age	yrs	Client Info	12	11	6
Grease Age	yrs	Client Info	1	1	0
Grease Serviced	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>200	41	40	49	
Iron	ppm	ASTM D5185m	>250	371	501	499
Chromium	ppm	ASTM D5185m	>10	19	24	24
Nickel	ppm	ASTM D5185m	>5	0	0	0
Cadmium	ppm	ASTM D5185m		1	1	0
Titanium	ppm	ASTM D5185m		0	0	<1
Vanadium	ppm	ASTM D5185m		1	1	<1
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>75	11	12	9
Tin	ppm	ASTM D5185m	>5	0	0	0
Silver	ppm	ASTM D5185m	>5	0	5	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		197	238	189
Magnesium	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		5	6	6
Molybdenum	ppm	ASTM D5185m		3887	3988	2455
Phosphorus	ppm	ASTM D5185m		640	655	419
Zinc	ppm	ASTM D5185m		254	181	110
Antimony	ppm	ASTM D5185m		---	---	---

THICKENER/SOAP

	method	limit/base	current	history1	history2	
Aluminum	ppm	ASTM D5185m		0	0	8
Barium	ppm	ASTM D5185m		12	13	9
Calcium	ppm	ASTM D5185m		92	128	159
Sodium	ppm	ASTM D5185m		31	32	25
Lithium	ppm	ASTM D5185m		2820	2955	1972
Sulfur	ppm	ASTM D5185m		5773	7047	5481



CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>150	256	▲ 621	40
Potassium	ppm	ASTM D5185m		5	4	3

GREASE CONDITION





	method	limit/base	current	history1	history2
Grease Color	*Visual	yellow	Yellow	---	---
Texture	*In-house		Buttery	---	---
NLGI Consistency	NLGI Scale *SKF Method	1	0-1	---	---

GREASE ANALYSIS

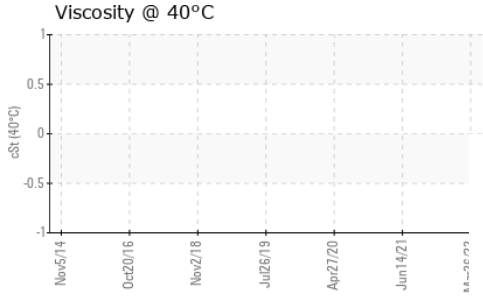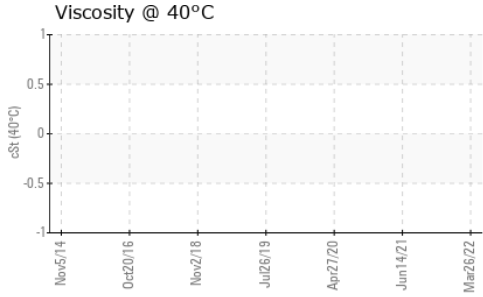

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter			no image	no image	no image

GRAPHS

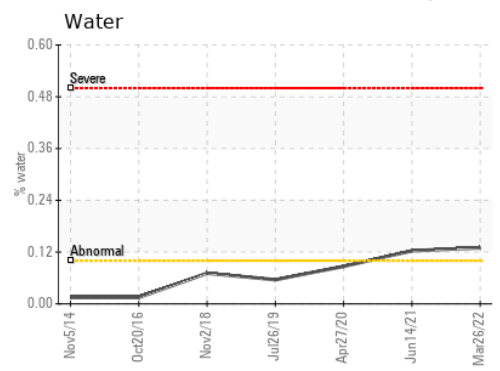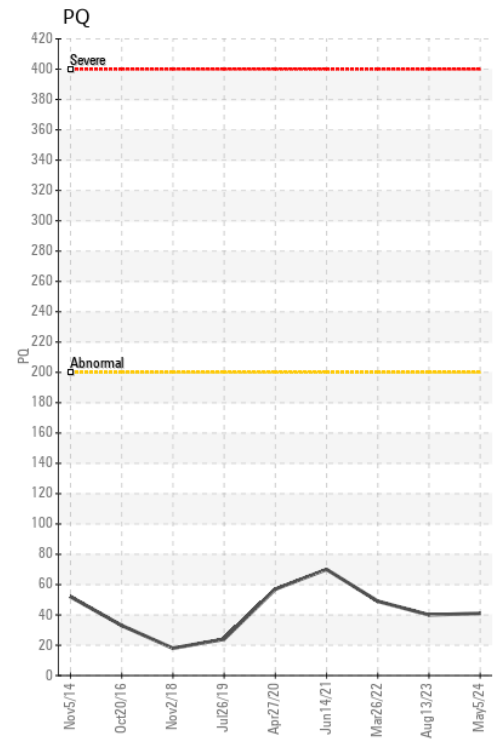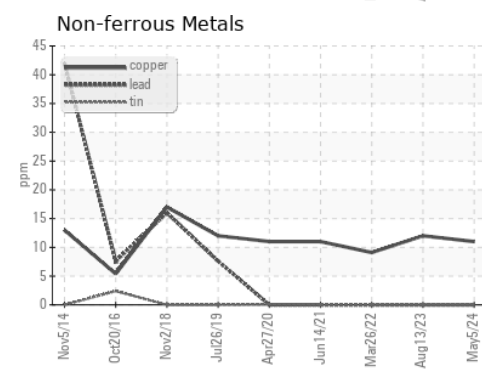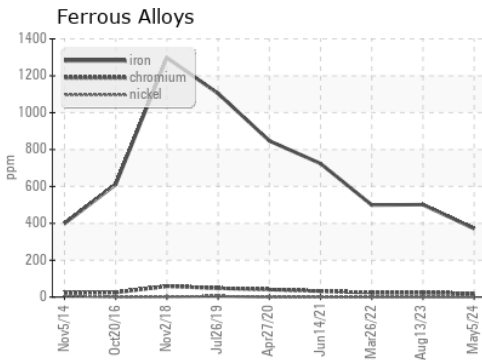

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0881146 **Received** : 29 May 2024
Lab Number : 06194912 **Tested** : 13 Jun 2024
Unique Number : 11057035 **Diagnosed** : 13 Jun 2024 - Doug Bogart
Test Package : GRS 1 (Additional Tests: KV40, SCREEN)

EOLO DE NICARAGUA S.A.
 DEL SEMAFORO DEL CLUB TERRAZA, 1 CUADRA AL SUR
 MANAGUA, ZZ
 NI
 Contact: Rafael Bermudez

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: