




GREASE ANALYSIS

Sample Rating Trend

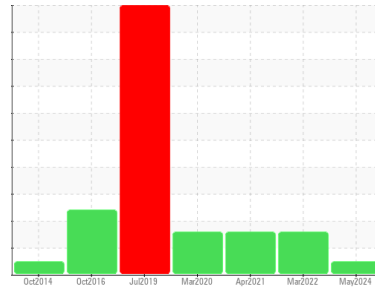

NORMAL



Machine Id
TURBINA 01 - REAR BEARING
 Component
Grease
 Fluid
KLUBER KLUBERPLEX BEM 41-141 (--- LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Grease Condition

The condition of the grease is acceptable for the time in service.

Contaminants

There is no indication of any contamination in the grease.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0881130	WC05582717	WC05279442
Sample Date	Client Info		07 May 2024	29 Mar 2022	28 Apr 2021
Machine Age	mths	Client Info	12	0	0
Grease Age	mths	Client Info	6	6	18
Grease Serviced	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	MARGINAL	MARGINAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>200	269	204	221	
Iron	ppm	ASTM D5185m	>250	685	▲ 752	▲ 1049
Chromium	ppm	ASTM D5185m	>10	97	▲ 62	▲ 63
Nickel	ppm	ASTM D5185m	>5	0	0	0
Cadmium	ppm	ASTM D5185m		<1	<1	0
Titanium	ppm	ASTM D5185m		<1	<1	<1
Vanadium	ppm	ASTM D5185m		1	<1	<1
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>75	15	11	10
Tin	ppm	ASTM D5185m	>5	0	0	0
Silver	ppm	ASTM D5185m	>5	0	3	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		210	199	192
Magnesium	ppm	ASTM D5185m		0	<1	2
Manganese	ppm	ASTM D5185m		7	8	11
Molybdenum	ppm	ASTM D5185m		3773	2312	1579
Phosphorus	ppm	ASTM D5185m		661	454	318
Zinc	ppm	ASTM D5185m		274	113	119
Antimony	ppm	ASTM D5185m		---	---	2

THICKENER/SOAP

	method	limit/base	current	history1	history2	
Aluminum	ppm	ASTM D5185m		0	6	15
Barium	ppm	ASTM D5185m		11	8	7
Calcium	ppm	ASTM D5185m		97	139	184
Sodium	ppm	ASTM D5185m		37	28	29
Lithium	ppm	ASTM D5185m		3035	2069	1611
Sulfur	ppm	ASTM D5185m		6132	5754	5845



CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>150	176	41	34
Potassium	ppm	ASTM D5185m		5	3	3

GREASE CONDITION





	method	limit/base	current	history1	history2
Grease Color	*Visual	yellow	Yellow	---	---
Texture	*In-house		Buttery	---	---
NLGI Consistency	NLGI Scale *SKF Method	1	0-1	---	---

GREASE ANALYSIS

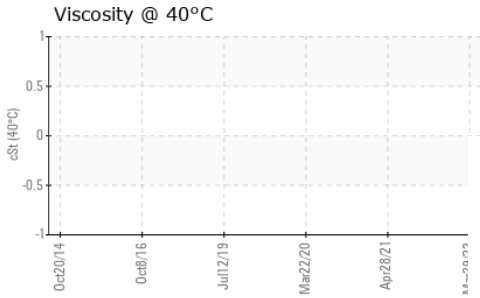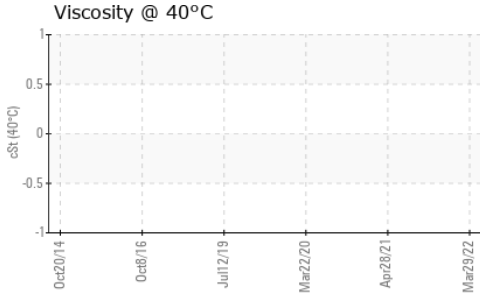

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter			no image	no image	no image

GRAPHS

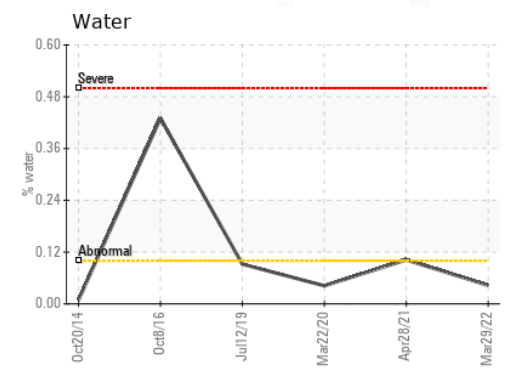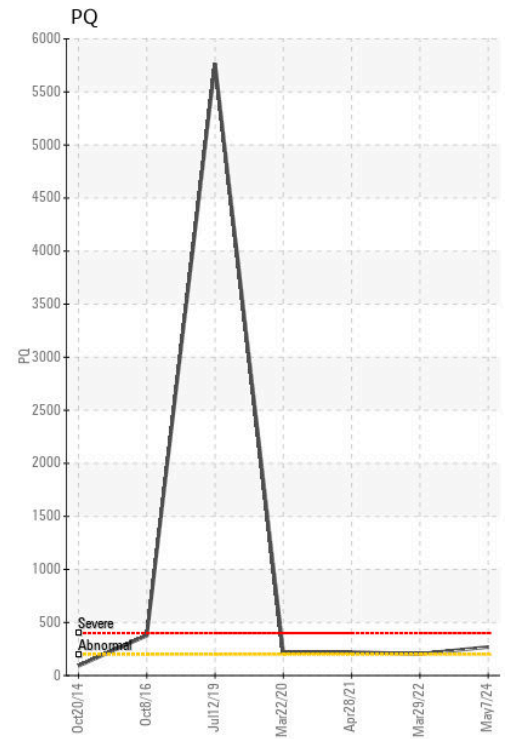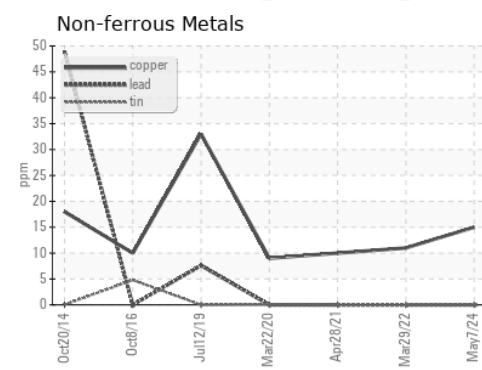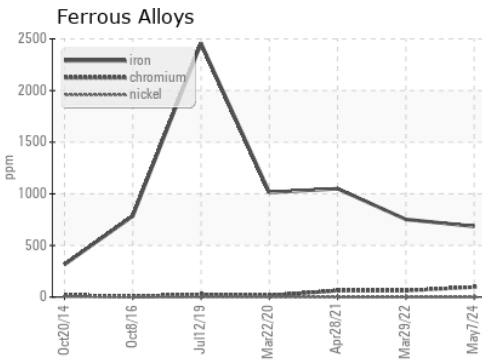

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0881130 **Received** : 29 May 2024
Lab Number : **06194916** **Tested** : 13 Jun 2024
Unique Number : 11057039 **Diagnosed** : 13 Jun 2024 - Doug Bogart
Test Package : GRS 1 (Additional Tests: KV40, SCREEN)

EOLO DE NICARAGUA S.A.
 DEL SEMAFORO DEL CLUB TERRAZA, 1 CUADRA AL SUR
 MANAGUA, ZZ
 NI

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: Oliver Narvaez
 oliver.narvaez@somoscmi.com
 T: 5(058)625-2038

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)