



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**DH GEN SN12**  
 Component  
**Genset**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
 Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>AO0000288</b>	---	---
Sample Date	Client Info			<b>19 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>512</b>	---	---
Oil Age	hrs	Client Info		<b>512</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	---	---
Water	WC Method	>0.1		<b>NEG</b>	---	---
Glycol	WC Method			<b>NEG</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>12	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>17	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>70	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	10	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	100	<b>46</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	450	<b>261</b>	---	---
Calcium	ppm	ASTM D5185m	3000	<b>1989</b>	---	---
Phosphorus	ppm	ASTM D5185m	1150	<b>1033</b>	---	---
Zinc	ppm	ASTM D5185m	1350	<b>1220</b>	---	---
Sulfur	ppm	ASTM D5185m	4250	<b>3456</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>5</b>	---	---
Sodium	ppm	ASTM D5185m	>158	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.3</b>	---	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.6</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.3</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.4</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>8.0</b>	---	---





# OIL ANALYSIS REPORT

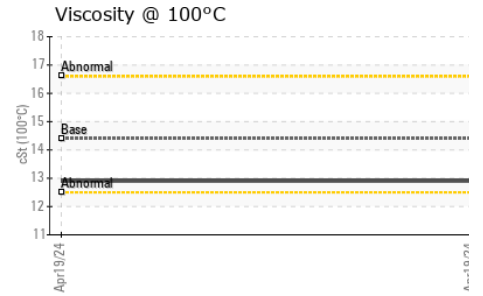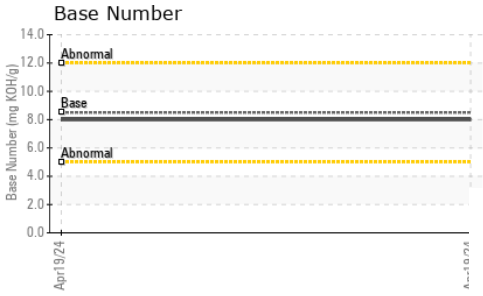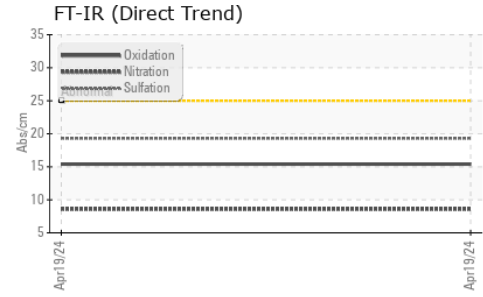

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.9</b>	---

### GRAPHS

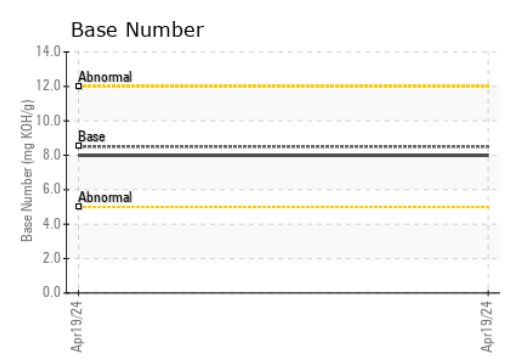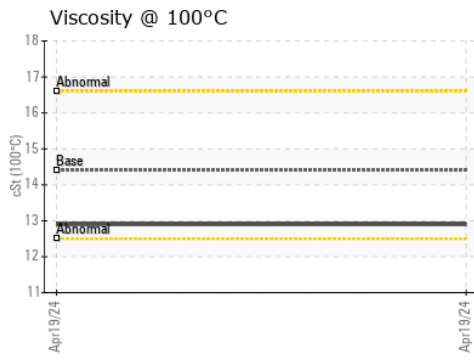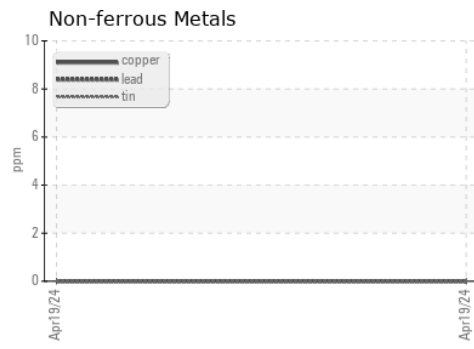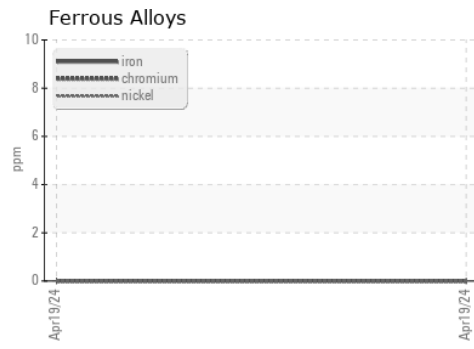

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : AO0000288      **Received** : 30 May 2024  
**Lab Number** : **06195207**      **Tested** : 31 May 2024  
**Unique Number** : 11057330      **Diagnosed** : 31 May 2024 - Wes Davis  
**Test Package** : FLEET

**DEEP WELL SERVICES**  
 10218 WEST CR 148  
 MIDLAND, TX  
 US 79706  
 Contact: ADRIAN GARCIA  
 agarcia@deepwellservices.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)