


## **OIL ANALYSIS REPORT**

Sample Rating Trend

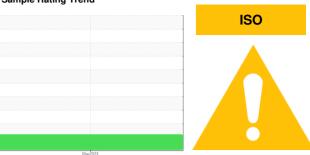

Machine Id

# 8363652 (S/N 2228)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

#### **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017781		
Sample Date		Client Info		09 May 2024		
Machine Age	hrs	Client Info		1908		
Oil Age	hrs	Client Info		1908		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	13		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	3		
		ASTM D5185m	>50	15		
Copper	ppm	ASTM D5185m	>10	1		
Vanadium	ppm	ASTM D5185m	>10	ι <1		
	ppm					
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	17		
Barium	ppm	ASTM D5185m	90	6		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		3		
Magnesium	ppm	ASTM D5185m	100	26		
Calcium	ppm	ASTM D5185m	0	527		
Phosphorus	ppm	ASTM D5185m	0	348		
Zinc	ppm	ASTM D5185m	0	244		
Sulfur	ppm	ASTM D5185m	23500	10766		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	5		
Water	%	ASTM D6304	>0.05	0.022		
ppm Water	ppm	ASTM D6304	>500	226		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		9771		
Particles >6µm		ASTM D7647	>1300	<b>4582</b>		
Particles >14μm		ASTM D7647	>80	<u>^</u> 234		
Particles >21µm		ASTM D7647	>20	22		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.32		



## **OIL ANALYSIS REPORT**





Laboratory Sample No.

: KCPA017781

Lab Number : 06195417 Unique Number : 11057540

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Received : 30 May 2024 **Tested** : 31 May 2024

Diagnosed

: 31 May 2024 - Angela Borella

Contact: Service Manager

1801 LONE STAR DR

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: BUZDAL [WUSCAR] 06195417 (Generated: 05/31/2024 16:53:17) Rev: 1

Contact/Location: Service Manager - BUZDAL

DALLAS, TX

US 75212

T:

F: