




# OIL ANALYSIS REPORT

Sample Rating Trend

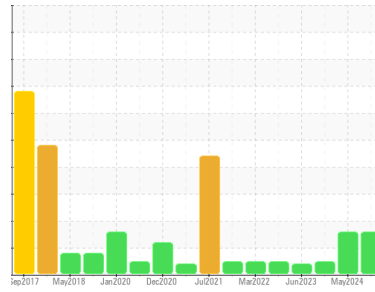

ISO



Machine Id  
**KAESER BSD 50T 5831166 (S/N 3841)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA012601</b>	KCPA012571	KCPA010179
Sample Date	Client Info		<b>08 May 2024</b>	08 May 2024	12 Dec 2023
Machine Age	hrs	Client Info	<b>34159</b>	34159	51315
Oil Age	hrs	Client Info	<b>2946</b>	2844	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	0
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	<1	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	2	0
Lead	ppm	ASTM D5185m >10	<1	<1	0
Copper	ppm	ASTM D5185m >50	5	6	12
Tin	ppm	ASTM D5185m >10	<1	<1	0
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	<1	2	0
Molybdenum	ppm	ASTM D5185m	<1	<1	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	41	53	4
Calcium	ppm	ASTM D5185m 2	0	<1	0
Phosphorus	ppm	ASTM D5185m	6	3	0
Zinc	ppm	ASTM D5185m	23	22	35
Sulfur	ppm	ASTM D5185m	23243	23075	17145

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	18	19	0
Sodium	ppm	ASTM D5185m	14	10	4
Potassium	ppm	ASTM D5185m >20	5	4	0
Water	%	ASTM D6304 >0.05	0.020	0.020	0.006
ppm Water	ppm	ASTM D6304 >500	209	200	66

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		4673	5819	866
Particles >6µm	ASTM D7647	>1300	1517	1785	280
Particles >14µm	ASTM D7647	>80	213	206	26
Particles >21µm	ASTM D7647	>20	76	63	6
Particles >38µm	ASTM D7647	>4	4	5	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	19/18/15	20/18/15	17/15/12

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.34	0.37	0.34

# OIL ANALYSIS REPORT

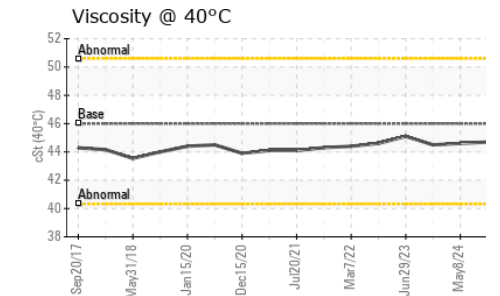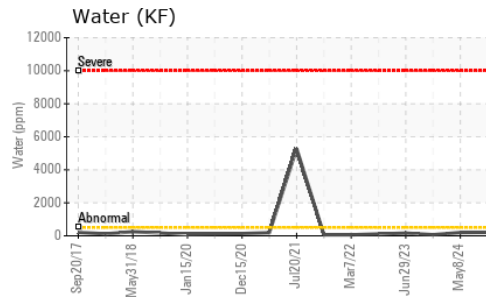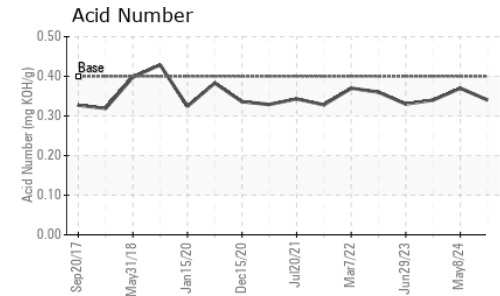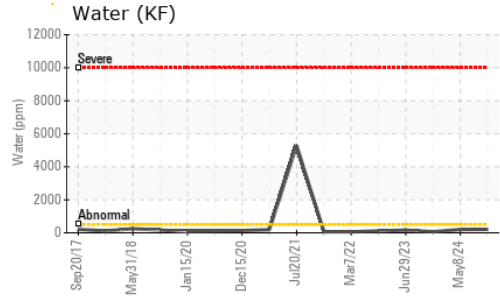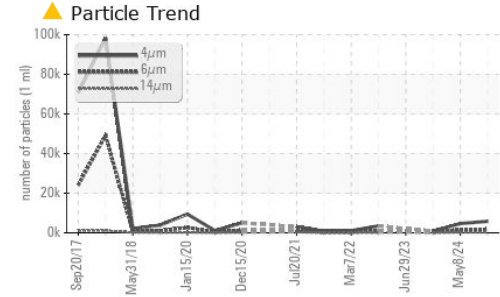





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.6	44.5

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

**GRAPHS**

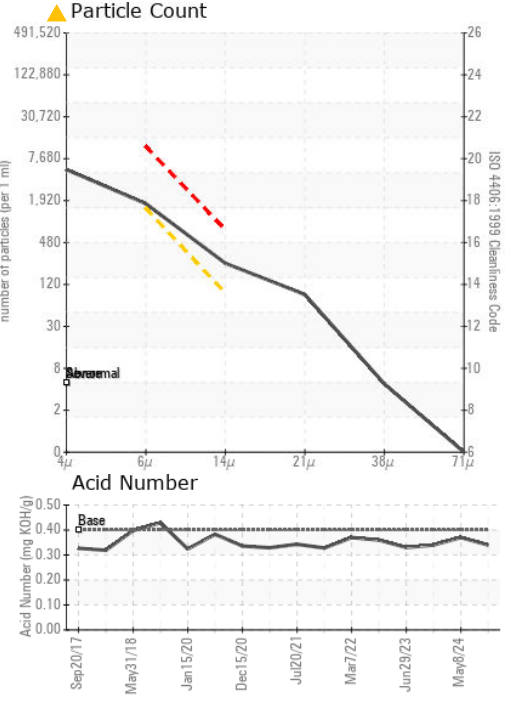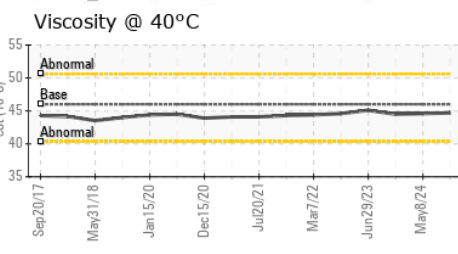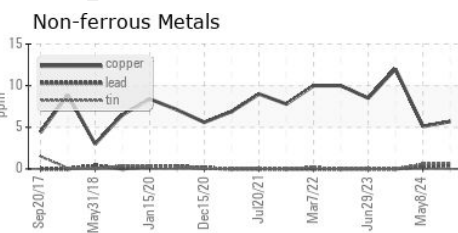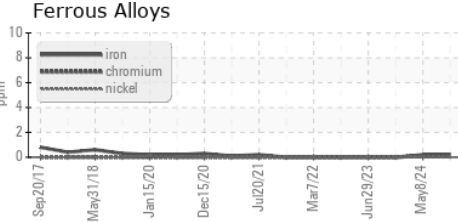

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012601 **Received** : 30 May 2024  
**Lab Number** : 06195430 **Tested** : 31 May 2024  
**Unique Number** : 11057553 **Diagnosed** : 31 May 2024 - Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**H & S MANUFACTURING**  
 2913 SINGLETON ST  
 ROWLETT, TX  
 US 75088  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)