




OIL ANALYSIS REPORT

Sample Rating Trend

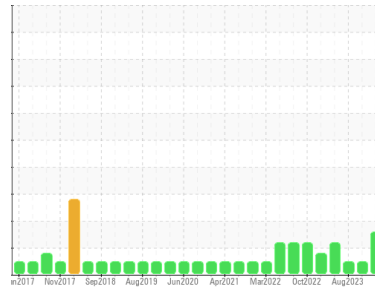

WEAR



Machine Id
BUSCH TYSWALWAS VAC 5C (S/N U074106871)
 Component
Pump
 Fluid
USPI VAC 100 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend an early resample to monitor this condition.

▲ Wear

The iron level is abnormal.

▲ Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM36371	USPM31851	USPM29084
Sample Date	Client Info		29 May 2024	12 Dec 2023	01 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	▲ 104	56	67
Chromium	ppm	ASTM D5185m >5	<1	0	0
Nickel	ppm	ASTM D5185m >5	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >7	2	<1	<1
Lead	ppm	ASTM D5185m >12	<1	0	0
Copper	ppm	ASTM D5185m >30	<1	<1	<1
Tin	ppm	ASTM D5185m >9	<1	1	<1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	<1	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 0	<1	0	0
Calcium	ppm	ASTM D5185m 0	1	1	0
Phosphorus	ppm	ASTM D5185m 1800	1190	965	983
Zinc	ppm	ASTM D5185m 0	4	0	0
Sulfur	ppm	ASTM D5185m 0	0	34	8

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	5	2	2
Sodium	ppm	ASTM D5185m	20	10	9
Potassium	ppm	ASTM D5185m >20	5	4	4
Water	%	ASTM D6304 >.1	0.057	0.032	0.032
ppm Water	ppm	ASTM D6304 >1000	576	325	329.2

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 39595	383	1160
Particles >6µm	ASTM D7647	>1300	1229	115	196
Particles >14µm	ASTM D7647	>160	26	14	21
Particles >21µm	ASTM D7647	>40	8	3	5
Particles >38µm	ASTM D7647	>10	0	0	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/17/12	16/14/11	17/15/12

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	0.72	0.51	0.49

OIL ANALYSIS REPORT


Particle Trend

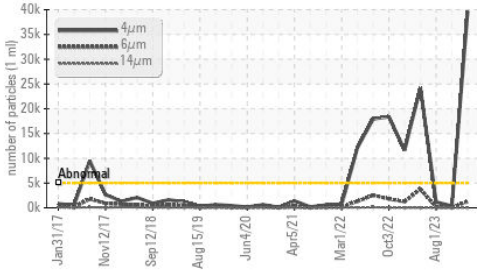


Water (KF)

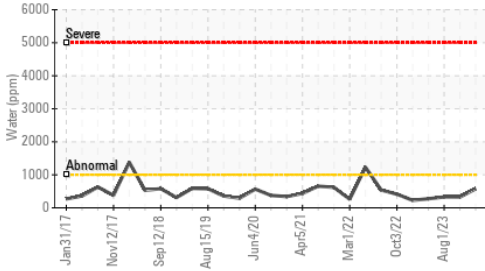


Ferrous Alloys

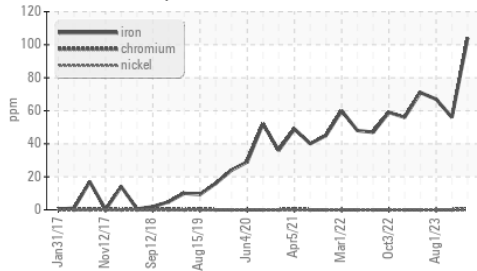

Acid Number

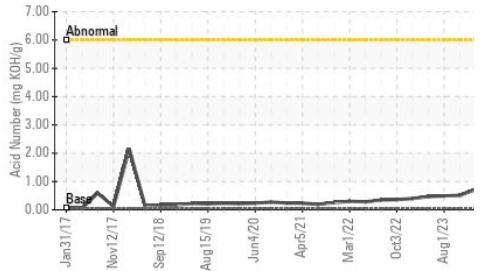


Water (KF)

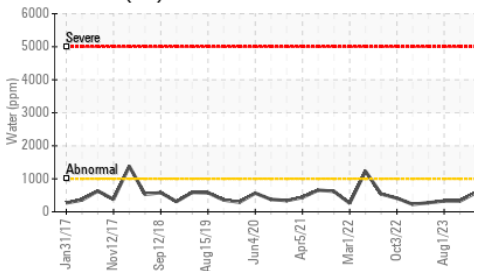

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	110	103	102

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

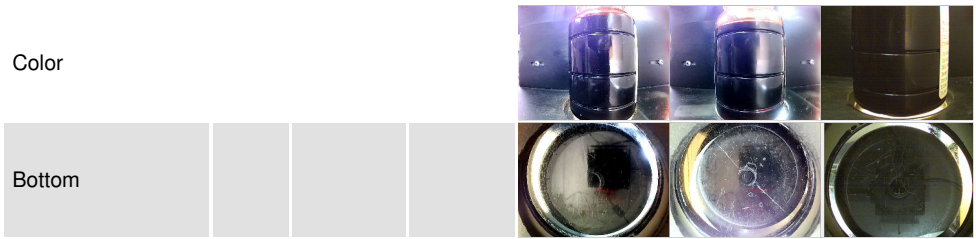


GRAPHS


Ferrous Alloys

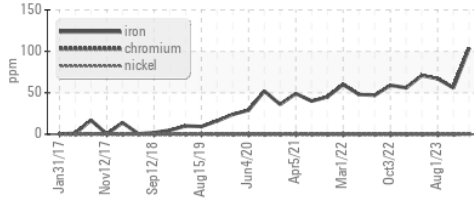


Non-ferrous Metals

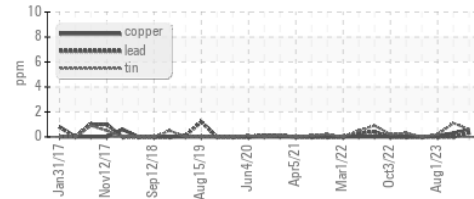


Viscosity @ 40°C

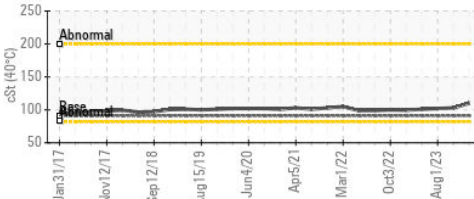

Particle Count

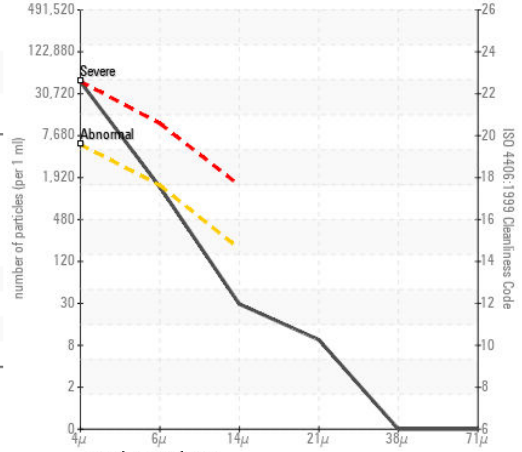

Acid Number

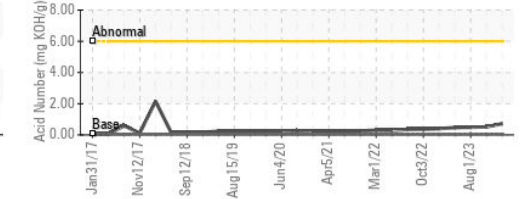

Certificate 12367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36371
Lab Number : 06195472
Unique Number : 11057595
Test Package : IND 2

Received : 30 May 2024
Tested : 31 May 2024
Diagnosed : 31 May 2024 - Doug Bogart

TYSON - PASCO WALLULA -USP
 DODD RD
 WALLULA, WA
 US 99363
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375

F: (402)423-6661