


OIL ANALYSIS REPORT

South Engine Room FRICK TYSCMIS C-7 SER (S/N SO555QFMPTTAC03)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012749	USP0007073	USP0003090
Sample Date		Client Info		29 May 2024	13 Feb 2024	05 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	8	12	3
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	<1	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	0
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		<1	<1	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	<1
Zinc	ppm	ASTM D5185m		1	0	0
Sulfur	ppm	ASTM D5185m	50	0	1	4
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	nnm	ASTM D5185m	>15	2	2	2
Sodium	ppm	ASTM D5185m	710	0	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.01	0.003	0.005	0.003
ppm Water	ppm	ASTM D6304		38	55	37.8
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	2415	2222	15324
Particles >6µm		ASTM D7647		364	584	3523
Particles >14µm		ASTM D7647	>320	15	28	94
Particles >21µm		ASTM D7647		2	8	9
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/11	18/16/12	21/19/14
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.013	0.029	0.014





OIL ANALYSIS REPORT












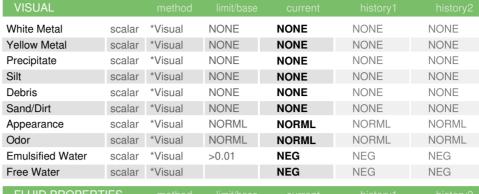



FLUID PROPER	711ES	method			riistory i	riistoryz
Visc @ 40°C	cSt	ASTM D445	65.6	65.3	66.0	65.9

MPLE IMAGES	method	

Color





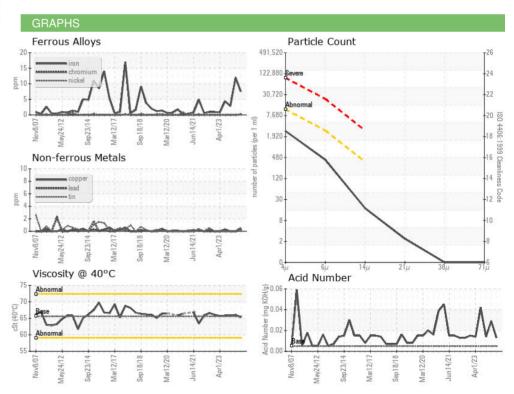





Certificate 12367

Laboratory Sample No.

Lab Number : 06195502 Unique Number : 11057625 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : USP0012749 Received : 30 May 2024

Tested : 31 May 2024 Diagnosed : 02 Jun 2024 - Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: SERVICE MANAGER - TYSCARMS

CARTHAGE, MS

US 75633

T:

F:

TYSON -CARTHAGE MS-USP

Contact: SERVICE MANAGER