




# OIL ANALYSIS REPORT

Area  
**ROTO H PLUS 32**  
 Machine Id  
**ATLAS COPCO ZH4000 ACC0445245 - S.C. JOHNSON WAX**  
 Component  
**Compressor**

## Sample Rating Trend

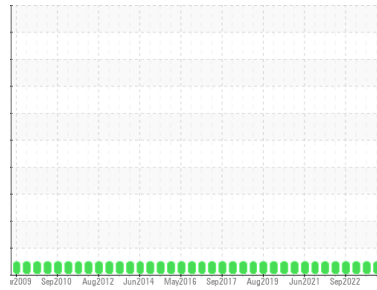

**NORMAL**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCZ06195543</b>	UCZ05861983	UCZ05736233
Sample Date	Client Info		<b>22 May 2024</b>	19 May 2023	29 Dec 2022
Machine Age	hrs	Client Info	<b>62183</b>	35591	32984
Oil Age	hrs	Client Info	<b>2700</b>	4500	2029
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >15	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >65	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >65	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	2	22
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>16</b>	113	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>1</b>	2	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Water	%	ASTM D6304 >0.1	<b>NEG</b>	NEG	NEG

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.06	<b>0.068</b>	0.167	0.079

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>LIGHT</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



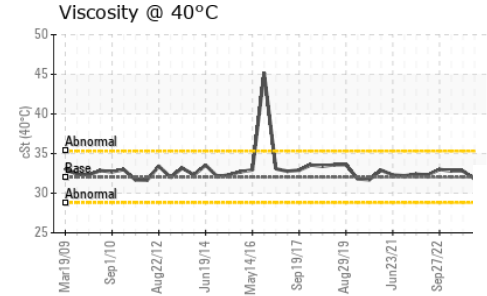
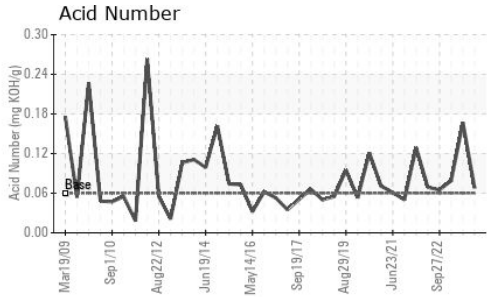


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.0	<b>31.8</b>	32.8	32.8

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

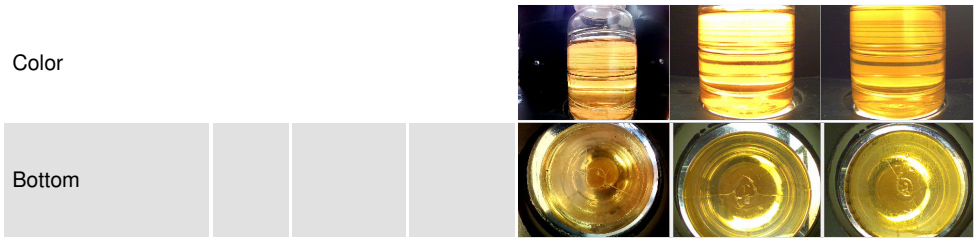

## GRAPHS

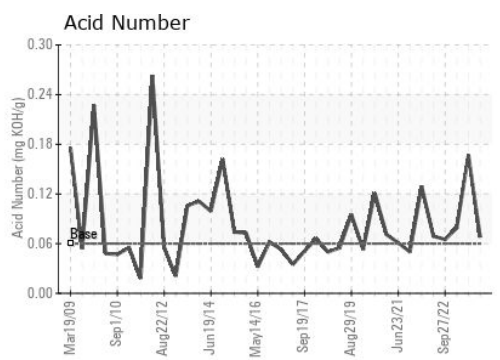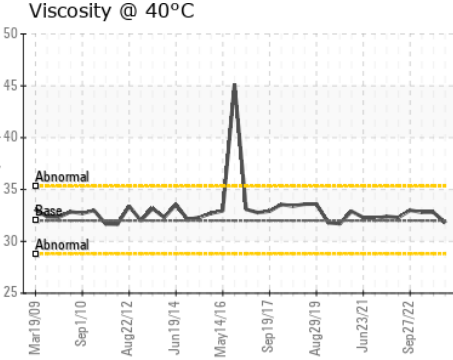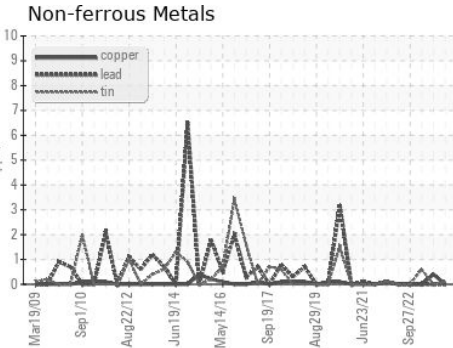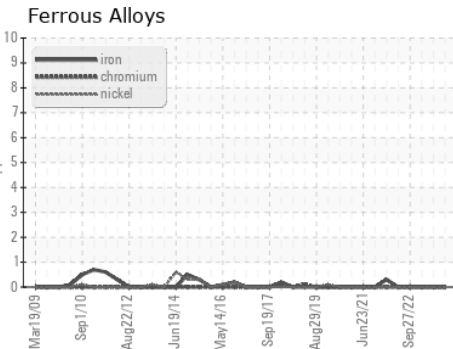

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06195543      **Received** : 30 May 2024  
**Lab Number** : 06195543      **Tested** : 01 Jun 2024  
**Unique Number** : 11057666      **Diagnosed** : 01 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**ZORN COMP & EQUIPMENT INC - MAIN**  
 1335 E WISCONSIN AVE  
 PEWAUKEE, WI  
 US 53072  
 Contact: TONY STELLA  
 tony.stella@zornair.com  
 T: (800)476-4637  
 F: (262)695-7017

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)