




# OIL ANALYSIS REPORT

## Sample Rating Trend

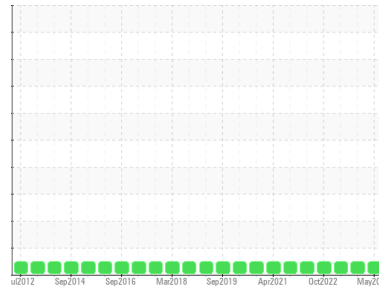

**NORMAL**



Machine Id  
**INGERSOLL RAND CMC-13011A - RJR T VILLE (S/N M87-4168)**  
 Component  
**Compressor**  
 Fluid  
**MOBIL DTE 732 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0923283</b>	WC0858579	WC0802894
Sample Date	Client Info			<b>21 May 2024</b>	30 Oct 2023	15 Jun 2023
Machine Age	hrs	Client Info		<b>29009</b>	28073	27372
Oil Age	hrs	Client Info		<b>2000</b>	600	2600
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	3	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	6	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	4
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	8	1
Zinc	ppm	ASTM D5185m		<b>0</b>	0	6
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	0



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	<b>0.09</b>	0.099	0.053

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



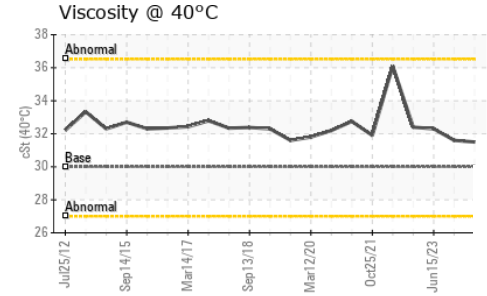
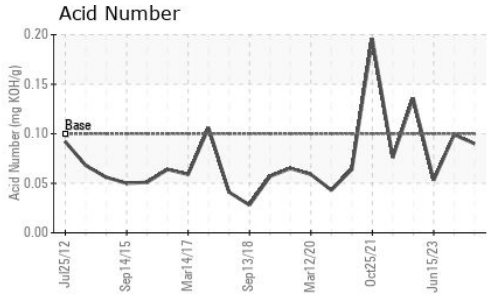


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	30.0	<b>31.5</b>	31.6	32.3

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

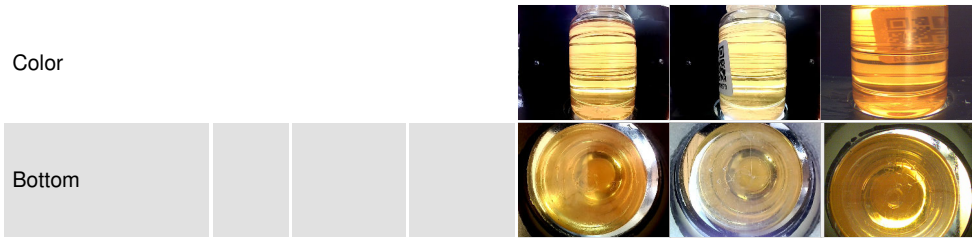

## GRAPHS

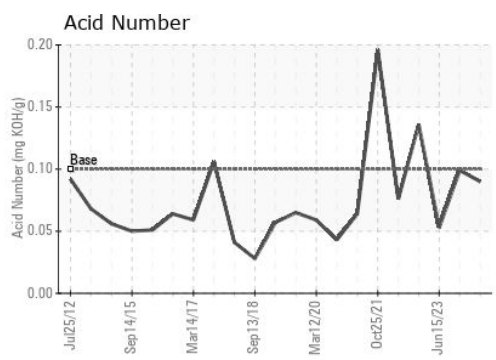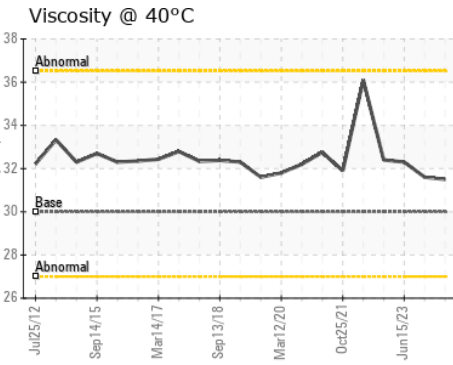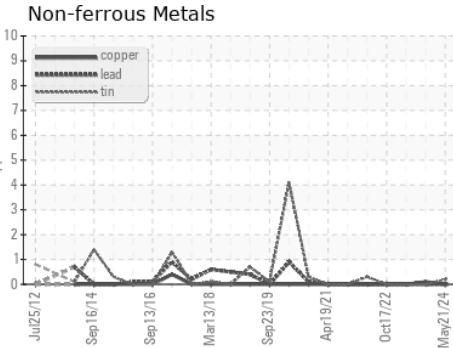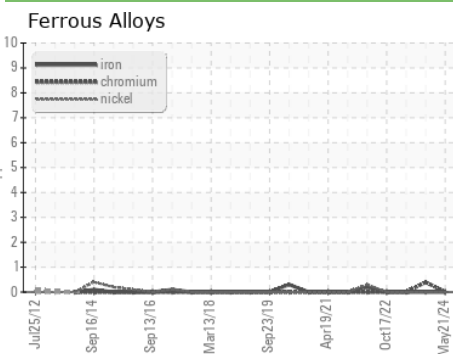

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0923283      **Received** : 30 May 2024  
**Lab Number** : 06195580      **Tested** : 01 Jun 2024  
**Unique Number** : 11057703      **Diagnosed** : 01 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**FS-COMPRESSION CO, LLC**  
 203 AERO COURT  
 GREENSBORO, NC  
 US 27409  
 Contact: Dallas Burcham  
 dallas.burcham@fs-compression.com  
 T: (336)605-9622  
 F: (336)605-9844

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)