




OIL ANALYSIS REPORT



Machine Id
IRGM01BE (S/N CTL0580)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (108 GAL)

Sample Rating Trend

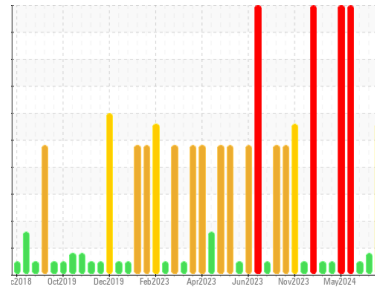

DIRT



DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition.

▲ Wear

The tin level is abnormal. All other component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0789116	WC0789115	WC0789114
Sample Date	Client Info		28 May 2024	22 May 2024	13 May 2024
Machine Age	hrs	Client Info	16713	16588	16468
Oil Age	hrs	Client Info	125	120	107
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	10	12	4
Chromium	ppm	ASTM D5185m >4	<1	<1	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >6	3	4	2
Lead	ppm	ASTM D5185m >9	6	3	1
Copper	ppm	ASTM D5185m >6	3	2	1
Tin	ppm	ASTM D5185m >4	▲ 5	▲ 5	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	22	23	8
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	11	16	9
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	48	44	34
Calcium	ppm	ASTM D5185m	1883	1834	2030
Phosphorus	ppm	ASTM D5185m	373	322	368
Zinc	ppm	ASTM D5185m	452	433	463
Sulfur	ppm	ASTM D5185m	3458	3259	3352

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	▲ 216	174	109
Sodium	ppm	ASTM D5185m >21	<1	1	1
Potassium	ppm	ASTM D5185m >20	0	<1	<1

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0
Nitration	Abs/cm	*ASTM D7624	6.0	5.8	5.4
Sulfation	Abs/.1mm	*ASTM D7415	21.3	19.8	18.0


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	13.2	11.9	10.0
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	2.28	1.32	0.64
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	3.72	3.38	4.54




OIL ANALYSIS REPORT


Non-ferrous Metals

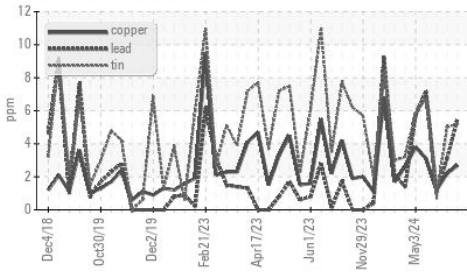


FT-IR (Direct Trend)

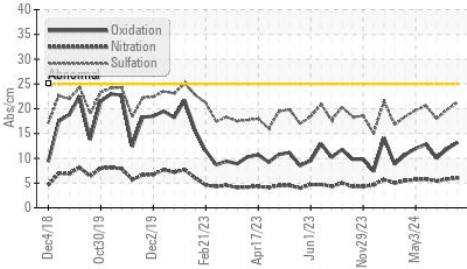


Acid Number

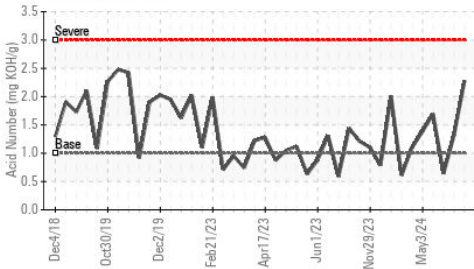

Acid Number

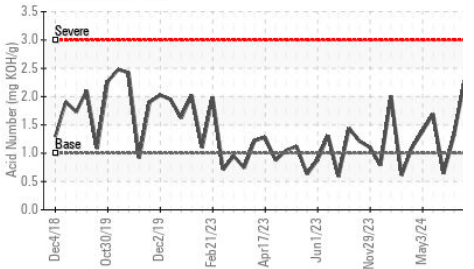









Base Number

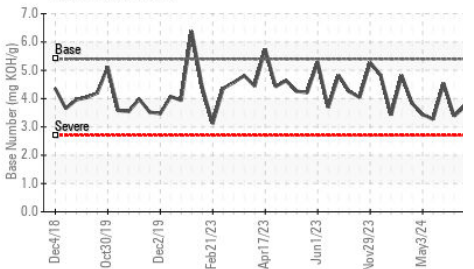

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.7	13.4

GRAPHS

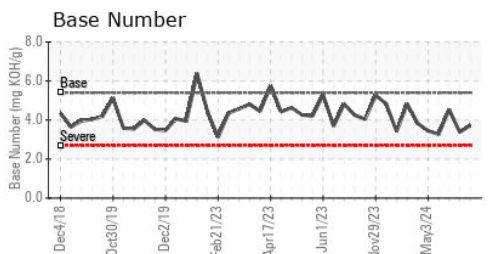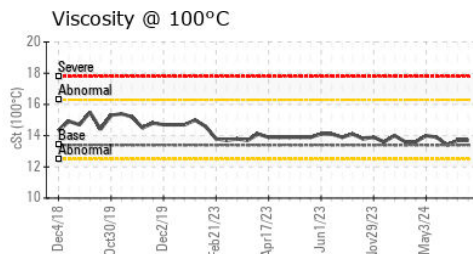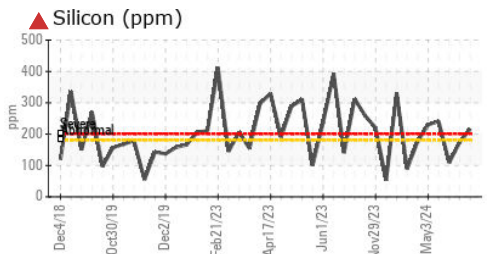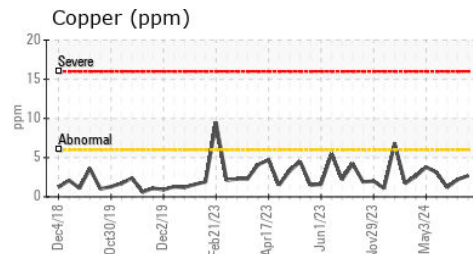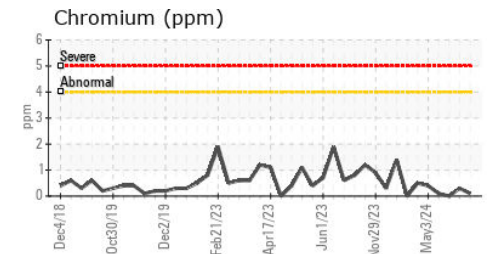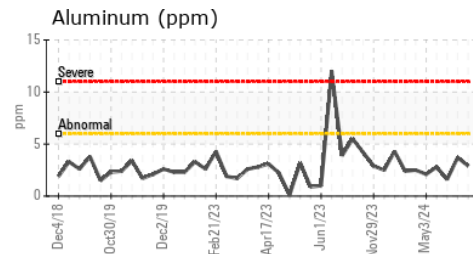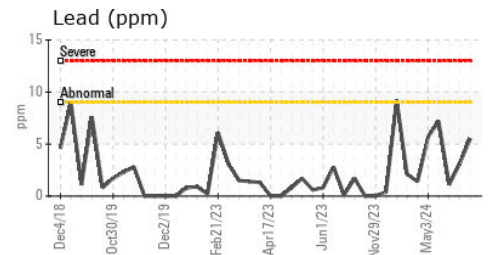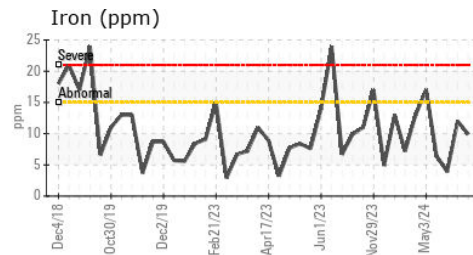

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0789116
 Lab Number : 06195612
 Unique Number : 11057735
 Test Package : MOB 2

Received : 30 May 2024
 Tested : 31 May 2024
 Diagnosed : 03 Jun 2024 - Sean Felton

EDL NA Recips-Iris Glen
 IRIS GLEN POWER STATION, 1705 E MAIN ST
 JOHNSON CITY, TN
 US 37601
 Contact: CHRIS SMITH
 csmith@stowerscat.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: