



OIL ANALYSIS REPORT

Sample Rating Trend



WATER



Machine Id

KAESER 7361645

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil. High concentration of visible dirt/debris present in the oil.

▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|----------|----------|
| Sample Number | Client Info | | KCPA015327 | --- | --- |
| Sample Date | Client Info | | 23 Apr 2024 | --- | --- |
| Machine Age | hrs | Client Info | 34541 | --- | --- |
| Oil Age | hrs | Client Info | 0 | --- | --- |
| Oil Changed | Client Info | | Changed | --- | --- |
| Sample Status | | | ABNORMAL | --- | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | 16 | --- | --- |
| Chromium | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m >3 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m >3 | 0 | --- | --- |
| Silver | ppm | ASTM D5185m >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m >50 | 6 | --- | --- |
| Tin | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <1 | --- | --- |
| Cadmium | ppm | ASTM D5185m | 0 | --- | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|----------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | --- | --- |
| Barium | ppm | ASTM D5185m 90 | 1 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m 90 | 1 | --- | --- |
| Calcium | ppm | ASTM D5185m 2 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 8 | --- | --- |
| Zinc | ppm | ASTM D5185m | 3 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 12739 | --- | --- |




CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|----------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | --- | --- |
| Sodium | ppm | ASTM D5185m | <1 | --- | --- |
| Potassium | ppm | ASTM D5185m >20 | 0 | --- | --- |
| Water | % | ASTM D6304 >0.05 | ▲ 0.107 | --- | --- |
| ppm Water | ppm | ASTM D6304 >500 | ▲ 1070 | --- | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.4 | 0.51 | --- | --- |

OIL ANALYSIS REPORT

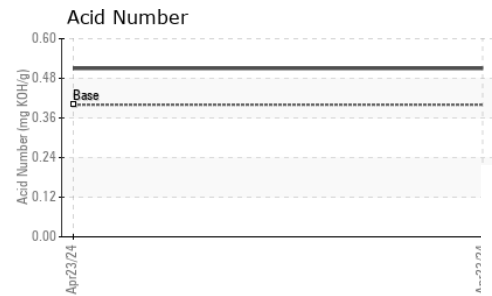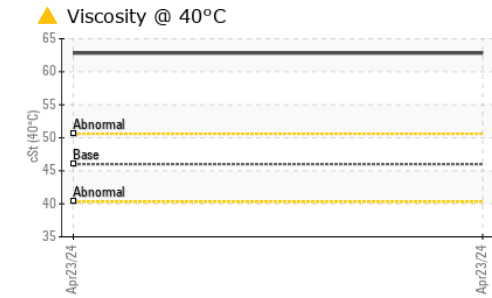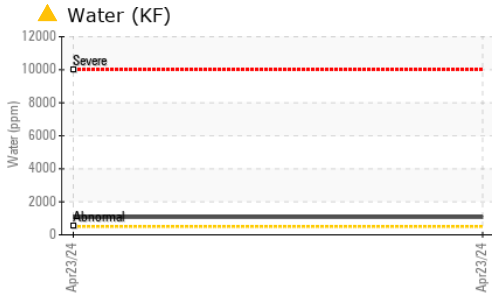





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|--------------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | HEAVY | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | 0.2% | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|--------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 62.82 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|--|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

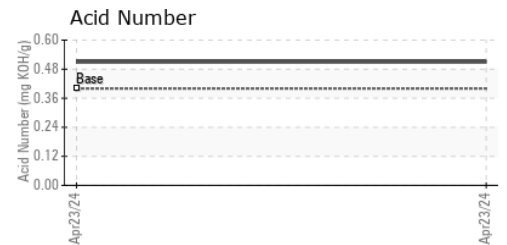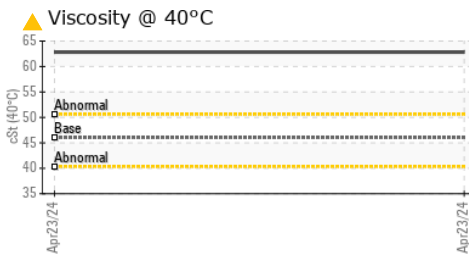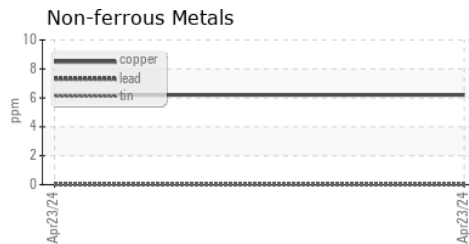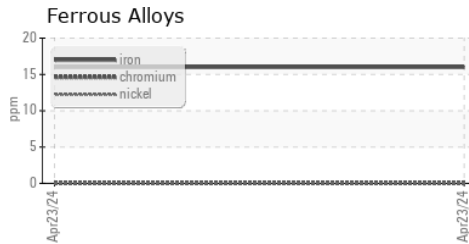

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015327
Lab Number : 06195928
Unique Number : 11058051
Test Package : IND 2 (Additional Tests: KF, PrtCount)

Received : 30 May 2024

Tested : 05 Jun 2024

Diagnosed : 05 Jun 2024 - Jonathan Hester

PEYTON'S SOUTHEASTERN
 153 REFRESHMENT LN SW
 CLEVELAND, TN
 US 37311

Contact: CHRISTOPHER CARTWRIGHT
 christopher.cartwright@kroger.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: