


OIL ANALYSIS REPORT

Sample Rating Trend

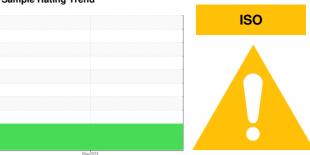

Machine Id

KAESER 8482345

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
			111111111111111111111111111111111111111			
Sample Number		Client Info		KCPA018279		
Sample Date	lawa	Client Info		24 May 2024		
Machine Age	hrs	Client Info		5364		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		Changed ABNORMAL		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	7		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		3		
Magnesium	ppm	ASTM D5185m	100	18		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	<1		
Zinc	ppm	ASTM D5185m	0	59		
Sulfur	ppm	ASTM D5185m	23500	21258		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.011		
ppm Water	ppm	ASTM D6304	>500	120		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		20015		
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 6881		
Particles >14μm		ASTM D7647	>80	^ 726		
Particles >21µm		ASTM D7647	>20	238		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/20/17</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.53		



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No.

Lab Number : 06195930 Unique Number : 11058053

: KCPA018279

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 30 May 2024 Tested : 02 Jun 2024 Diagnosed

: 02 Jun 2024 - Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: BIOPLE [WUSCAR] 06195930 (Generated: 06/02/2024 17:35:22) Rev: 1

Contact/Location: Service Manager - BIOPLE

11101 88TH AVE

US 53158

T:

F:

PLEASANT PRAIRIE, WI

Contact: Service Manager