




# OIL ANALYSIS REPORT

## Sample Rating Trend

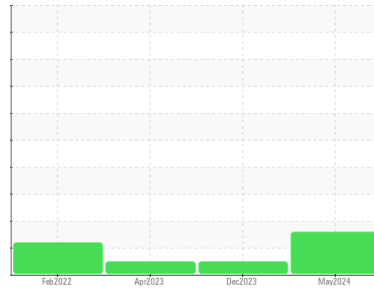

ISO



Machine Id  
**2214089 (S/N 1011)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA017907</b>	KCPA009320	KCP53503
Sample Date	Client Info			<b>20 May 2024</b>	07 Dec 2023	19 Apr 2023
Machine Age	hrs	Client Info		<b>80671</b>	79127	76937
Oil Age	hrs	Client Info		<b>1544</b>	0	4200
Oil Changed		Client Info		<b>Not Chngd</b>	N/A	Changed
Sample Status				<b>ATTENTION</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	3	4
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>22</b>	6	2
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>64</b>	39	7
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	1	0
Zinc	ppm	ASTM D5185m	0	<b>14</b>	2	23
Sulfur	ppm	ASTM D5185m	23500	<b>21502</b>	18486	21146

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	5	11
Sodium	ppm	ASTM D5185m		<b>18</b>	11	2
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.019</b>	0.020	0.008
ppm Water	ppm	ASTM D6304	>500	<b>190</b>	202	83.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3765</b>	946	640
Particles >6µm		ASTM D7647	>1300	<b>1350</b>	287	167
Particles >14µm		ASTM D7647	>80	<b>113</b>	24	7
Particles >21µm		ASTM D7647	>20	<b>27</b>	7	2
Particles >38µm		ASTM D7647	>4	<b>2</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/18/14</b>	17/15/12	16/15/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.50</b>	0.38	0.41

# OIL ANALYSIS REPORT

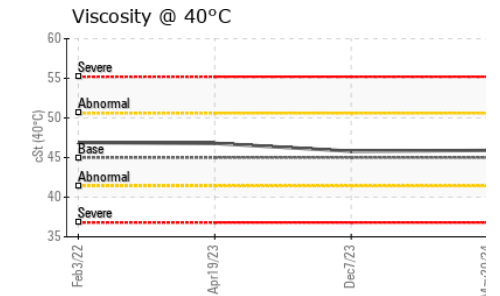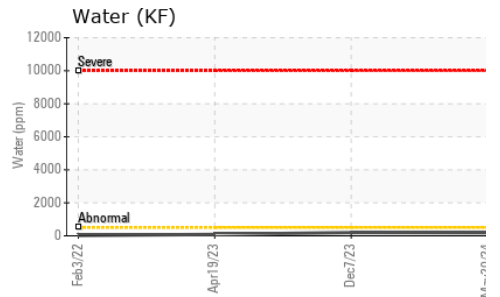
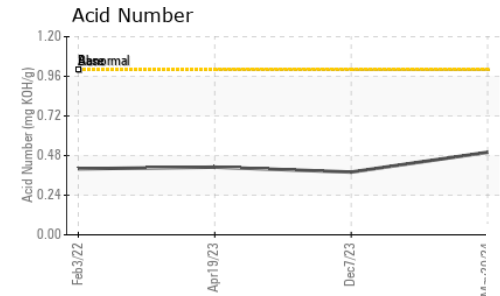
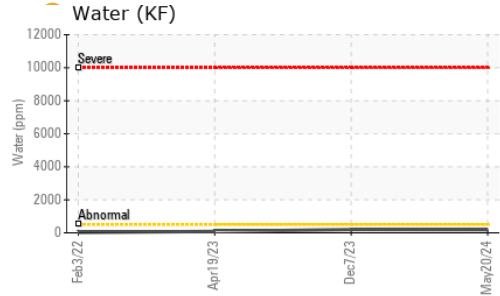
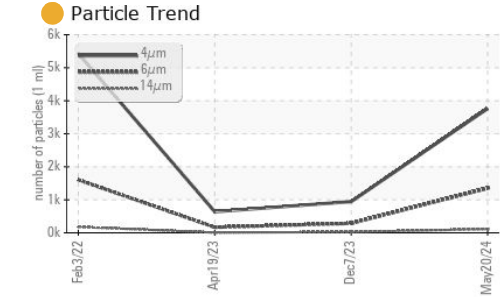


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.8	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

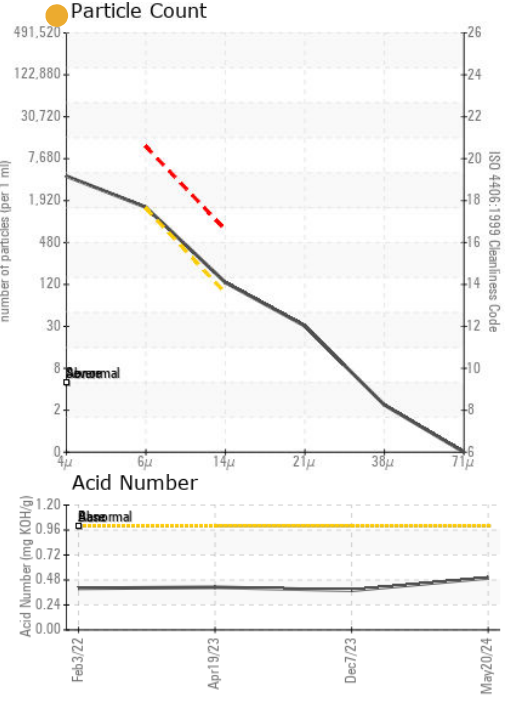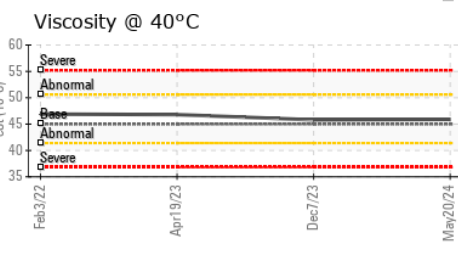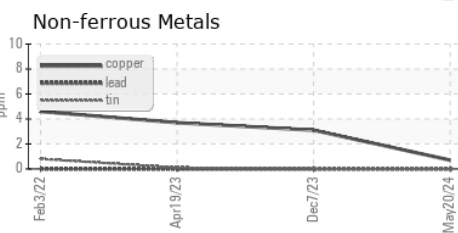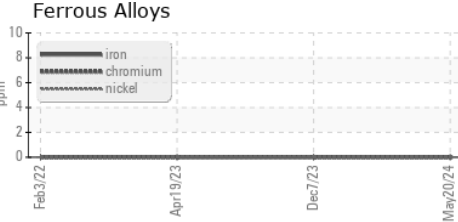

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017907 **Received** : 30 May 2024  
**Lab Number** : 06195932 **Tested** : 02 Jun 2024  
**Unique Number** : 11058055 **Diagnosed** : 02 Jun 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**IMPACT PHOTOGRAPHICS**  
 4961 WINDPLAY DR  
 EL DORADO HILLS, CA  
 US 95762  
 Contact: JIM W  
 jimw@impactphotographics.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)