


OIL ANALYSIS REPORT

Sample Rating Trend

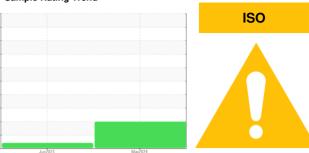

Machine Id

KAESER 7817455

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Junzuza	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA014404	KCPA002354	
Sample Date		Client Info		17 May 2024	23 Jun 2023	
Machine Age	hrs	Client Info		8823	6014	
Oil Age	hrs	Client Info		2809	0	
Oil Changed		Client Info		Not Changd	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	2	13	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	33	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	72	47	
Calcium	ppm	ASTM D5185m	0	3	4	
Phosphorus	ppm	ASTM D5185m	0	2	0	
Zinc	ppm		0	9	12	
Sulfur	ppm	ASTM D5185m	23500	20898	19392	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	10	5	
Sodium	ppm	ASTM D5185m		19	18	
Potassium	ppm	ASTM D5185m	>20	2	3	
Water	%	ASTM D6304	>0.05	0.021	0.019	
ppm Water	ppm	ASTM D6304	>500	219	196.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		35772		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38μm		ASTM D7647	>4	<u>^</u> 7		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/17</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39	0.31	



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA014404 : 06195935 Unique Number : 11058058

Received : 30 May 2024 **Tested** : 02 Jun 2024 Diagnosed

: 02 Jun 2024 - Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMAZON SMF 6 4930 ALLBAUGH DR SACRAMENTO, CA US 95837 Contact: B. BRISM

bbrism@amazon.com

T: F: