




# OIL ANALYSIS REPORT

## Sample Rating Trend

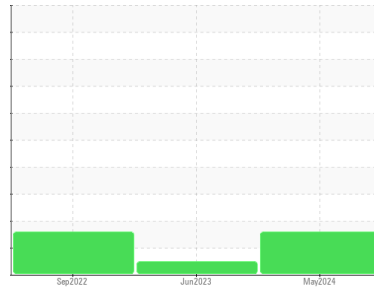

ISO



Machine Id

**KAESER 7785672**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA014391</b>	KCPA002352	KCP60390
Sample Date	Client Info			<b>17 May 2024</b>	23 Jun 2023	25 Sep 2022
Machine Age	hrs	Client Info		<b>8589</b>	6037	3253
Oil Age	hrs	Client Info		<b>2552</b>	0	1300
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	Not Chngd
Sample Status				<b>ATTENTION</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>2</b>	8	4
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>30</b>	12	28
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	100	<b>72</b>	60	74
Calcium	ppm	ASTM D5185m	0	<b>3</b>	<1	2
Phosphorus	ppm	ASTM D5185m	0	<b>6</b>	0	0
Zinc	ppm	ASTM D5185m	0	<b>10</b>	7	7
Sulfur	ppm	ASTM D5185m	23500	<b>20809</b>	20317	23168

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>13</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>18</b>	13	13
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	12	16
Water	%	ASTM D6304	>0.05	<b>0.019</b>	0.017	0.010
ppm Water	ppm	ASTM D6304	>500	<b>193</b>	173.7	105.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>4381</b>	---	5057
Particles >6µm		ASTM D7647	>1300	<b>1429</b>	---	1693
Particles >14µm		ASTM D7647	>80	<b>84</b>	---	185
Particles >21µm		ASTM D7647	>20	<b>22</b>	---	35
Particles >38µm		ASTM D7647	>4	<b>2</b>	---	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/18/14</b>	---	20/18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.38</b>	0.32	0.32


# OIL ANALYSIS REPORT

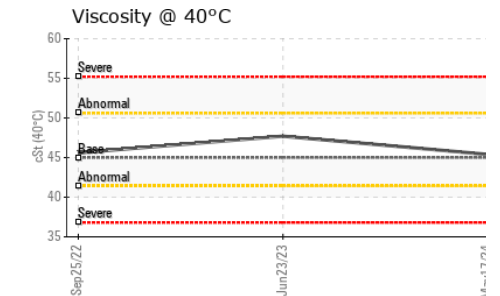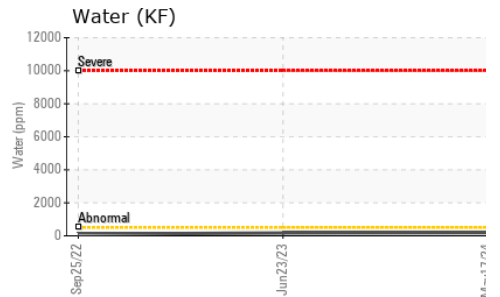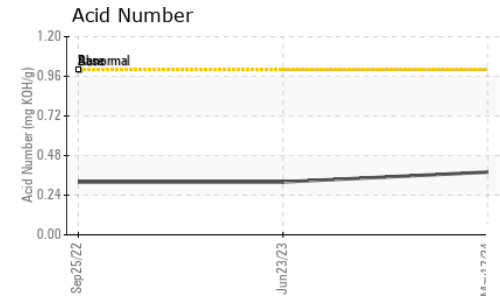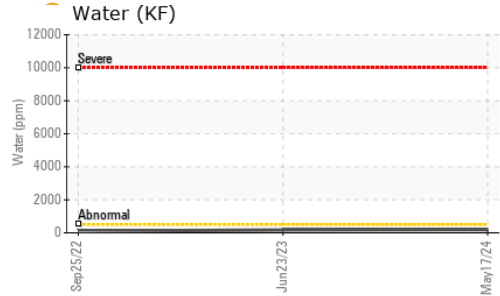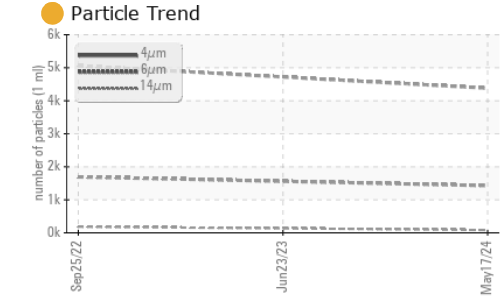




PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	MODER	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.4	47.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

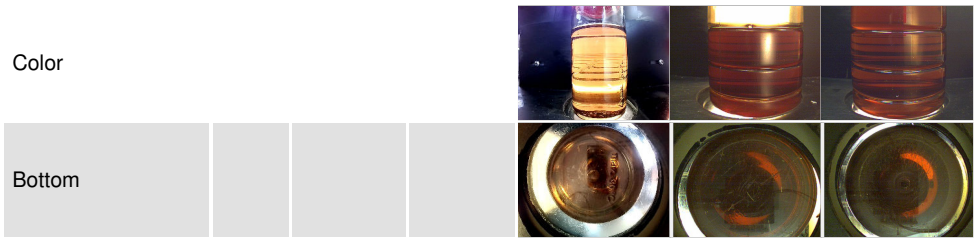

## GRAPHS

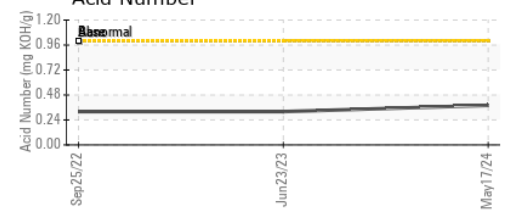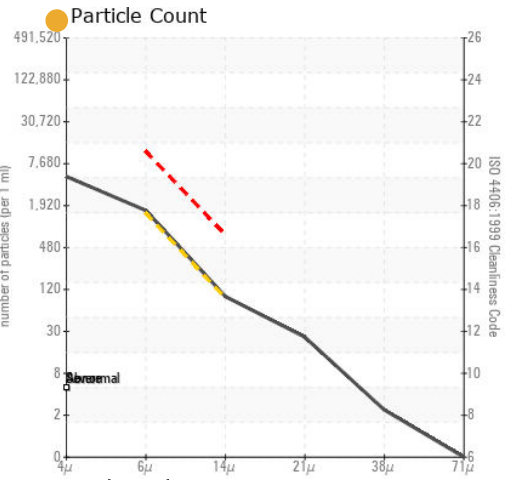

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA014391 **Received** : 30 May 2024  
**Lab Number** : 06195937 **Tested** : 02 Jun 2024  
**Unique Number** : 11058060 **Diagnosed** : 02 Jun 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON SMF 6**  
 4930 ALLBAUGH DR  
 SACRAMENTO, CA  
 US 95837  
 Contact: B. BRISM  
 bbrism@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)