


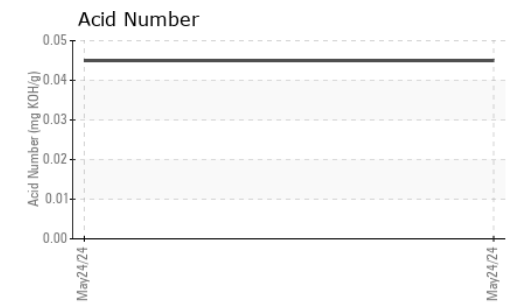
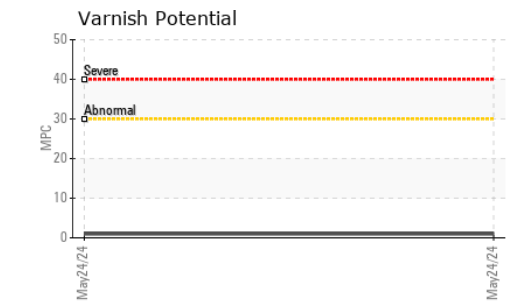


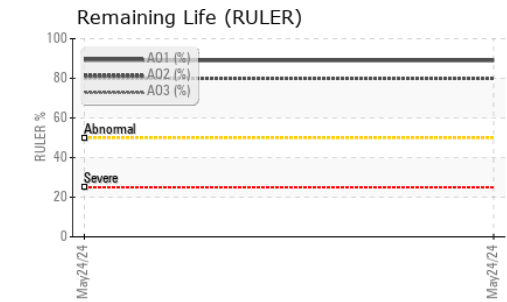

OIL ANALYSIS REPORT

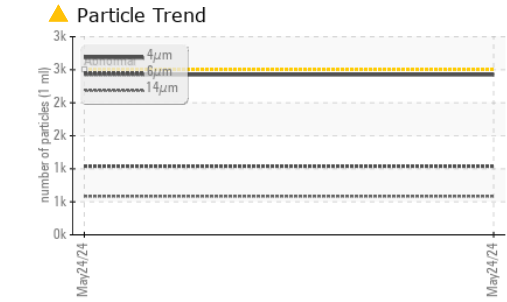

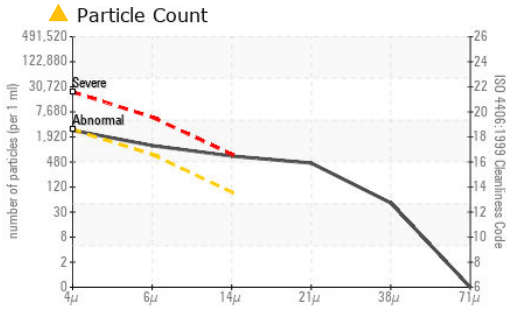


| FLUID DEGRADATION | method | limit/base | current | history1 | history2 |
|-----------------------|----------|------------|--------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.045 | --- | --- |
| Anti-Oxidant 1 | % | ASTM D6971 | 89 | --- | --- |
| Anti-Oxidant 2 | % | ASTM D6971 | 80 | --- | --- |
| MPC Varnish Potential | Scale | ASTM D7843 | 1 | --- | --- |

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|--------------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.03 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|-------------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 30.4 | 34.7 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | | |
|--------|--|--|--|---------------------------------------------------------------------------------------|----------|----------|
| Color | | | |  | no image | no image |
| Bottom | | | |  | no image | no image |
| MPC | | | |  | no image | no image |



Certificate L2367


Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0930103 **Received** : 30 May 2024
Lab Number : **06195940** **Tested** : 14 Jun 2024
Unique Number : 11058063 **Diagnosed** : 14 Jun 2024 - Doug Bogart
Test Package : AOM 1 (Additional Tests: KF)

SRP - Salt River Project
 SRP Mail Station POB003, P.O. Box 52025
 Phoenix, AZ
 US 85072-2025
 Contact: Chris Keisling
 chris.keisling@srpnet.com


To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

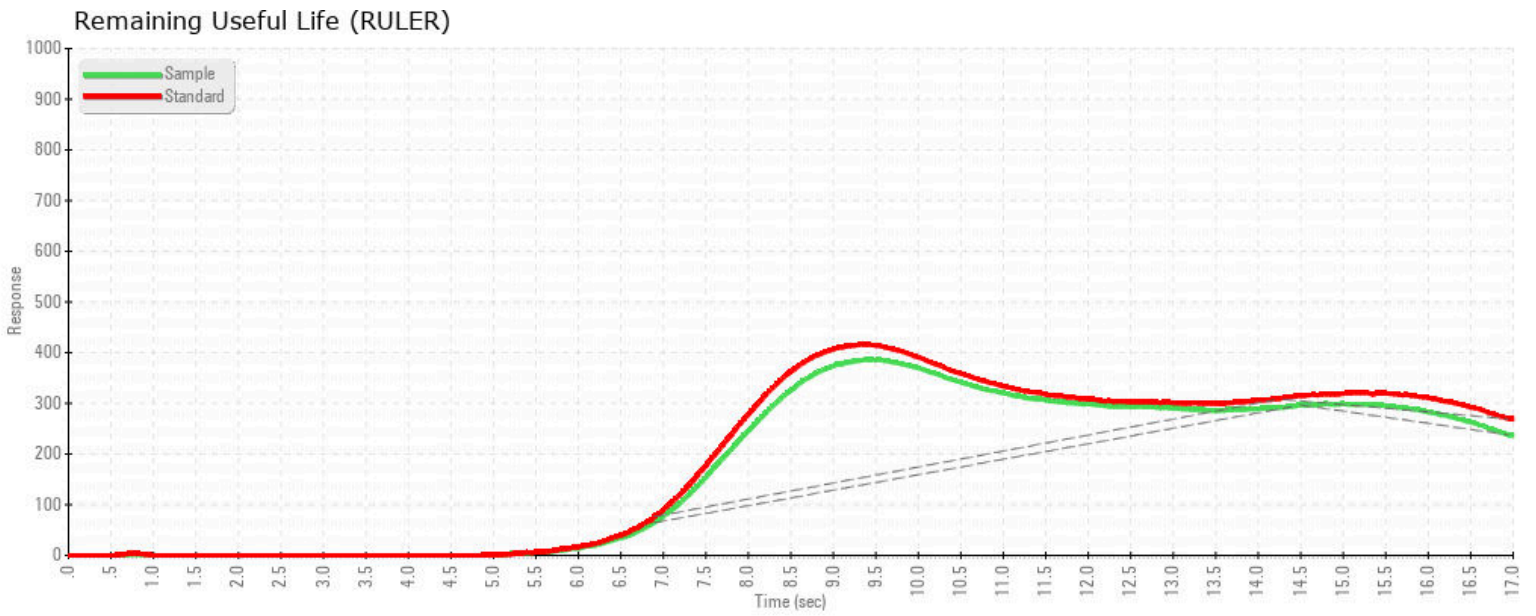

MPC (Varnish Test)

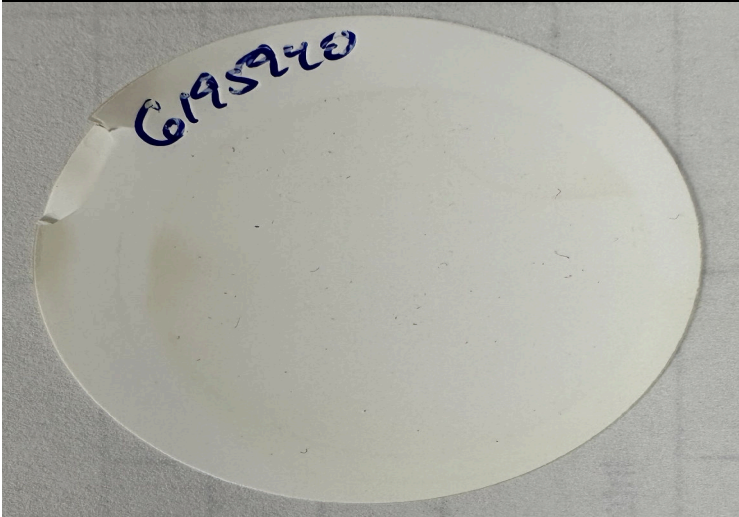

Sample Color & Clarity



This page left intentionally blank