

# **OIL ANALYSIS REPORT**

**OER** NH3 - OER-C-16

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

# Sample Rating Trend **NORMAL**

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP242813		
Sample Date		Client Info		29 May 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	0		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		2		
Sulfur	ppm	ASTM D5185m	50	31		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.01	0.003		
ppm Water	ppm	ASTM D6304	>100	38		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	2021		
Particles >6µm		ASTM D7647	>2500	461		
Particles >14µm		ASTM D7647	>320	32		
Particles >21µm		ASTM D7647		7		
Particles >38µm		ASTM D7647	>20	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/12		
FLUID DEGRAD	ATION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014		



## **OIL ANALYSIS REPORT**

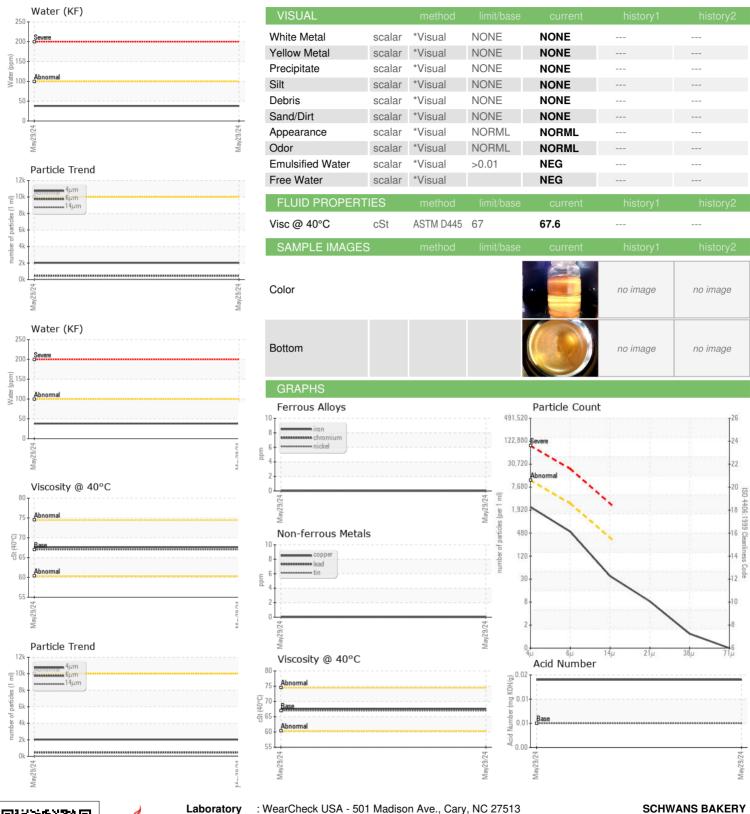



Certificate 12367

Laboratory Sample No.

: USP242813 Lab Number : 06195956

Unique Number : 11058079 Test Package : IND 2

Received : 30 May 2024 **Tested** : 02 Jun 2024

Diagnosed : 02 Jun 2024 - Doug Bogart **5 EAST WALNUT** STILWELL, OK US 74960

Contact: DENNIS LONGSHORE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: DENNIS LONGSHORE - SCHSTI

Report Id: SCHSTI [WUSCAR] 06195956 (Generated: 06/02/2024 17:45:21) Rev: 1

F:

T: (918)696-8296