


# **OIL ANALYSIS REPORT**

ACS-32 [420492] SULLAIR 201611100070 - INFINEUM Component Compressor

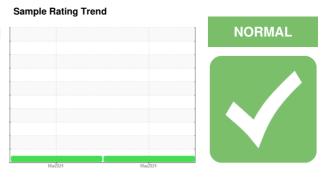

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06195973	UCH06142339	
Sample Date		Client Info		22 May 2024	04 Mar 2024	
Machine Age	hrs	Client Info		46223	44334	
Oil Age	hrs	Client Info		1910	21	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	٧	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	<1	
Silver	ppm	ASTM D5185m		0	<1	
Aluminum	ppm	ASTM D5185m	>25	0	2	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>15	<1	<1	
Vanadium	ppm	ASTM D5185m		<1	<1	
Cadmium	ppm	ASTM D5185m		0	<1	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0	0	
Barium	ppm	ASTM D5185m	730	578	548	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0.0	0	0	
Magnesium	ppm	ASTM D5185m	0	<1	1	
Calcium	ppm	ASTM D5185m	0	3	7	
Phosphorus	ppm	ASTM D5185m	0	10	2	
Zinc	ppm	ASTM D5185m	0	7	2	
Sulfur	ppm	ASTM D5185m	590	574	602	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		24	6	
Potassium	ppm	ASTM D5185m	>20	3	2	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.167	0.087	





# **OIL ANALYSIS REPORT**

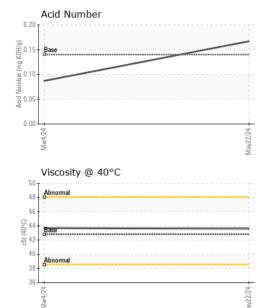

VISUAL		method	limit/base	current	history1	history2			
White Metal	scalar	*Visual	NONE	NONE	NONE				
Yellow Metal	scalar	*Visual	NONE	NONE	NONE				
Precipitate	scalar	*Visual	NONE	NONE	NONE				
Silt	scalar	*Visual	NONE	NONE	NONE				
Debris	scalar	*Visual	NONE	NONE	NONE				
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE				
Appearance	scalar	*Visual	NORML	NORML	NORML				
Odor	scalar	*Visual	NORML	NORML	NORML				
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG	NEG				
Free Water	scalar	*Visual		NEG	NEG				
FLUID PROPERTIES		method	limit/base	current	history1	history2			
Visc @ 40°C	cSt	ASTM D445	42.8	43.6	43.7				
SAMPLE IMAGES		method	limit/base	current	history1	history2			
Color						no image			
Bottom						no image			
GRAPHS									
Ferrous Alloys									











Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06195973

: UCH06195973 Unique Number : 11058096

Received **Tested** Diagnosed

: 30 May 2024 : 02 Jun 2024 : 02 Jun 2024 - Wes Davis

700 WASHINGTON AVE CARLSTADT, NJ

US 07072 Contact: ELVIN DIAZ

F: (201)342-6241

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

ediaz@airmaticcompressor.com;canastasio@wearcheckusa.com T: (800)864-7621

**AIRMATIC COMPRESSOR SYSTEMS** 

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: UCAIRCAR [WUSCAR] 06195973 (Generated: 06/02/2024 09:24:05) Rev: 1

Contact/Location: ELVIN DIAZ - UCAIRCAR