


OIL ANALYSIS REPORT

Sample Ratii

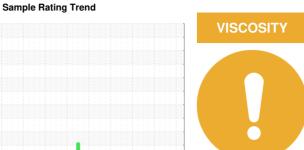

JBS310PLUS-46 Machine Id BOGE S220 5096379

Component Compressor

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Waar

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06195978	UCH06103151	UCH06077000
Sample Date		Client Info		07 May 2024	09 Feb 2024	15 Jan 2024
Machine Age	hrs	Client Info		38777	37260	36675
Oil Age	hrs	Client Info		1021	1870	1285
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	ATTENTION	ATTENTION
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>15	0	0	<1
Lead	ppm	ASTM D5185m	>65	0	0	0
Copper	ppm	ASTM D5185m	>65	3	<1	<1
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	0	0	0
Barium	ppm	ASTM D5185m	0.8	0	0	2
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0.9	0	0	<1
Magnesium	ppm	ASTM D5185m	0	0	0	1
Calcium	ppm	ASTM D5185m	0	0	0	1
Phosphorus	ppm	ASTM D5185m	409	225	226	275
Zinc	ppm	ASTM D5185m	0	15	11	26
Sulfur	ppm	ASTM D5185m	1290	945	766	918
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0	0	0
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	0.54	0.85	0.72



OIL ANALYSIS REPORT






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.56	63.0	59.65	57.2


SAMPLE IMAGES


Color


Bottom















Certificate 12367

Laboratory Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 **Sample No.** : UCH06195978 Lab Number : 06195978 Unique Number : 11058101

Received **Tested**

: 30 May 2024 : 02 Jun 2024

Diagnosed : 02 Jun 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

1024 HARRISON ST. NASHVILLE, TN US 37203

JOHN BOUCHARD & SONS

Contact: STEVE SANDERS Steve.sanders@jbouchard.com T:

F: (865)544-1400

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)