



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

WC0930109 CHEVRON GST 32

Component

New (Unused) Oil

Fluid

CHEVRON GST OIL ISO 32 (--- QTS)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0930109	---	---
Sample Date	Client Info			30 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>5	0	---	---
Copper	ppm	ASTM D5185m	>5	0	---	---
Tin	ppm	ASTM D5185m	>5	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		2	---	---
Phosphorus	ppm	ASTM D5185m		2	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		940	---	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304		0.003	---	---
ppm Water	ppm	ASTM D6304		28	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	167	---	---
Particles >6µm		ASTM D7647	>1300	50	---	---
Particles >14µm		ASTM D7647	>160	8	---	---
Particles >21µm		ASTM D7647	>40	3	---	---
Particles >38µm		ASTM D7647	>10	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	15/13/10	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.131	---	---




OIL ANALYSIS REPORT

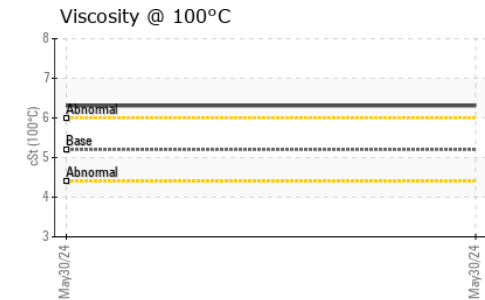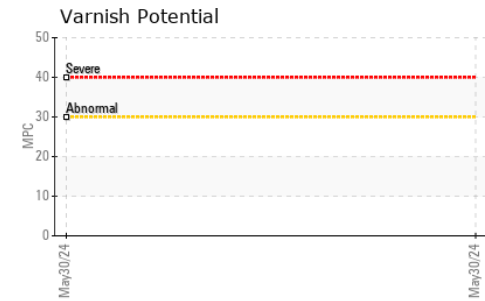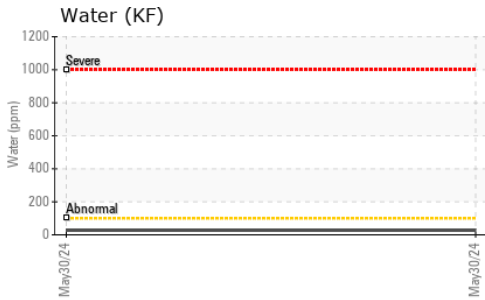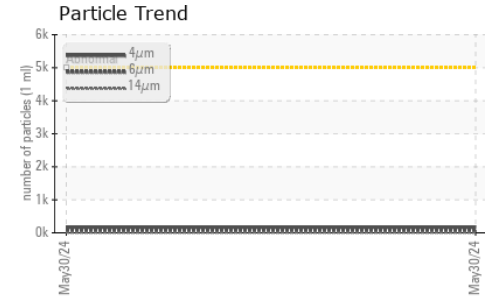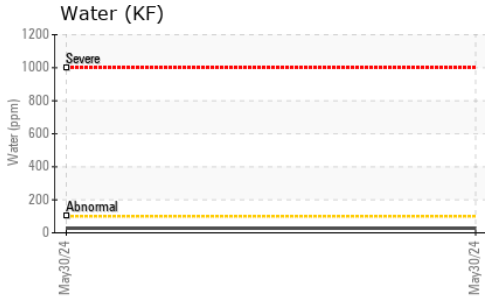

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	NEG	---	---	
Free Water	scalar	*Visual	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	30.4	32.95	---	---
Visc @ 100°C	cSt	ASTM D445	5.2	6.31	---	---
Viscosity Index (VI)	Scale	ASTM D2270	102	145	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image
MPC				no image	no image

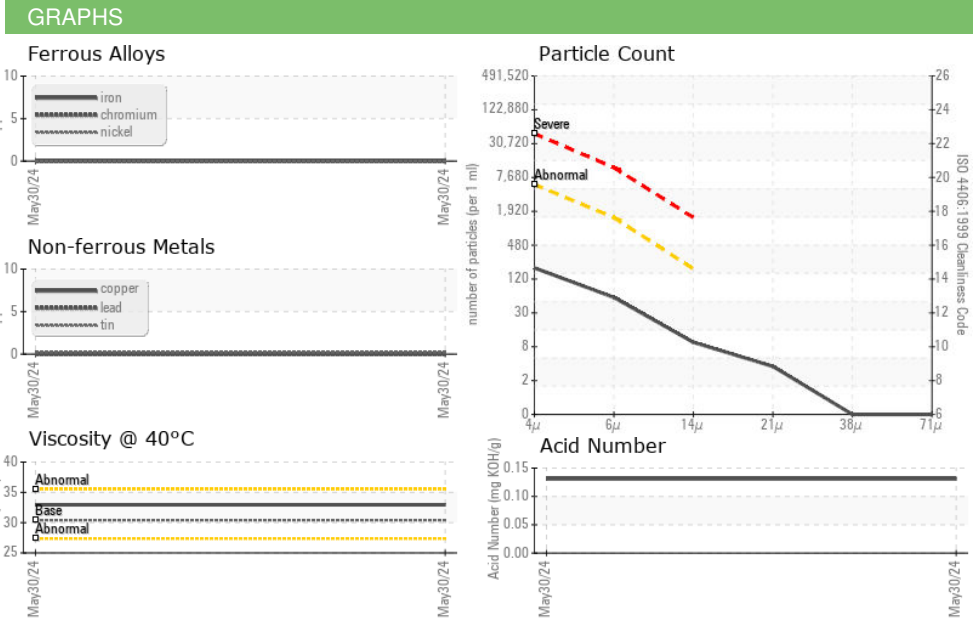

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0930109

Lab Number : 06196161

Unique Number : 11058284

Test Package : AOM 1 (Additional Tests: KF)

Received : 30 May 2024

Tested : 13 Jun 2024

Diagnosed : 13 Jun 2024 - Doug Bogart

SRP - Salt River Project

SRP Mail Station POB003, P.O. Box 52025

Phoenix, AZ

US 85072-2025

Contact: CHRIS CALTON

To discuss this sample report, contact Customer Service at 1-800-237-1369.


* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: (919)484-2136

Sample Color & Clarity

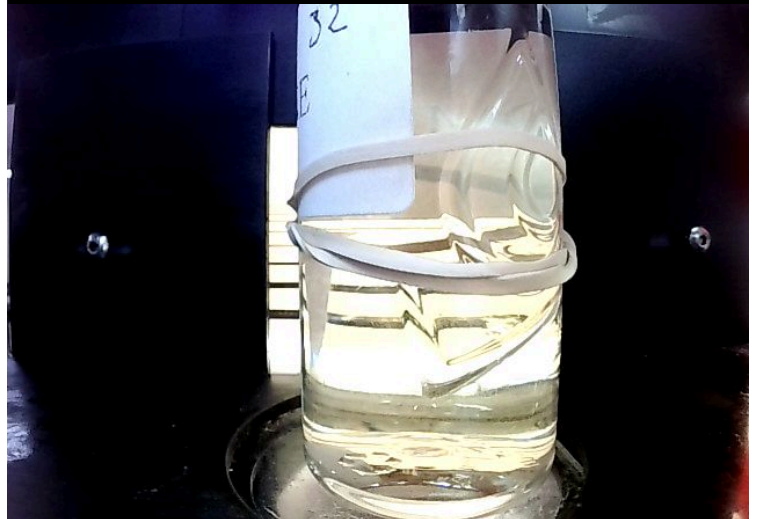

This page left intentionally blank