




OIL ANALYSIS REPORT

Sample Rating Trend

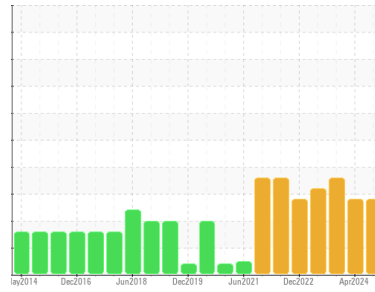

DIRT



Area
412
 Machine Id
273 AIRVAYOR
 Component
Inboard Bearing
 Fluid
MOBIL SHC 630 (10 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0912097	WC0838924	WC0838892
Sample Date	Client Info		23 May 2024	04 Apr 2024	10 Nov 2023
Machine Age	hrs	Client Info	0	0	6
Oil Age	hrs	Client Info	0	720	0
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		7	18	13
Iron	ppm	ASTM D5185m >20	7	5	8
Chromium	ppm	ASTM D5185m >20	0	<1	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	0	2	<1
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	0	<1	<1
Tin	ppm	ASTM D5185m >20	0	<1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	7
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	<1	<1	<1
Calcium	ppm	ASTM D5185m	<1	4	1
Phosphorus	ppm	ASTM D5185m	496	413	447
Zinc	ppm	ASTM D5185m	<1	0	0
Sulfur	ppm	ASTM D5185m	23	0	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	▲ 40	▲ 29	▲ 46
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	0	<1	<1


FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 113647	▲ 54160	▲ 84825
Particles >6µm	ASTM D7647	>2500	▲ 8077	● 3031	▲ 14721
Particles >14µm	ASTM D7647	>160	25	20	▲ 853
Particles >21µm	ASTM D7647	>40	4	4	▲ 145
Particles >38µm	ASTM D7647	>10	0	0	2
Particles >71µm	ASTM D7647	>3	0	0	1
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 24/20/12	▲ 23/19/11	▲ 24/21/17




OIL ANALYSIS REPORT


Particle Trend

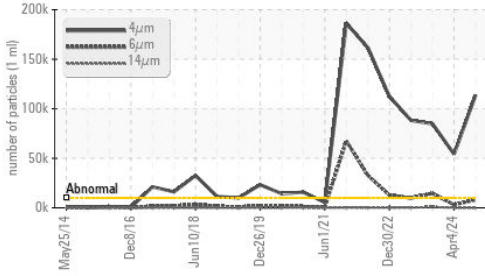


Silicon (ppm)

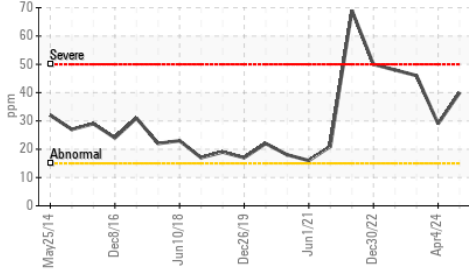


PQ

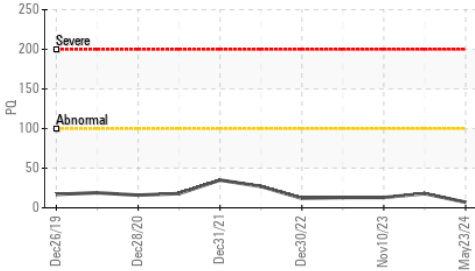

Acid Number

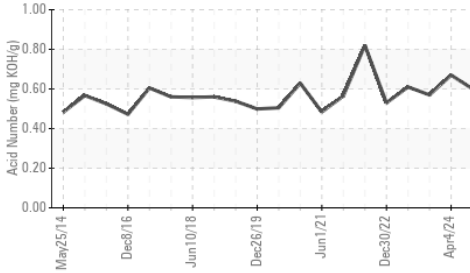

Viscosity @ 40°C

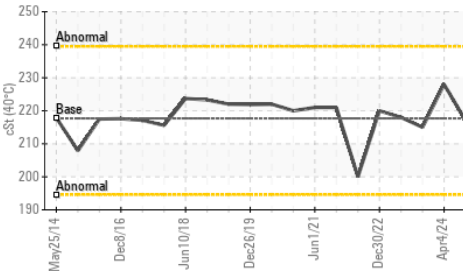


FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN) mg KOH/g	ASTM D8045	0.60	0.67	0.57		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D445	217	228	215

SAMPLE IMAGES

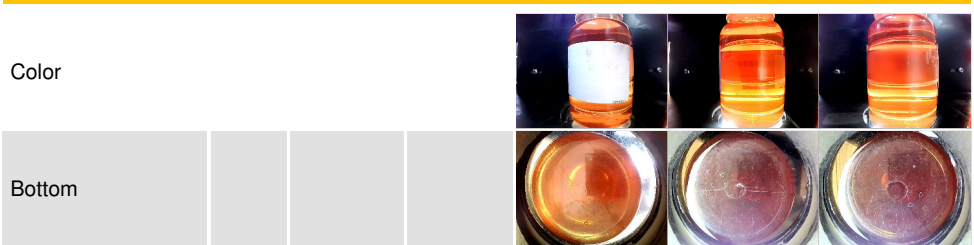


GRAPHS


Ferrous Alloys

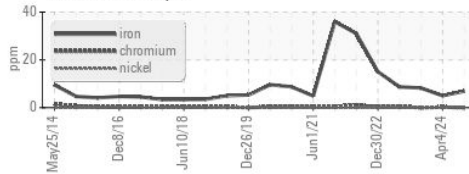


Non-ferrous Metals

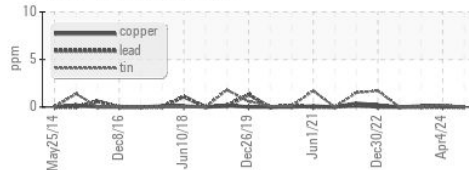


Viscosity @ 40°C

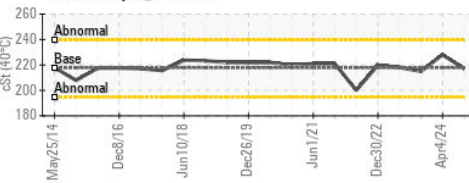

Particle Count

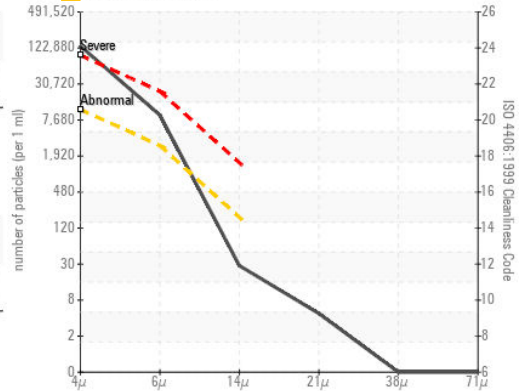

Acid Number

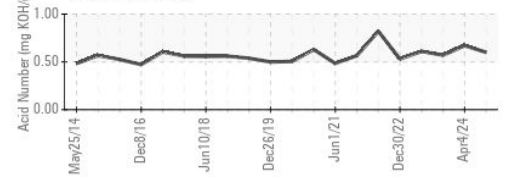

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0912097

Lab Number : **06196549**

Unique Number : 11058672

Test Package : IND 2 (Additional Tests: PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 31 May 2024

Tested : 03 Jun 2024

Diagnosed : 03 Jun 2024 - Don Baldrige

BRIDGESTONE FIRESTONE - DES MOINES

4600 NW 2ND AVE

DES MOINES, IA

US 50313

Contact: SCOTT CARTER

CarterScottA@FirestoneAg.com

T : x:

F : x: