




# OIL ANALYSIS REPORT

Sample Rating Trend

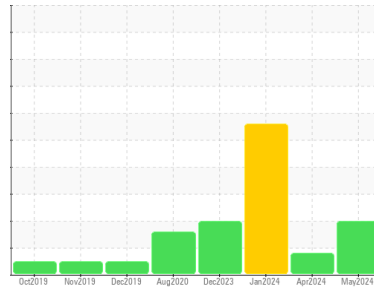

ISO



Area

## DS-102

Machine Id

### B64981 - PUMP VACUUM BUSCH RA 630 HIGH SPEED (S/N U192100028)

Component

#### Vacuum Pump

Fluid

#### PETRO CANADA PURITY FG SYNTHETIC 100 (4 GAL)

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0930383</b>	WC0907994	WC0880527
Sample Date	Client Info		<b>26 May 2024</b>	04 Apr 2024	27 Jan 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	Not Changd
Sample Status			<b>ABNORMAL</b>	ATTENTION	SEVERE

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>20	<b>11</b>	4	0
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>20	<b>1</b>	0	0
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	<1	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0
Phosphorus	ppm	ASTM D5185m		<b>316</b>	329	322
Zinc	ppm	ASTM D5185m		<b>16</b>	<1	0
Sulfur	ppm	ASTM D5185m		<b>578</b>	622	507

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>7</b>	6	6
Sodium	ppm	ASTM D5185m		<b>108</b>	72	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	4

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 17550</b>	9992	▲ 42375
Particles >6µm	ASTM D7647	>2500	<b>▲ 6990</b>	● 2688	▲ 13403
Particles >14µm	ASTM D7647	>320	<b>▲ 599</b>	141	▲ 756
Particles >21µm	ASTM D7647	>80	<b>▲ 97</b>	34	▲ 155
Particles >38µm	ASTM D7647	>20	<b>7</b>	2	2
Particles >71µm	ASTM D7647	>4	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 21/20/16</b>	● 20/19/14	▲ 23/21/17


## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	<b>0.98</b>	0.82	▲ 4.949




# OIL ANALYSIS REPORT


▲ Particle Trend

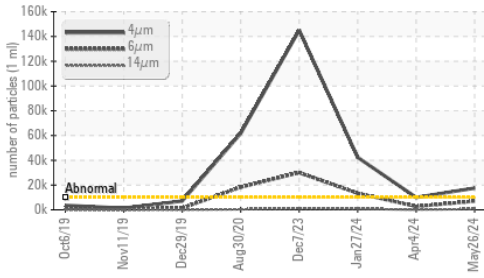


▲ Particle Trend

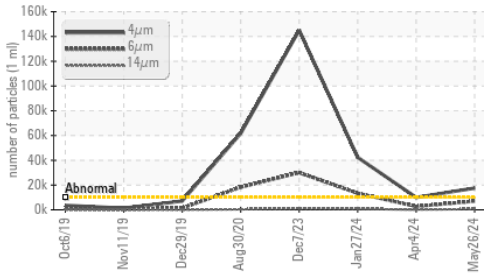

Acid Number

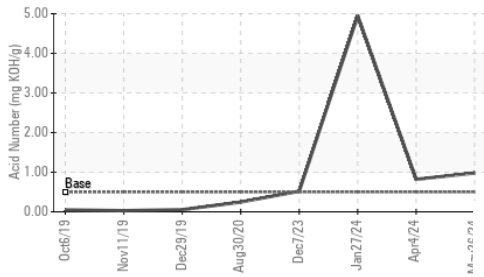

Viscosity @ 40°C

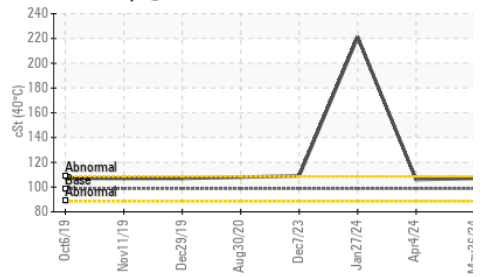

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	98.7	107	106 ▲ 221

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


Ferrous Alloys

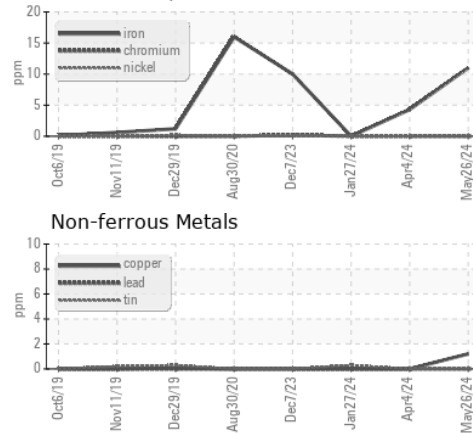


Non-ferrous Metals

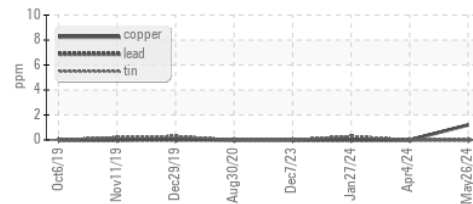


Viscosity @ 40°C

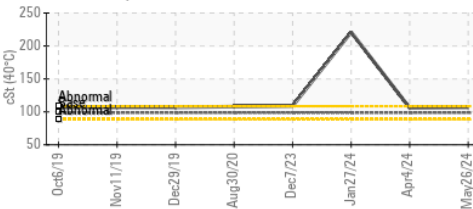

▲ Particle Count

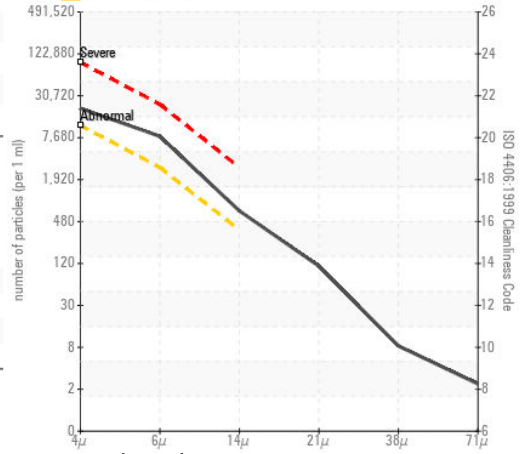

Acid Number

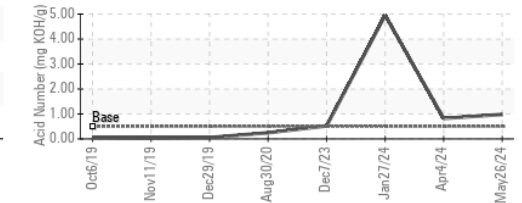

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0930383

Lab Number : 06196640

Unique Number : 11058763

Test Package : IND 2 ( Additional Tests: PrtCount )

Received : 31 May 2024

Tested : 03 Jun 2024

Diagnosed : 03 Jun 2024 - Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HORMEL FOODS - AUSTIN

1101 NORTH MAIN ST

AUSTIN, MN

US 55912

Contact: RYAN LOWE

rslowe@hormel.com

T: (507)437-5674

F: (507)437-9805