




OIL ANALYSIS REPORT

Sample Rating Trend

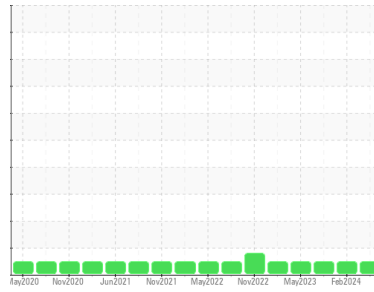

NORMAL



Area
88-50 [30719475]
 Machine Id
CRUSH CORE PRESS 2
 Component
Hydraulic System
 Fluid
MOBIL DTE 25 (500 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0910120	WC0864245	WC0845501
Sample Date	Client Info		24 May 2024	02 Feb 2024	18 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	0
Chromium	ppm	ASTM D5185m	>20	0	0
Nickel	ppm	ASTM D5185m	>20	0	0
Titanium	ppm	ASTM D5185m		0	<1
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>20	0	0
Lead	ppm	ASTM D5185m	>20	0	0
Copper	ppm	ASTM D5185m	>20	1	<1
Tin	ppm	ASTM D5185m	>20	0	0
Vanadium	ppm	ASTM D5185m		0	<1
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		0	0
Molybdenum	ppm	ASTM D5185m		0	0
Manganese	ppm	ASTM D5185m		0	<1
Magnesium	ppm	ASTM D5185m		0	0
Calcium	ppm	ASTM D5185m		140	126
Phosphorus	ppm	ASTM D5185m		510	402
Zinc	ppm	ASTM D5185m		725	697
Sulfur	ppm	ASTM D5185m		7734	6718

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1
Sodium	ppm	ASTM D5185m		2	2
Potassium	ppm	ASTM D5185m	>20	0	3
Water	%	ASTM D6304	>0.05	NEG	NEG

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	1652	1003	1117
Particles >6µm	ASTM D7647	>1300	527	160	337
Particles >14µm	ASTM D7647	>160	58	4	35
Particles >21µm	ASTM D7647	>40	14	1	10
Particles >38µm	ASTM D7647	>10	1	0	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	18/16/13	17/14/9	17/16/12


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		1.13	0.88




OIL ANALYSIS REPORT


Particle Trend

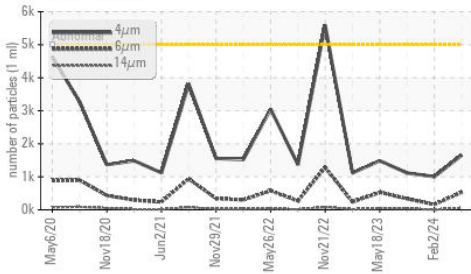


Acid Number

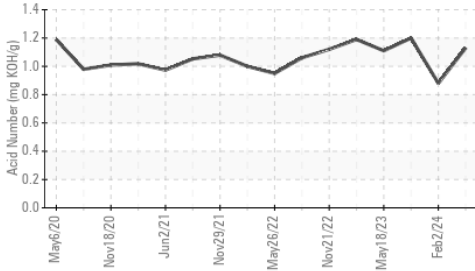

Viscosity @ 40°C

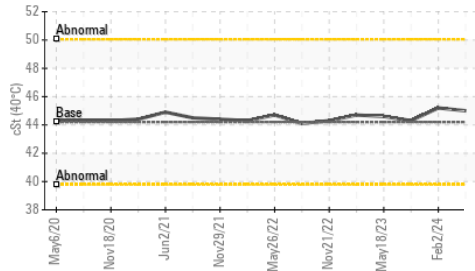

Particle Trend

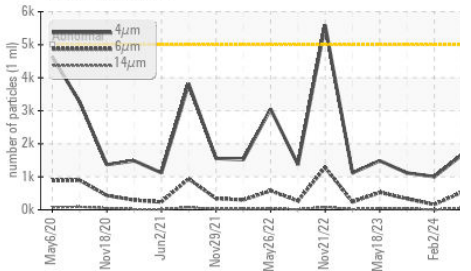

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	45.0	45.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

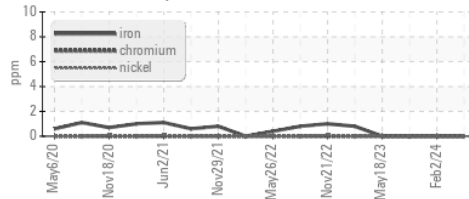


Non-ferrous Metals

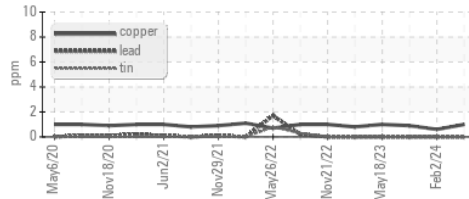


Viscosity @ 40°C

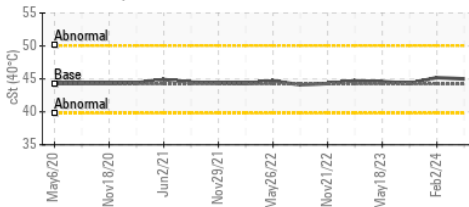

Particle Count

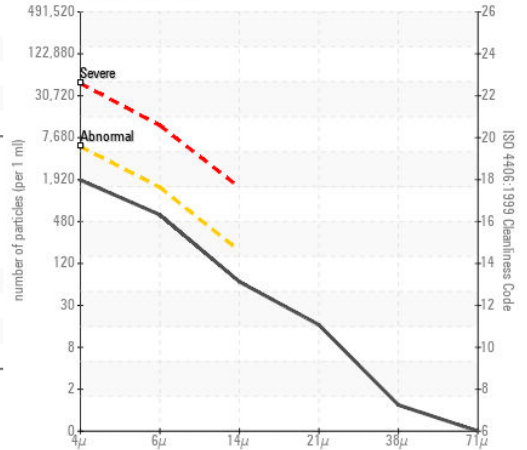

Acid Number

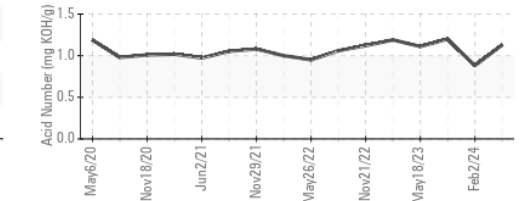

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0910120

Lab Number : 06196644

Unique Number : 11058767

Test Package : PLANT

Received : 31 May 2024

Tested : 05 Jun 2024

Diagnosed : 05 Jun 2024 - Jonathan Hester

THE BOEING COMPANY

5400 AIRFRAME DR

NORTH CHARLESTON, SC

US 29418

Contact: DAN HARRIS

DANIEL.R.HARRIS2@BOEING.COM

T: (843)730-0805

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)