OIL ANALYSIS REPORT

Sample Rating Trend

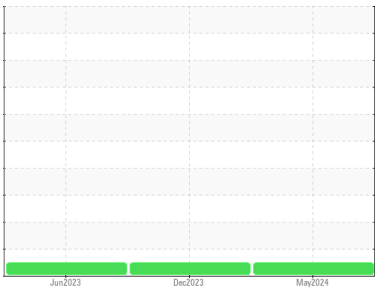

NORMAL

Area
DDGS
Machine Id
C-807
Component
Gear Reducer
Fluid
MOBIL SHC 630 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0941001**	WC0887409	WC0830814
Sample Date		Client Info		**29 May 2024**	19 Dec 2023	20 Jun 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>150	**<1**	1	<1
Chromium	ppm	ASTM D5185m	>10	**0**	<1	0
Nickel	ppm	ASTM D5185m	>10	**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>25	**0**	2	0
Lead	ppm	ASTM D5185m	>100	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**0**	0	0
Tin	ppm	ASTM D5185m	>10	**0**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m		**0**	<1	0
Calcium	ppm	ASTM D5185m		**3**	<1	0
Phosphorus	ppm	ASTM D5185m		**514**	550	712
Zinc	ppm	ASTM D5185m		**11**	0	0
Sulfur	ppm	ASTM D5185m		**77**	0	121

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	**14**	24	28
Sodium	ppm	ASTM D5185m		**0**	0	0
Potassium	ppm	ASTM D5185m	>20	**0**	<1	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	**15112**	30800	122417
Particles >6µm		ASTM D7647	>5000	**2277**	5520	21916
Particles >14µm		ASTM D7647	>640	**181**	127	1321
Particles >21µm		ASTM D7647	>160	**23**	29	200
Particles >38µm		ASTM D7647	>40	**1**	4	5
Particles >71µm		ASTM D7647	>10	**0**	2	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	**21/18/15**	22/20/14	24/22/18

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.61**	0.56	0.46

OIL ANALYSIS REPORT

Particle Trend

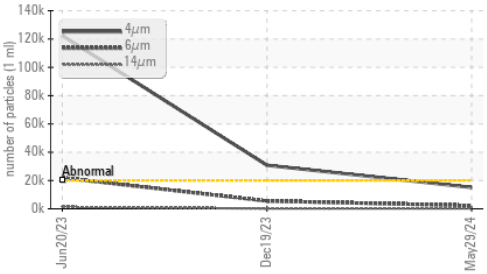

Acid Number

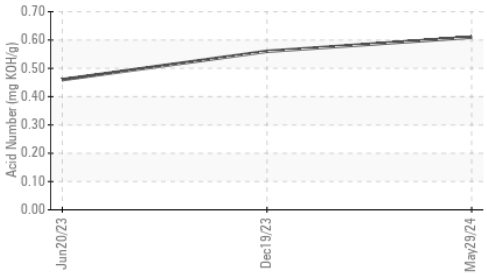

Viscosity @ 40°C

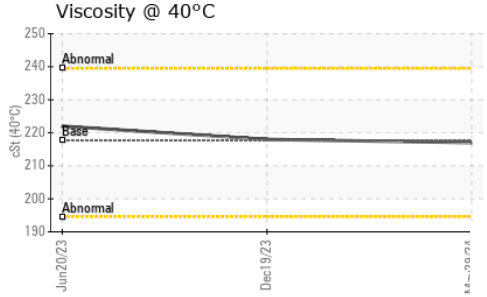

Particle Trend

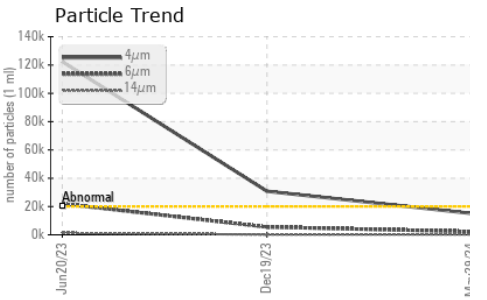

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	217.7	**217**	218	222

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

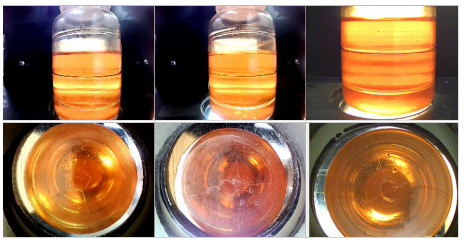

GRAPHS

Ferrous Alloys

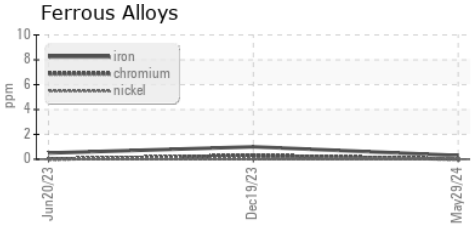

Non-ferrous Metals

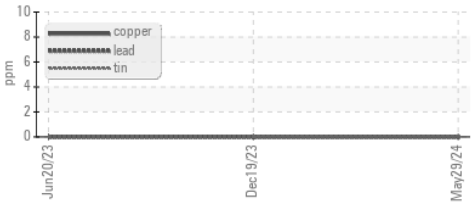

Viscosity @ 40°C

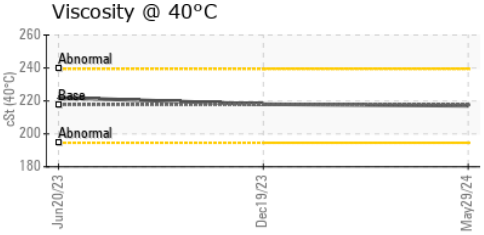

Particle Count

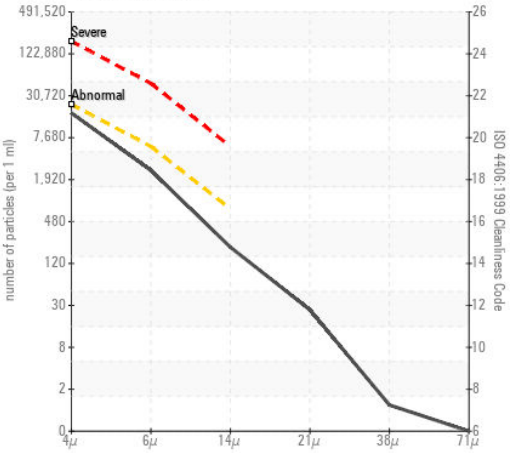

Acid Number

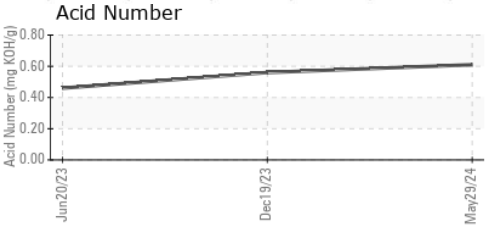

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0941001 **Received** : 31 May 2024
Lab Number : 06196645 **Tested** : 05 Jun 2024
Unique Number : 11058768 **Diagnosed** : 05 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

POET BIOREFINING - Groton
40425 133RD STREET
GROTON, SD
US 57445-6400
Contact: GAVIN KRUEGER
Gavin.Krueger@POET.COM
T: 6(05)846-6863
F: (605)397-2754

Report Id: POEGRO [WUSCAR] 06196645 (Generated: 06/06/2024 00:34:23) Rev: 1

Submitted By: GAVIN KRUEGER