


OIL ANALYSIS REPORT

Sample Rating Trend

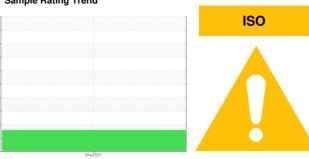

Machine Id

8964302 (S/N 1429)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017619		
Sample Date		Client Info		10 May 2024		
Machine Age	hrs	Client Info		4936		
Oil Age	hrs	Client Info		4936		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
					HISTOLAL	HISTOTYZ
Iron	ppm	ASTM D5185m	>50	3		
Chromium	ppm		>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		10		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m		2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	0		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		64		
Zinc	ppm	ASTM D5185m		48		
Sulfur	ppm	ASTM D5185m		594		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.00		
ppm Water	ppm	ASTM D6304	>500	0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10149		
Particles >6µm		ASTM D7647	>1300	△ 3708		
Particles >14µm		ASTM D7647	>80	<u>▲</u> 358		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.15		
ACIO NUMBER (AIN)	my NOTI/9	49 LINI D0049	0.4	0.13		



OIL ANALYSIS REPORT

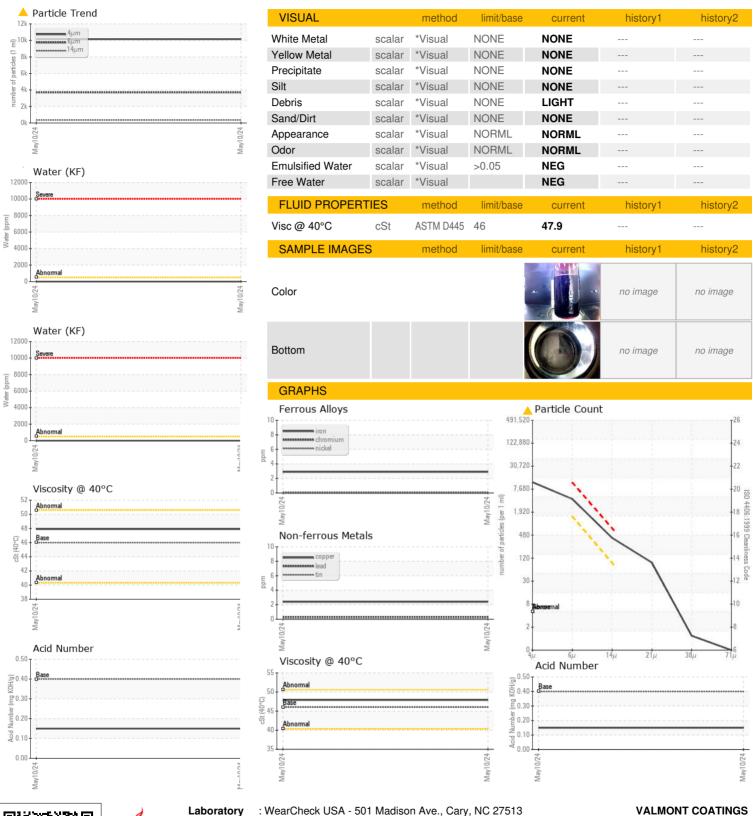





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA017619 : 06196668 Unique Number : 11058791

Received : 31 May 2024 **Tested** : 03 Jun 2024 : 03 Jun 2024 - Don Baldridge Diagnosed

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

bradley.cunningham@valmont.com T: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

US 74019

25055 ALLIANCE DR CLAREMORE, OK

Contact: BRADLEY CUNNINGHAM