

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

9385664 (S/N 1004)

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

A Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128361		
Sample Date		Client Info		14 May 2024		
Machine Age	hrs	Client Info		607		
Oil Age	hrs	Client Info		607		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	10		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	62		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		9		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		18		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.025		
ppm Water	ppm	ASTM D6304	>500	256		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4601		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<mark> </mark> 37		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 19/19/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.44		



Built for a lifetime Particle Trend

14µm

5

Ê 4

IC les

5 11

0

12000

1000

800 (maa)

600 Water 400

200

0.50

(B/HOX Ê0.3

Pio 0.1

0.00

1000

600 Water (

4000

200

52

5

48

(D=04) 44 B

42

4(

38

Uav1

Abnor

/Jav

Water (KF)


Abnormal n


Mav1

Ulan1

Water (KF)

Acid Number



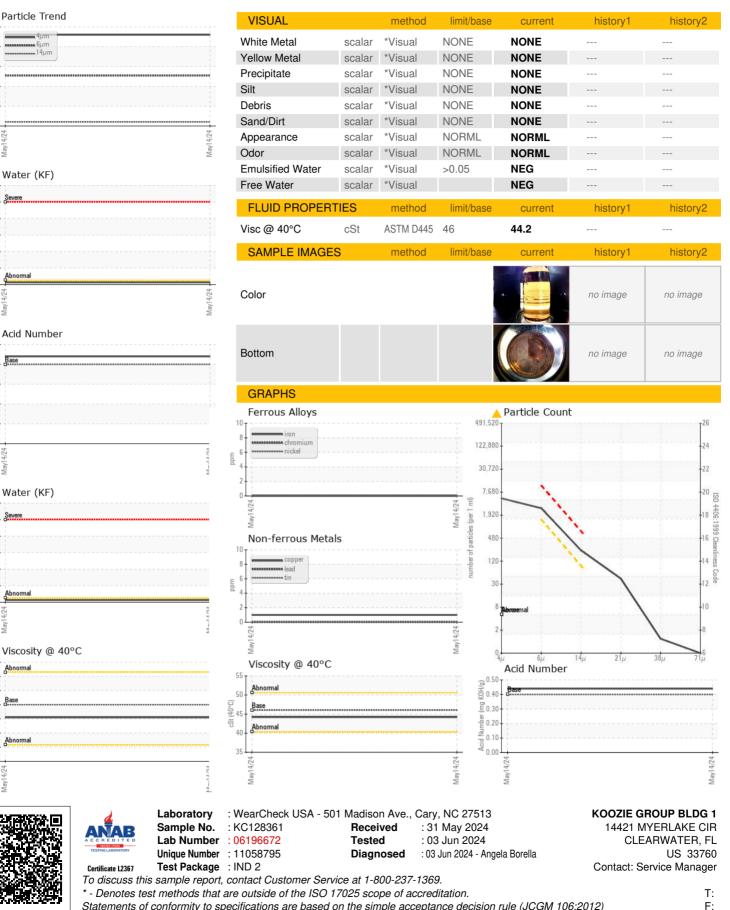

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - KOOCLE Page 2 of 2