




OIL ANALYSIS REPORT

Sample Rating Trend

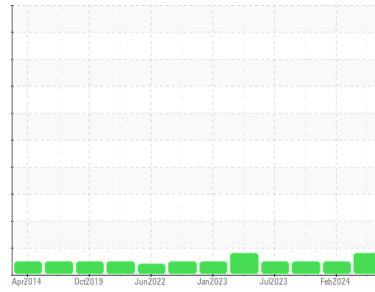

ISO



Machine Id
GAS COMP 3 SKID WEST
 Component
West Turbine
 Fluid
MOBIL PEGASUS 805 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0012878	USP0007092	USP255339
Sample Date	Client Info		30 May 2024	13 Feb 2024	09 Nov 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	0	<1	0
Chromium	ppm	ASTM D5185m >4	0	0	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >10	2	2	<1
Lead	ppm	ASTM D5185m	<1	<1	0
Copper	ppm	ASTM D5185m >5	<1	<1	<1
Tin	ppm	ASTM D5185m >5	0	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 80	31	38	51
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	7	7	4
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	91	87	110
Calcium	ppm	ASTM D5185m 1020	1515	1339	1428
Phosphorus	ppm	ASTM D5185m 220	425	386	395
Zinc	ppm	ASTM D5185m 230	462	439	464
Sulfur	ppm	ASTM D5185m 1000	2676	2375	2616

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	1	2	2
Sodium	ppm	ASTM D5185m	<1	0	<1
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304 >0.03	0.016	0.018	0.012
ppm Water	ppm	ASTM D6304 >300	166	183	122.8

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 5223	4787	5410
Particles >6µm	ASTM D7647	>640	619	419	716
Particles >14µm	ASTM D7647	>80	25	4	26
Particles >21µm	ASTM D7647	>20	7	1	7
Particles >38µm	ASTM D7647	>4	2	0	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 20/16/12	19/16/9	20/17/12


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.932	0.374	0.761




OIL ANALYSIS REPORT


Particle Trend

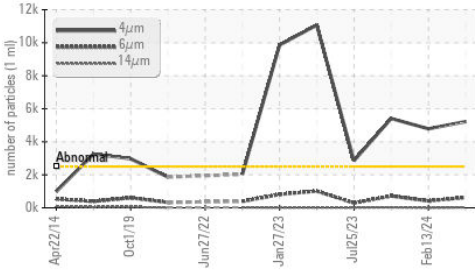


Water (KF)

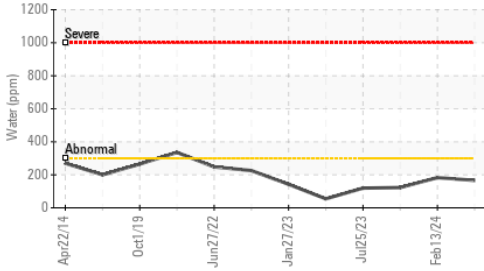


Acid Number

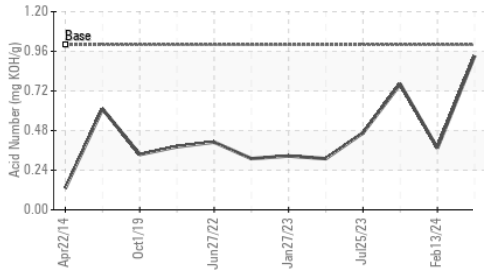

Water (KF)

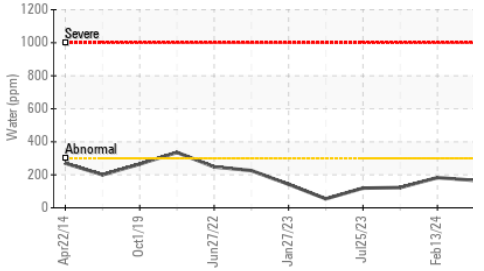


Viscosity @ 40°C

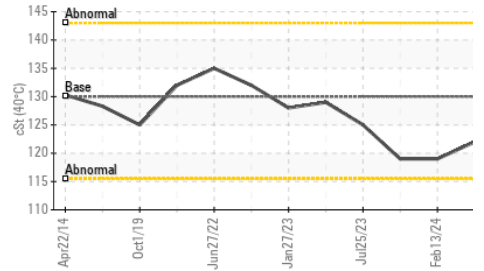

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	130.0	122	119

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

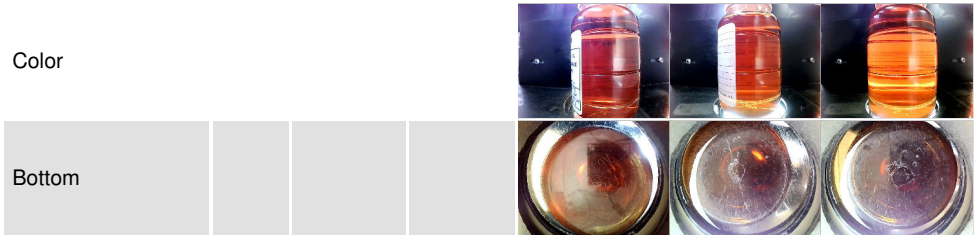


GRAPHS


Ferrous Alloys

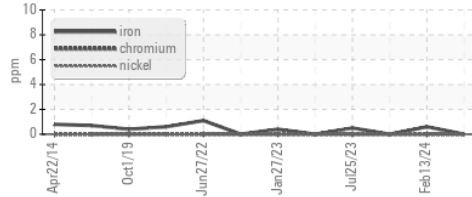


Non-ferrous Metals

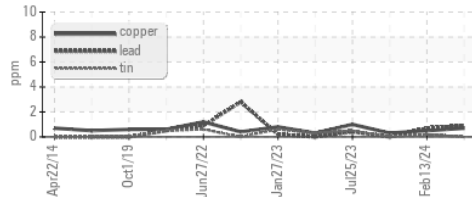


Viscosity @ 40°C

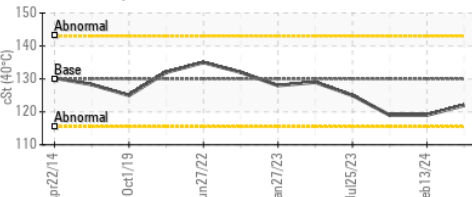

Particle Count

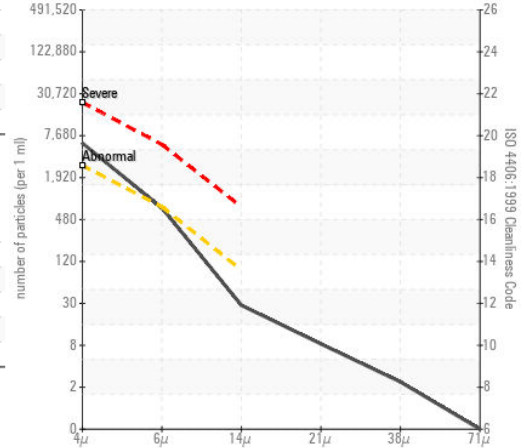

Acid Number

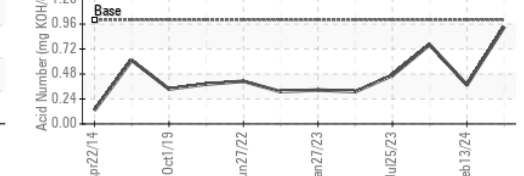

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP0012878
 Lab Number : 06196711
 Unique Number : 11058834
 Test Package : IND 2

Received : 31 May 2024
 Tested : 03 Jun 2024
 Diagnosed : 03 Jun 2024 - Doug Bogart

ENERGY CENTER DOVER LLC - DCODOV
 1280 W NORTH ST
 DOVER, DE
 US 19904
 Contact: ERNIE JUST
 ernie.just@clearwayenergy.com
 T: (302)678-4353
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)