


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# **KD1 TURBINE LUBE**

Component Reservoir Turbine

**MOBIL JET OIL II (--- GAL)** 

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


w2014 Jan2015 Oct2016 Jan2016 Jan2019 May2020 Feb2022 Oct2022 Jat2022 May20							
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2	
Sample Number		Client Info		USP0012881	USP0007095	USP249786	
Sample Date		Client Info		30 May 2024	25 Jan 2024	09 Nov 2023	
Machine Age	hrs	Client Info		0	0	0	
Oil Age	hrs	Client Info		0	0	0	
Oil Changed		Client Info		N/A	N/A	N/A	
Sample Status				NORMAL	NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	0	0	0	
Chromium	ppm	ASTM D5185m	>4	0	0	0	
Nickel	ppm	ASTM D5185m	>2	0	0	0	
Titanium	ppm	ASTM D5185m		0	0	0	
Silver	ppm	ASTM D5185m		0	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	0	
Lead	ppm	ASTM D5185m		0	0	0	
Copper	ppm	ASTM D5185m	>5	<1	<1	0	
Tin	ppm	ASTM D5185m	>5	0	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	0	
Cadmium	ppm	ASTM D5185m		0	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0	
Barium	ppm	ASTM D5185m		0	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	0	
Manganese	ppm	ASTM D5185m		0	0	0	
Magnesium	ppm	ASTM D5185m		2	0	0	
Calcium	ppm	ASTM D5185m		3	1	0	
Phosphorus	ppm	ASTM D5185m		3191	2422	2729	
Zinc	ppm	ASTM D5185m		<1	0	0	
Sulfur	ppm	ASTM D5185m		0	0	0	
CONTAMINANTS		method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<1	<1	0	
Sodium	ppm	ASTM D5185m		<1	<1	<1	
Potassium	ppm	ASTM D5185m	>20	<1	0	0	
Water	%	ASTM D6304	>.1	0.080	0.045	0.035	
ppm Water	ppm	ASTM D6304	>1000	806	453	356.9	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2	
Particles >4µm		ASTM D7647	>2500	242	47	394	
Particles >6µm		ASTM D7647	>640	105	22	156	
Particles >14µm		ASTM D7647	>80	16	3	24	
Particles >21µm		ASTM D7647	>20	4	2	9	
Particles >38µm		ASTM D7647	>4	0	0	1	
Particles >71µm		ASTM D7647	>3	0	0	0	
Oil Cleanliness		ISO 4406 (c)	>18/16/13	15/14/11	13/12/9	16/14/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.03	0.31	0.26	0.26	





## **OIL ANALYSIS REPORT**




Aun	onna	4μm							
******		6μm 14μm							
k									
k -									
L	270			$\sim$	<u></u>		athres .		1
Mar5/14	7/15	Oct1/16	1/18	Jun6/19	May19/20	Feb28/22	Oct4/22	Jul25/23	May30/24
N N	Jan 27	Oct	an J	Jun	/ay	Feb2	Oct	Jul	/lay3







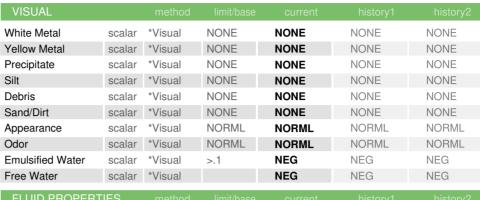


I LOID I NOI LI	IIILO	memou			HISTOLAL	HISTORYZ
Visc @ 40°C	cSt	ASTM D445	27.6	26.2	26.4	26.3

SAMPLE IMAGES	method		history2

Color





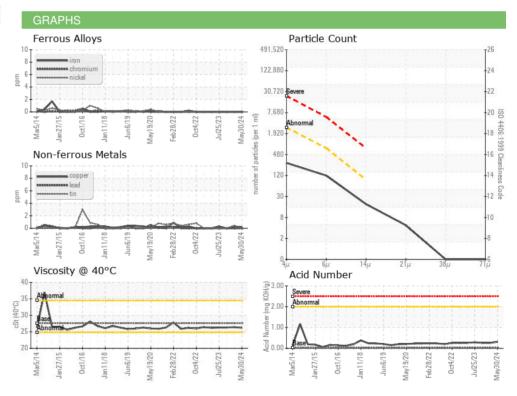





Certificate 12367

Laboratory Sample No.

: USP0012881 Lab Number : 06196713 Unique Number : 11058836

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 31 May 2024

**Tested** : 03 Jun 2024 Diagnosed : 03 Jun 2024 - Doug Bogart

1280 W NORTH ST DOVER, DE US 19904 Contact: ERNIE JUST

ernie.just@clearwayenergy.com

**ENERGY CENTER DOVER LLC - DCODOV** 

T: (302)678-4353

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: NRGDOV [WUSCAR] 06196713 (Generated: 06/04/2024 06:51:01) Rev: 1

Contact/Location: ERNIE JUST - NRGDOV

F: