




OIL ANALYSIS REPORT

Sample Rating Trend

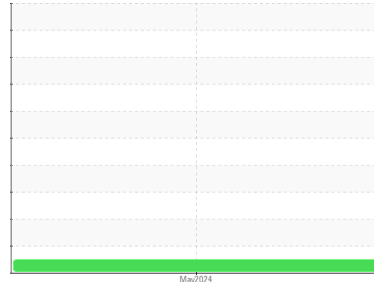

NORMAL



Area

NOT GIVEN

Machine Id

KAESER 1128 - VISHAQ

Component

Compressor

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|----------|----------|
| Sample Number | Client Info | | UCH06196787 | --- | --- |
| Sample Date | Client Info | | 17 May 2024 | --- | --- |
| Machine Age | hrs | Client Info | 19281 | --- | --- |
| Oil Age | hrs | Client Info | 1 | --- | --- |
| Oil Changed | Client Info | | Changed | --- | --- |
| Sample Status | | | NORMAL | --- | --- |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.05 | NEG | --- | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | <1 | --- | --- |
| Chromium | ppm | ASTM D5185m >10 | <1 | --- | --- |
| Nickel | ppm | ASTM D5185m >3 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m >3 | <1 | --- | --- |
| Silver | ppm | ASTM D5185m >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m >10 | 2 | --- | --- |
| Lead | ppm | ASTM D5185m >10 | <1 | --- | --- |
| Copper | ppm | ASTM D5185m >50 | 4 | --- | --- |
| Tin | ppm | ASTM D5185m >10 | <1 | --- | --- |
| Vanadium | ppm | ASTM D5185m | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | 0 | --- | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 9 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | <1 | --- | --- |
| Manganese | ppm | ASTM D5185m | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 2 | --- | --- |
| Calcium | ppm | ASTM D5185m | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 323 | --- | --- |
| Zinc | ppm | ASTM D5185m | 20 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 2154 | --- | --- |

CONTAMINANTS


| | method | limit/base | current | history1 | history2 |
|-----------|--------|-----------------|----------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | 3 | --- | --- |
| Sodium | ppm | ASTM D5185m | 0 | --- | --- |
| Potassium | ppm | ASTM D5185m >20 | 1 | --- | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.49 | --- | --- |



OIL ANALYSIS REPORT

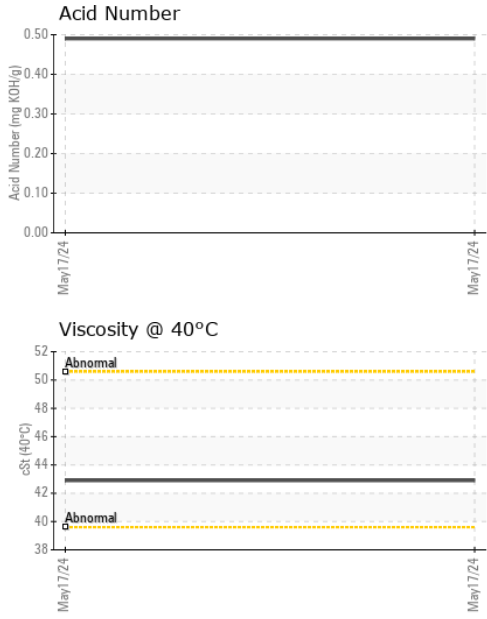





| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|--------------|----------|-----|
| White Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- | --- |
| Silt | scalar | *Visual | NONE | MODER | --- | --- |
| Debris | scalar | *Visual | NONE | NONE | --- | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- | --- |
| Odor | scalar | *Visual | NORML | NORML | --- | --- |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | --- | --- |
| Free Water | scalar | *Visual | | NEG | --- | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 42.9 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|--|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

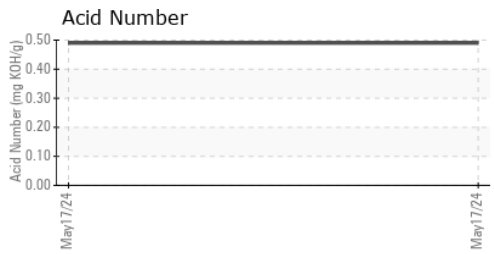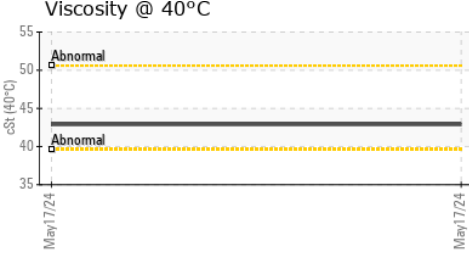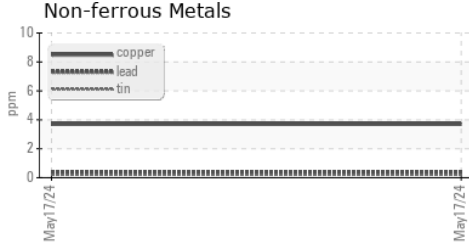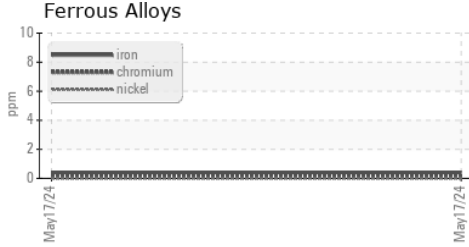

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06196787 **Received** : 31 May 2024
Lab Number : **06196787** **Tested** : 03 Jun 2024
Unique Number : 11058910 **Diagnosed** : 04 Jun 2024 - Don Baldrige
Test Package : IND 2

RASMUSSEN AIR & GAS ENERGY - RAGE
 655 240TH STREET
 WATERLOO, NE
 US 68069
 Contact: CHASE SVOBODA
 chase.svoboda@rage-energy.com
 T: (402)614-9926
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)