




# OIL ANALYSIS REPORT

Sample Rating Trend

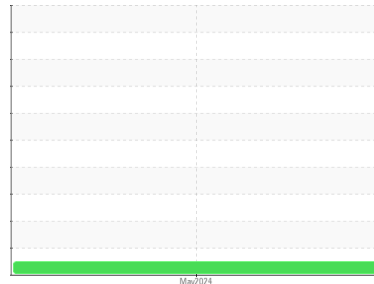

**NORMAL**



Area  
**FSE TURBOCOOL ISO 32**  
 Machine Id  
**ELLIOT B7ETZE070-1**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06196790</b>	---	---
Sample Date	Client Info			<b>16 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>47771</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>3</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>207</b>	---	---
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>55</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.18</b>	---	---



# OIL ANALYSIS REPORT

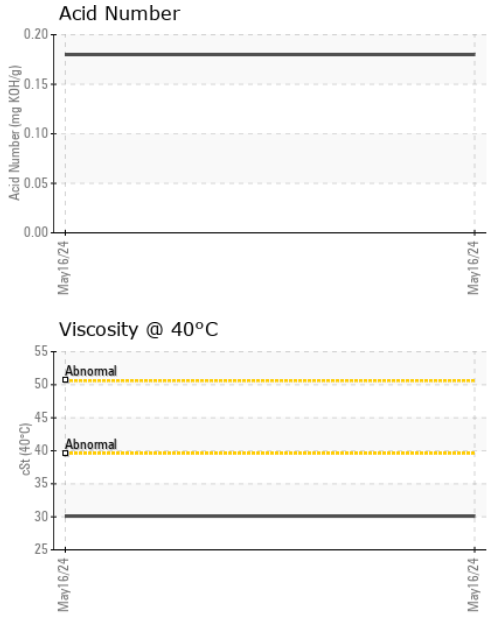





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>30.1</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

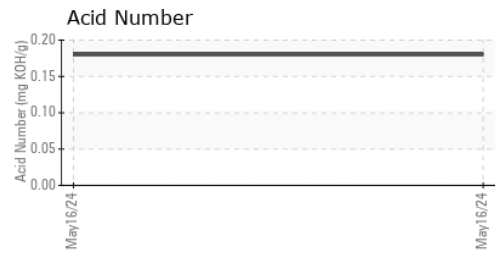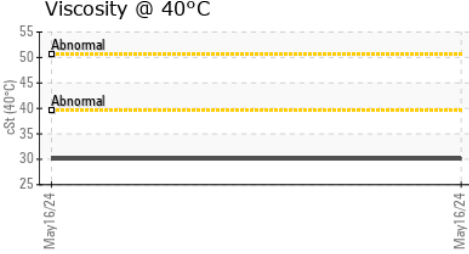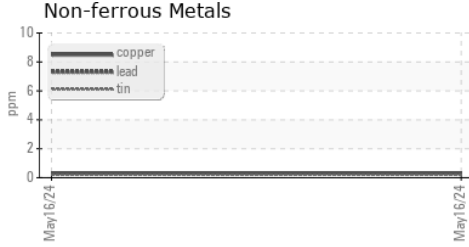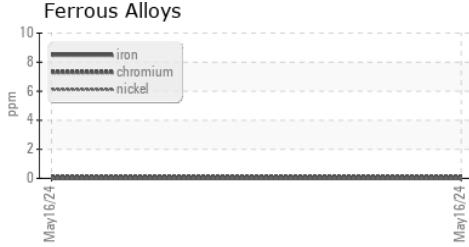

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06196790      **Received** : 31 May 2024  
**Lab Number** : **06196790**      **Tested** : 03 Jun 2024  
**Unique Number** : 11058913      **Diagnosed** : 03 Jun 2024 - Sean Felton  
**Test Package** : IND 2

**RASMUSSEN AIR & GAS ENERGY - RAGE**  
 655 240TH STREET  
 WATERLOO, NE  
 US 68069  
 Contact: CHASE SVOBODA  
 chase.svoboda@rage-energy.com  
 T: (402)614-9926  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)