

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

SULLIVAN PALATEK 1710050009 - EMPLAS

Component Compressor

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCS06196809		
Sample Date		Client Info		17 May 2024		
Machine Age	hrs	Client Info		56403		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	1		
Copper	ppm	ASTM D5185m	>50	16		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0.3	<1		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m	0.3	0		
Magnesium	ppm	ASTM D5185m	0.4	<1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	689	379		
Zinc	ppm	ASTM D5185m	0	6		
Sulfur	ppm	ASTM D5185m	1237	269		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	0.29		


Sullivan


OIL ANALYSIS REPORT

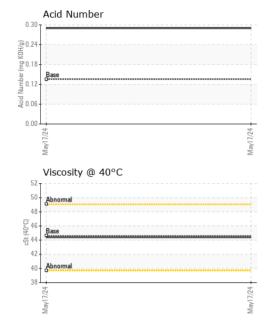



VIOLIAI			12 - 24 //		111	1:
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	LIGHT		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.62	44.4		
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color no image no image **Bottom** no image no image **GRAPHS**













Certificate 12367

Laboratory Sample No.

Lab Number : 06196809

Test Package : IND 2

: UCS06196809 Unique Number : 11058932

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 31 May 2024 Tested : 03 Jun 2024

Diagnosed : 03 Jun 2024 - Wes Davis

COMPRESSED AIR TECHNOLOGIES

MCDONOUGH, GA US 30253

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCCOMMCD [WUSCAR] 06196809 (Generated: 06/03/2024 13:55:22) Rev: 1

Contact/Location: Service Manager - UCCOMMCD

T:

F: