




# OIL ANALYSIS REPORT

Area  
**CHEMLUBE 228**  
 Machine Id  
**LEROI 4225X387 - BANK OF AMERICA**  
 Component  
**Compressor**

Sample Rating Trend

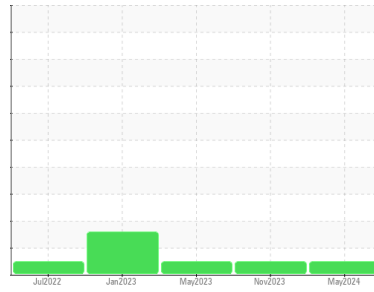

**NORMAL**



## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06196813</b>	UCH06013391	UCH05857438
Sample Date	Client Info		<b>24 May 2024</b>	06 Nov 2023	15 May 2023
Machine Age	hrs	Client Info	<b>25926</b>	25887	25836
Oil Age	hrs	Client Info	<b>0</b>	0	1
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1.5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>&lt;1</b>	2	3
Molybdenum	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m 0.3	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m 406	<b>259</b>	223	248
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	12
Sulfur	ppm	ASTM D5185m 1283	<b>1243</b>	1033	1172

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.463	<b>0.107</b>	0.083	0.06




# OIL ANALYSIS REPORT

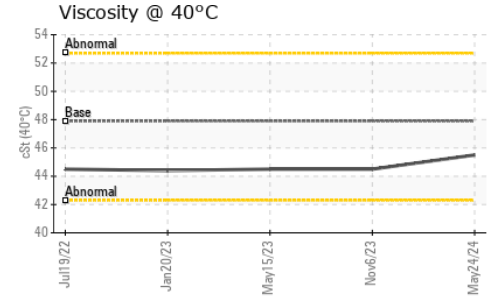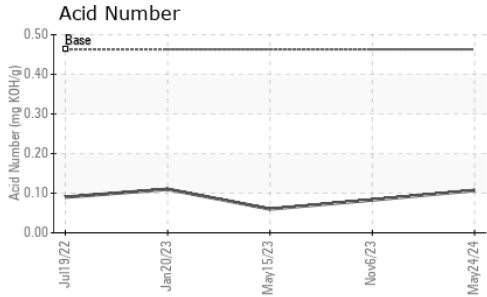





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	HEAVY
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.9	<b>45.5</b>	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

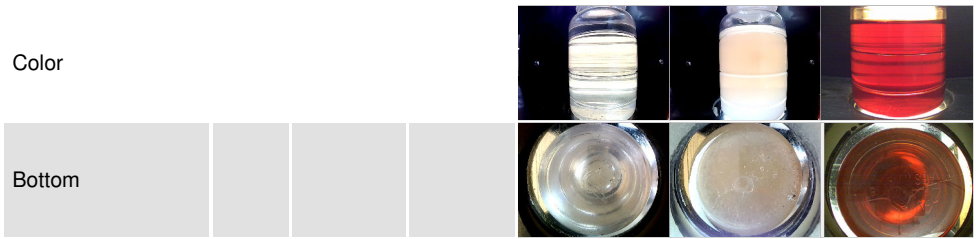

## GRAPHS

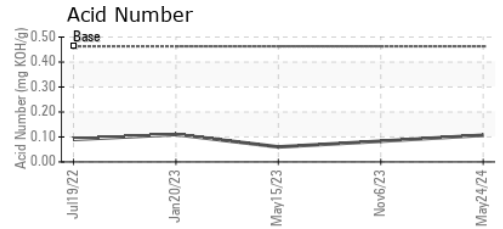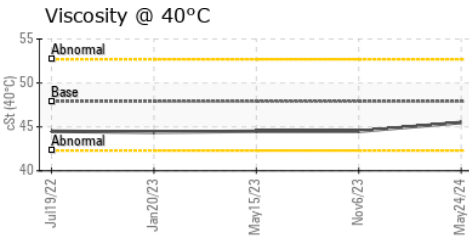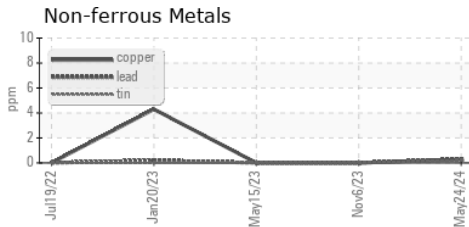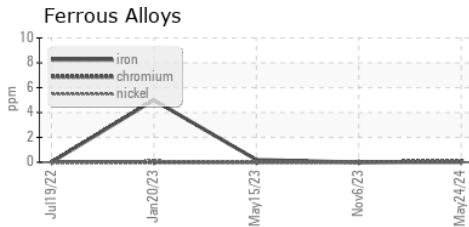

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06196813      **Received** : 31 May 2024  
**Lab Number** : **06196813**      **Tested** : 03 Jun 2024  
**Unique Number** : 11058936      **Diagnosed** : 03 Jun 2024 - Wes Davis  
**Test Package** : IND 2

**CUMMINS-WAGNER CO INC**  
 175 Edgemoor Rd  
 WILMINGTON, DE  
 US 19809  
 Contact: Natalie Gagliano  
 NGagliano@cummins-wagner.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)