




OIL ANALYSIS REPORT

Machine Id
HBKM01BE
 Component
Biogas Engine
 Fluid
SHELL MYSELLA S5 S (--- GAL)

Sample Rating Trend

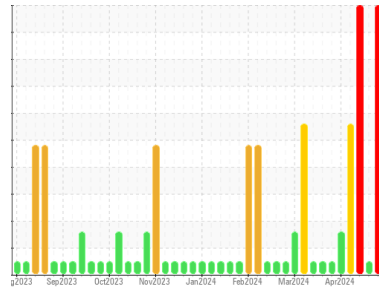

DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. (Customer Sample Comment: Top Up Amount: 30 GAL)

▲ Wear

The tin level is severe. The aluminum level is abnormal.

▲ Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0775166	WC0775168	WC0775171
Sample Date	Client Info		29 May 2024	22 May 2024	16 May 2024
Machine Age	hrs	Client Info	110378	110217	110078
Oil Age	hrs	Client Info	276	115	688
Oil Changed	Client Info		Oil Added	Changed	Oil Added
Sample Status			SEVERE	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>14	7	2	11
Chromium	ppm	ASTM D5185m	>3	<1	0	1
Nickel	ppm	ASTM D5185m		<1	0	1
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m		<1	<1	<1
Aluminum	ppm	ASTM D5185m	>5	▲ 5	2	5
Lead	ppm	ASTM D5185m	>8	<1	<1	1
Copper	ppm	ASTM D5185m	>5	2	<1	4
Tin	ppm	ASTM D5185m	>3	▲ 5	1	▲ 7
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		<1	0	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		39	4	7
Barium	ppm	ASTM D5185m		2	0	0
Molybdenum	ppm	ASTM D5185m		9	4	8
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		30	16	24
Calcium	ppm	ASTM D5185m		2437	1597	1581
Phosphorus	ppm	ASTM D5185m	300	600	343	349
Zinc	ppm	ASTM D5185m		736	423	430
Sulfur	ppm	ASTM D5185m		5595	3593	3269

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>180	▲ 226	85	▲ 260
Sodium	ppm	ASTM D5185m	>20	<1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	0	2

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0	0
Nitration	Abs/cm	*ASTM D7624		4.9	3.8	7.8
Sulfation	Abs/.1mm	*ASTM D7415		26.1	18.2	21.6


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414		20.6	11.1	14.7
Acid Number (AN)	mg KOH/g	ASTM D8045		1.05	0.68	1.50
Base Number (BN)	mg KOH/g	ASTM D2896	5.3	3.56	4.27	2.96




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

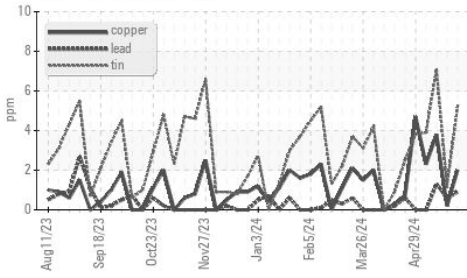


● FT-IR (Direct Trend)

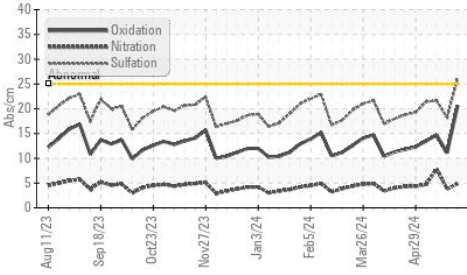


● Acid Number

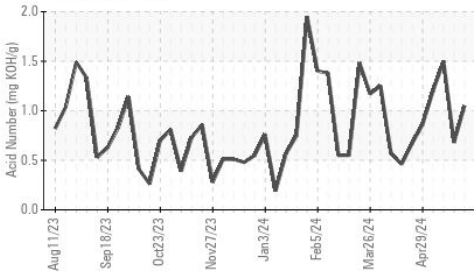

● FT-IR (Direct Trend)

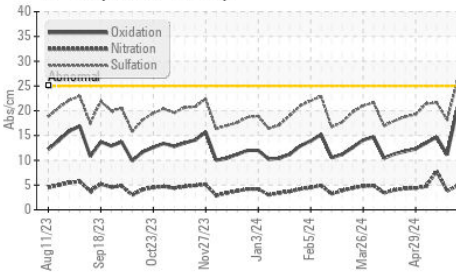









● Acid Number

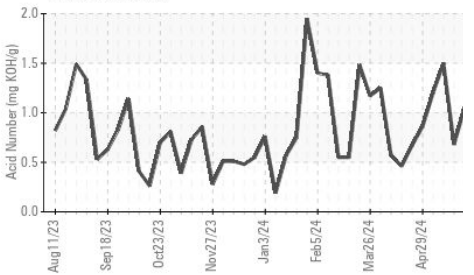

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.4	13.2

GRAPHS

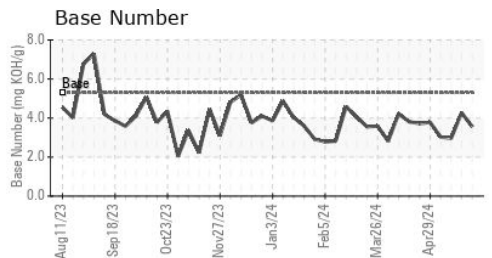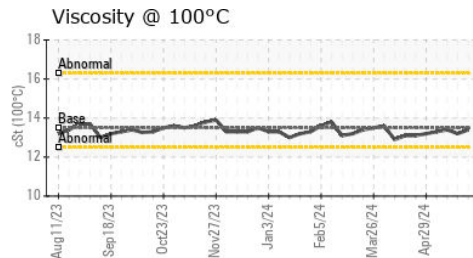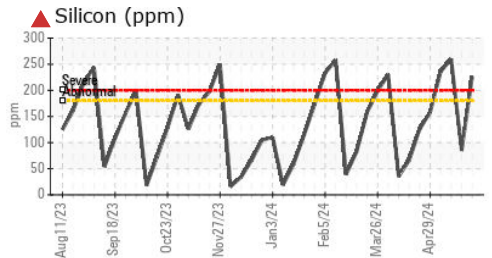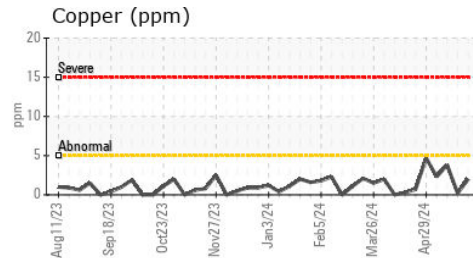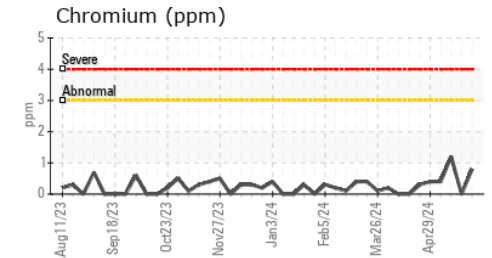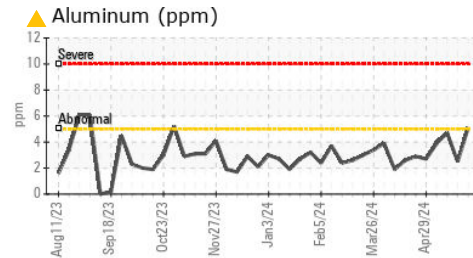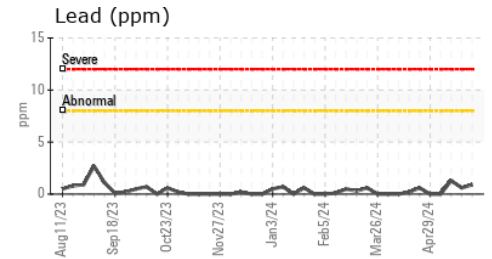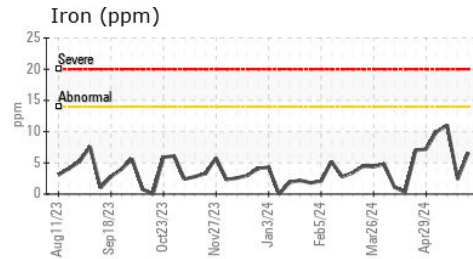

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0775166
 Lab Number : 06196856
 Unique Number : 11058979
 Test Package : MOB 2

Received : 31 May 2024
 Tested : 03 Jun 2024
 Diagnosed : 03 Jun 2024 - Sean Felton

EDL NA Recips-Honeybrook
 Honey Brook Powerstation, 481 S. Churchtown Road
 Narvon, PA
 US 17555-9574
 Contact: Christian Adames
 Christian.Adames@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: