




OIL ANALYSIS REPORT

Machine Id
Brent Run CAT 4 BRRM04BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

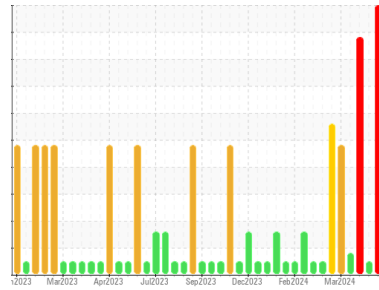

DIAGNOSIS

▲ Recommendation
 We recommend that you drain the oil and perform a filter service on this component if not already done. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. (Customer Sample Comment: 500 hr sample after odd side turbo failure)

▲ Wear
 The tin level is severe.

▲ Contamination
 Elemental level of silicon (Si) above normal.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0915813	WC0915801	WC0915821
Sample Date	Client Info		29 May 2024	30 Apr 2024	17 Apr 2024
Machine Age	hrs	Client Info	108700	108105	107871
Oil Age	hrs	Client Info	489	685	471
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			SEVERE	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	5	3	4
Chromium	ppm	ASTM D5185m >3	<1	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	<1	0	0
Aluminum	ppm	ASTM D5185m >5	3	2	2
Lead	ppm	ASTM D5185m >8	<1	0	<1
Copper	ppm	ASTM D5185m >5	2	2	2
Tin	ppm	ASTM D5185m >3	▲ 5	3	▲ 4
Vanadium	ppm	ASTM D5185m	<1	<1	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	80	<1	0
Barium	ppm	ASTM D5185m	2	0	0
Molybdenum	ppm	ASTM D5185m	5	1	2
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	29	7	7
Calcium	ppm	ASTM D5185m	1870	1827	1861
Phosphorus	ppm	ASTM D5185m	438	272	281
Zinc	ppm	ASTM D5185m	544	316	307
Sulfur	ppm	ASTM D5185m	4296	2843	3205

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	▲ 231	163	▲ 211
Sodium	ppm	ASTM D5185m >20	0	2	3
Potassium	ppm	ASTM D5185m >20	2	0	0

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	5.1	6.1	6.4
Sulfation	Abs/.1mm	*ASTM D7415	22.4	20.4	23.3


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	16.0	13.6	16.8
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	1.86	1.17	2.945
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	4.86	3.61	▲ 2.44




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

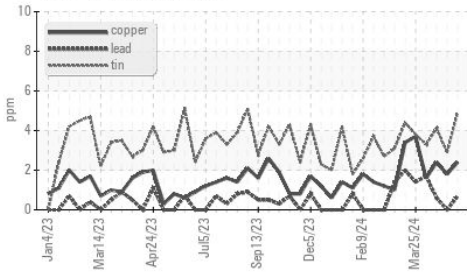


FT-IR (Direct Trend)

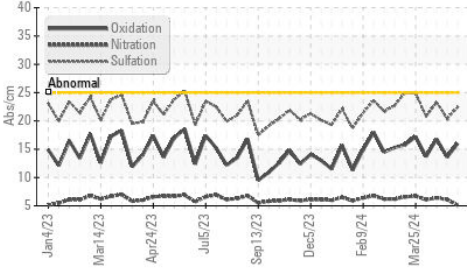


Acid Number

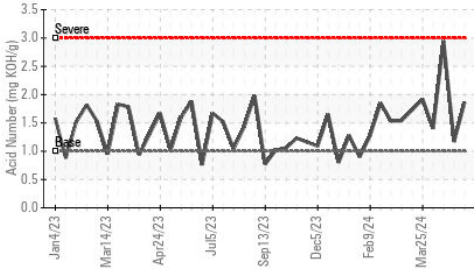

Acid Number

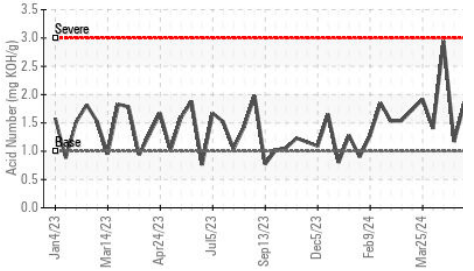









Base Number

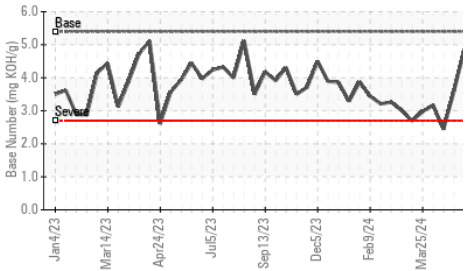

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	14.4	13.7

GRAPHS

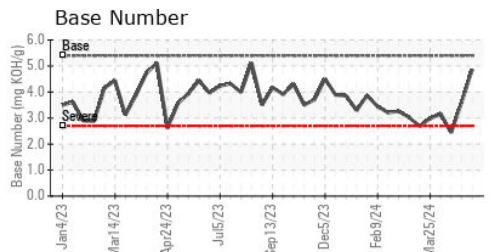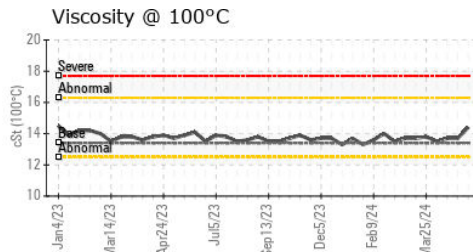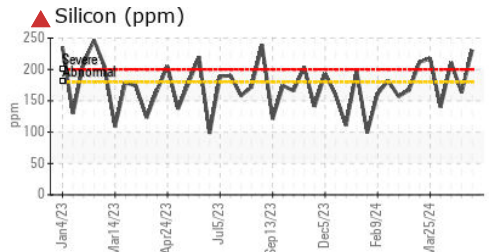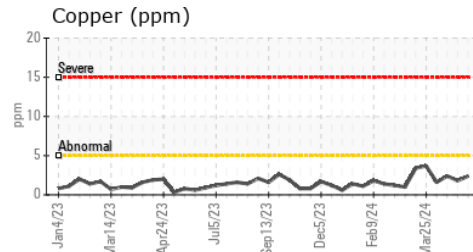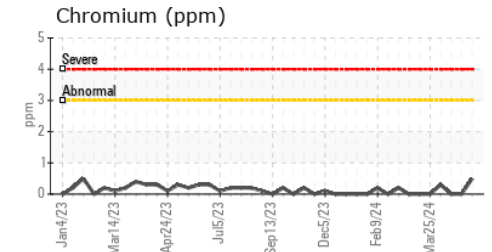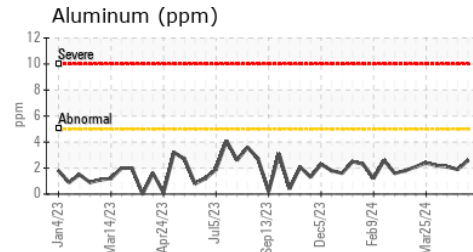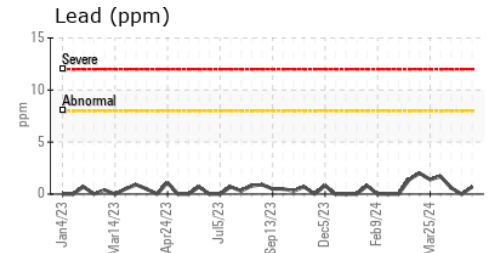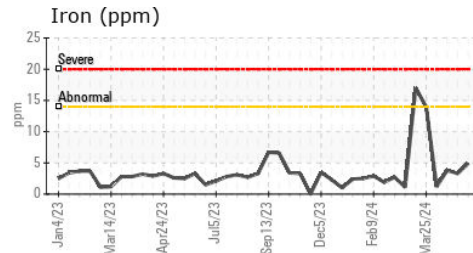

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0915813
Lab Number : 06196859
Unique Number : 11058982
Test Package : MOB 2

Received : 31 May 2024
Tested : 03 Jun 2024
Diagnosed : 03 Jun 2024 - Sean Felton

EDL NA Recips-Brent Run
 Brent Run Power Station, 8383 Vienna Road
 Montrose, MI
 US 48457-9141
 Contact: Rob Stewart
 Rob.Stewart@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: