




# FUEL REPORT

Sample Rating Trend

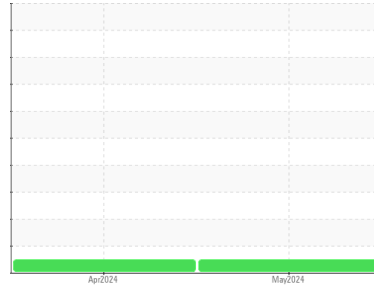

**NORMAL**



Machine Id  
**HCA FLORIDA LAWNWOOD HOSPITAL EMERGENCY GEN**  
 Component  
**Bulk Tank Diesel Fuel**  
 Fluid  
**DDSL (3900 GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WCDF4616</b>	WCDF4597	---
Sample Date	Client Info			<b>24 May 2024</b>	17 Apr 2024	---
Machine Age	mls	Client Info		<b>0</b>	0	---
Sample Status				<b>NORMAL</b>	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen		<b>Red</b>	Red	---
ASTM Color	scalar	*ASTM D1500		<b>L4.5</b>	L5.5	---
Visc @ 40°C	cSt	ASTM D445		<b>2.48</b>	2.53	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		<b>61.2</b>	62.4	---
Cloud Point	°C	ASTM D5771		<b>-11</b>	-10	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	---
Sulfur (UVF)	ppm	ASTM D5453		<b>14</b>	15	---





DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		<b>172</b>	174	---
5% Distillation Point	°C	ASTM D86		<b>195</b>	197	---
10% Distill Point	°C	ASTM D86		<b>205</b>	206	---
15% Distillation Point	°C	ASTM D86		<b>212</b>	214	---
20% Distill Point	°C	ASTM D86		<b>220</b>	221	---
30% Distill Point	°C	ASTM D86		<b>235</b>	236	---
40% Distill Point	°C	ASTM D86		<b>248</b>	250	---
50% Distill Point	°C	ASTM D86		<b>262</b>	263	---
60% Distill Point	°C	ASTM D86		<b>276</b>	277	---
70% Distill Point	°C	ASTM D86		<b>291</b>	291	---
80% Distill Point	°C	ASTM D86		<b>307</b>	307	---
85% Distillation Point	°C	ASTM D86		<b>317</b>	318	---
90% Distill Point	°C	ASTM D86		<b>328</b>	328	---
95% Distillation Point	°C	ASTM D86		<b>345</b>	346	---
Final Boiling Point	°C	ASTM D86		<b>361</b>	359	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		<b>36</b>	37	---
Cetane Index		ASTM D4737	<40.0	<b>49</b>	49	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m	<0.1	<b>1</b>	0	---
Water	%	ASTM D6304	<0.05	<b>0.002</b>	0.004	---
ppm Water	ppm	ASTM D6304	<500	<b>22</b>	44	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	---






# FUEL REPORT

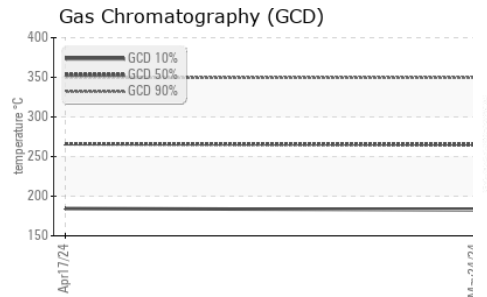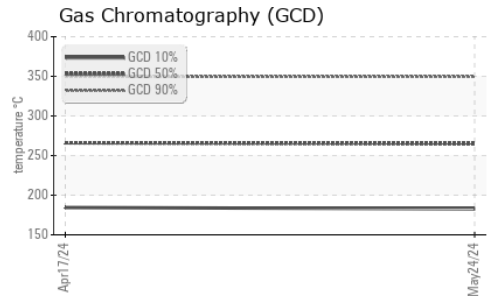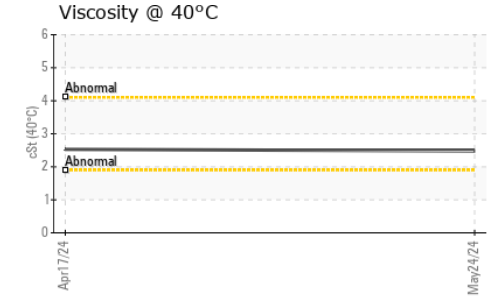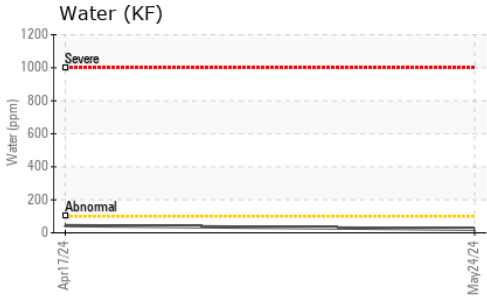

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	---
Nickel	ppm	ASTM D5185m	<0.1	0	---
Lead	ppm	ASTM D5185m	<0.1	0	---
Vanadium	ppm	ASTM D5185m	<0.1	0	---
Iron	ppm	ASTM D5185m	<0.1	0	---
Calcium	ppm	ASTM D5185m	<0.1	0	---
Magnesium	ppm	ASTM D5185m	<0.1	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	---
Zinc	ppm	ASTM D5185m	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2	
Color						no image
Bottom						no image

## GRAPHS

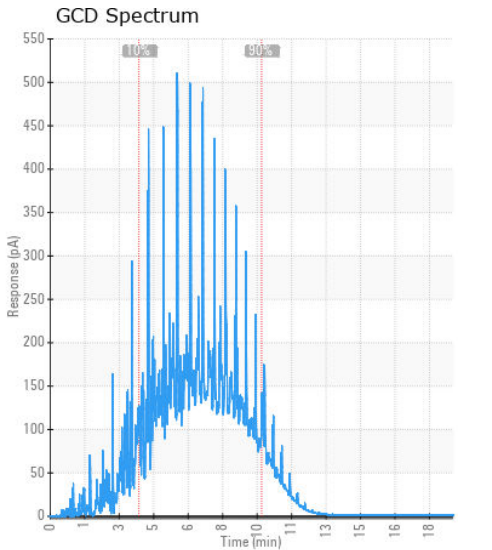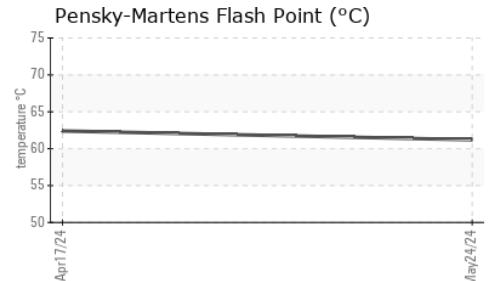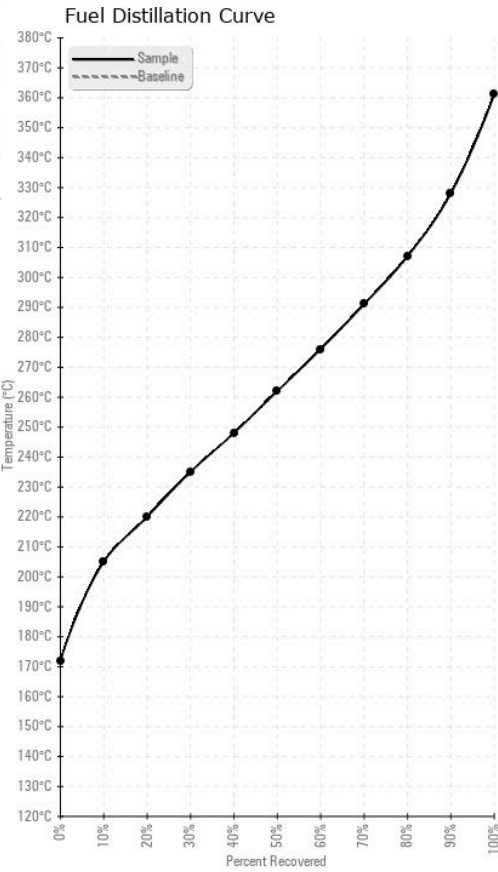

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WCDF4616      **Received** : 31 May 2024  
**Lab Number** : 06197194      **Tested** : 11 Jun 2024  
**Unique Number** : 11059317      **Diagnosed** : 11 Jun 2024 - Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: CldPt, Fuel, PrtCount, Screen )

**TANK WIZARDS**  
 1511 MASTERS RD NW  
 PALM BAY, FL  
 US 32907  
 Contact: WENDALL STRODERD  
 wendall@tankwizards.com  
 T: (321)427-5149  
 F: (321)574-4131

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)