




OIL ANALYSIS REPORT

Sample Rating Trend

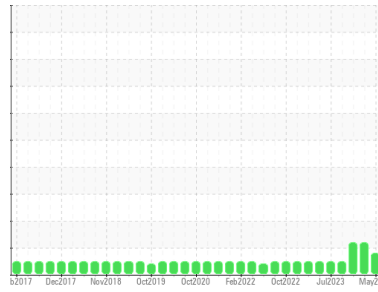

VISCOSITY



Machine Id
GARDNER DENVER RS GARDNER DENVER AC 2 (S/N S420359)
 Component
Air Compressor
 Fluid
USPI MAX FG AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

Viscosity is noted. This plus the additive levels indicates the addition of a different brand or type of oil. Confirmed. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM36319	USPM36870	USPM31685
Sample Date	Client Info		25 May 2024	14 Mar 2024	21 Dec 2023
Machine Age	hrs	Client Info	62611	30999	0
Oil Age	hrs	Client Info	874	4549	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	3	0
Chromium	ppm	ASTM D5185m >4	<1	<1	0
Nickel	ppm	ASTM D5185m >4	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >40	<1	0	0
Tin	ppm	ASTM D5185m >5	<1	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 0	<1	0	0
Calcium	ppm	ASTM D5185m 0	4	0	0
Phosphorus	ppm	ASTM D5185m 0	30	44	61
Zinc	ppm	ASTM D5185m 0	5	0	0
Sulfur	ppm	ASTM D5185m 0	0	44	64

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	0
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304 >0.6	0.010	0.006	0.010
ppm Water	ppm	ASTM D6304 >6000	104	65	106

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	308	123	87
Particles >6µm	ASTM D7647	>2500	91	31	33
Particles >14µm	ASTM D7647	>320	12	3	5
Particles >21µm	ASTM D7647	>80	4	1	2
Particles >38µm	ASTM D7647	>20	0	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	15/14/11	14/12/9	14/12/10


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.16	0.68	0.54	0.39




OIL ANALYSIS REPORT


Additives

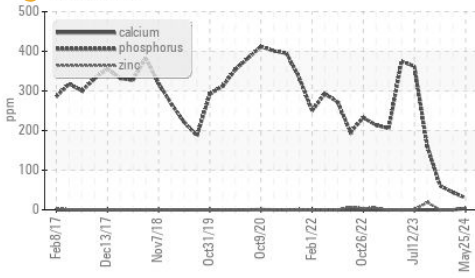


Water (KF)

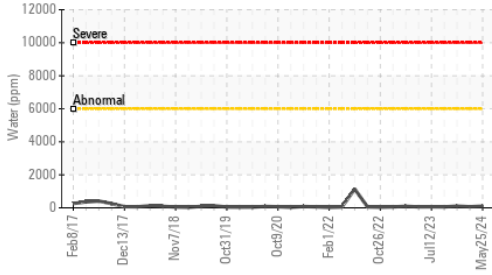


Particle Trend

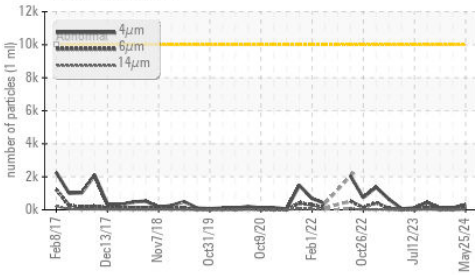

Acid Number

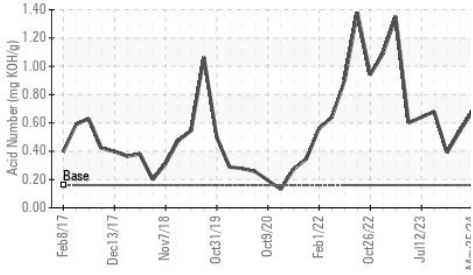

Water (KF)

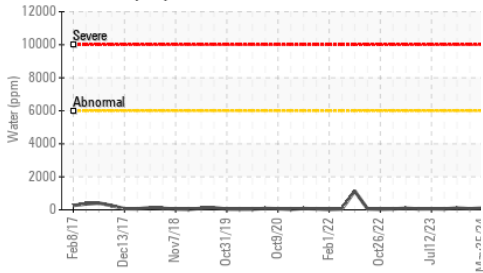

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	55.15	54.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

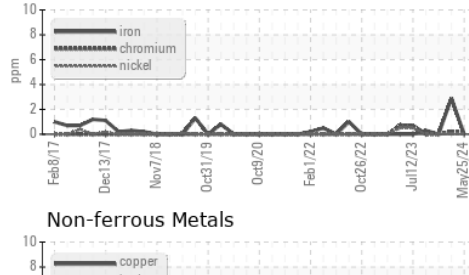


Non-ferrous Metals

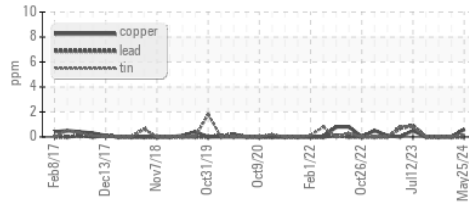


Viscosity @ 40°C

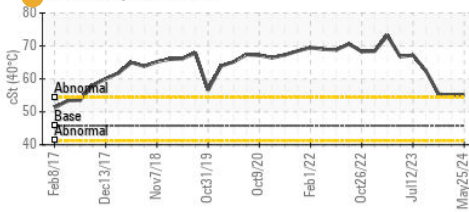

Particle Count

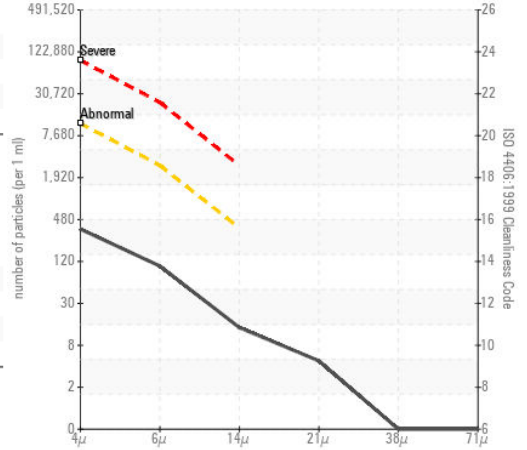

Acid Number

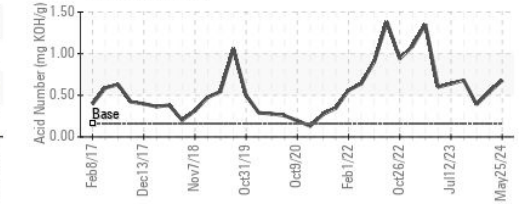

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USPM36319
 Lab Number : 06197659
 Unique Number : 11059782
 Test Package : IND 2

Received : 03 Jun 2024
 Tested : 06 Jun 2024
 Diagnosed : 09 Jun 2024 - Doug Bogart

TYSON - SEDALIA - USP
 19578 WHITFIELD RD
 SEDALIA, MO
 US 65301
 Contact: BONNIE
 bonnie.weathers@tyson.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)