




OIL ANALYSIS REPORT

Sample Rating Trend

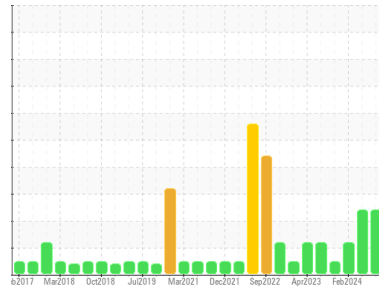

DEGRADATION



Machine Id
GARDNER DENVER 6 (S/N U92804)
 Component
Compressor
 Fluid
USPI COMP CLEAN II (--- GAL)

DIAGNOSIS

● Recommendation

Resample at the next service interval to monitor.
 NOTE: one of two samples received with same ID.

Wear

All component wear rates are normal.

● Contamination

There is a moderate amount of particulates present in the oil.

▲ Fluid Condition

The AN level is approaching the top-end of the recommended limit.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM36343	USPM36347	USPM30148
Sample Date	Client Info		02 Jun 2024	02 Jun 2024	26 Feb 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	3	3	2
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		1	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	4
Zinc	ppm	ASTM D5185m		1	2	0
Sulfur	ppm	ASTM D5185m		0	0	0

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		3	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.1	0.033	0.029	0.013
ppm Water	ppm	ASTM D6304	>1000	338	295	135

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	5463	3628	2503
Particles >6µm	ASTM D7647	>2500	2076	1475	505
Particles >14µm	ASTM D7647	>320	● 440	● 352	41
Particles >21µm	ASTM D7647	>80	● 150	● 130	14
Particles >38µm	ASTM D7647	>20	6	8	1
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	● 20/18/16	● 19/18/16	19/16/13


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	▲ 1.65	▲ 1.69	▲ 2.91




OIL ANALYSIS REPORT


● Particle Trend

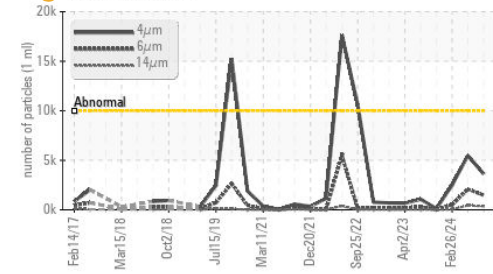


↘ Water (KF)

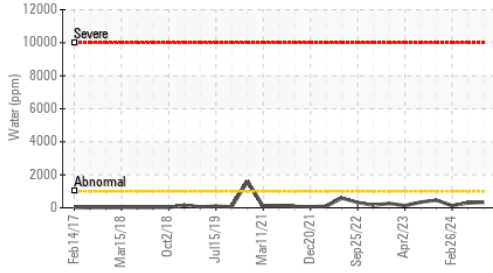


▲ Acid Number

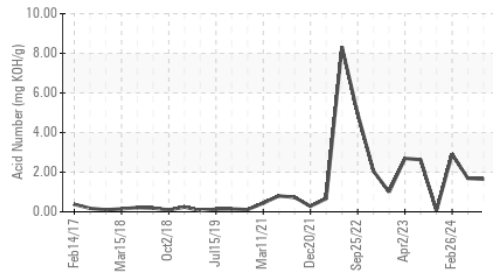

↘ Water (KF)

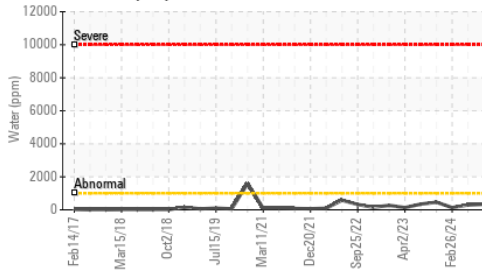


Viscosity @ 40°C

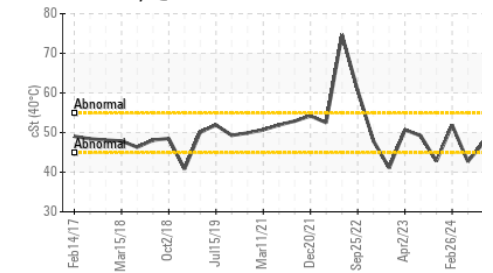

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.5	42.7	51.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

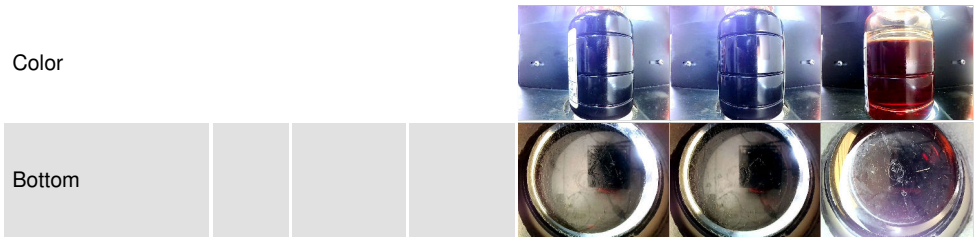


GRAPHS


Ferrous Alloys

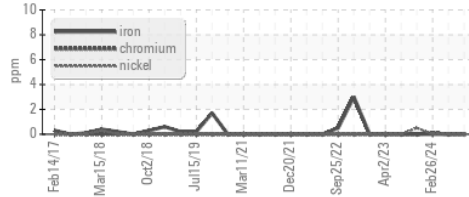


Non-ferrous Metals

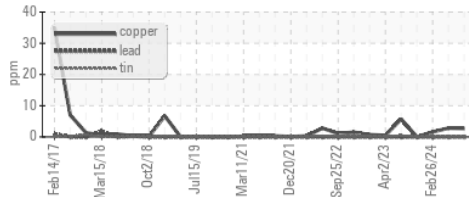


Viscosity @ 40°C

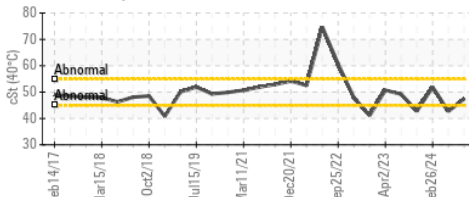

● Particle Count

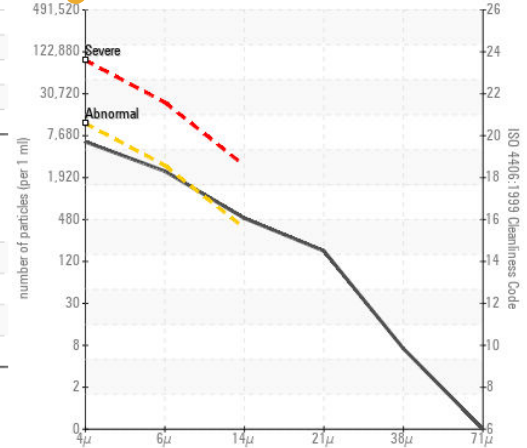

▲ Acid Number

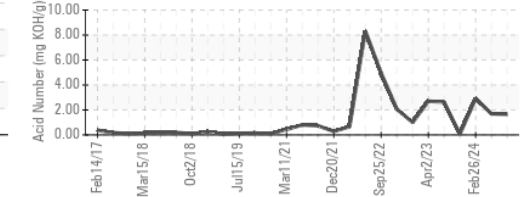

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USPM36343
 Lab Number : 06197667
 Unique Number : 11059790
 Test Package : IND 2

Received : 03 Jun 2024
 Tested : 04 Jun 2024
 Diagnosed : 05 Jun 2024 - Doug Bogart

CARGILL

FORT MORGAN, CO
 US
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: