




# OIL ANALYSIS REPORT

Sample Rating Trend

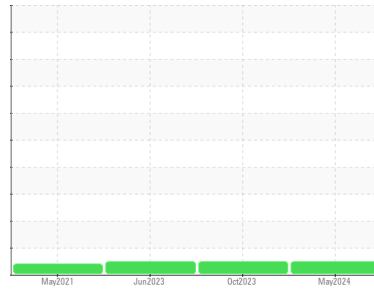

**NORMAL**



Area

**AIRLUBE PLUS 10 [CSA181]**

Machine Id

**ATLAS COPCO API480-505 - MORGAN SERVICES**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06197744</b>	UCH06000596	UCH05879622
Sample Date	Client Info		<b>10 May 2024</b>	06 Oct 2023	10 Jun 2023
Machine Age	hrs	Client Info	<b>32928</b>	30716	29487
Oil Age	hrs	Client Info	<b>3441</b>	1229	4000
Oil Changed	Client Info		<b>Not Changed</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>4</b>	5	5
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >15	<b>2</b>	1	2
Lead	ppm	ASTM D5185m >65	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >65	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.1	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.8	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0.9	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 409	<b>424</b>	396	430
Zinc	ppm	ASTM D5185m 0	<b>42</b>	49	88
Sulfur	ppm	ASTM D5185m 1290	<b>8</b>	389	565

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>4</b>	2	0
Sodium	ppm	ASTM D5185m	<b>2</b>	2	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.537	<b>0.69</b>	0.84	1.01




# OIL ANALYSIS REPORT

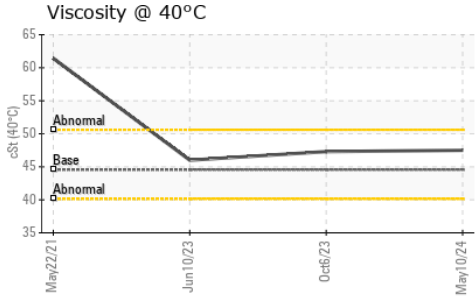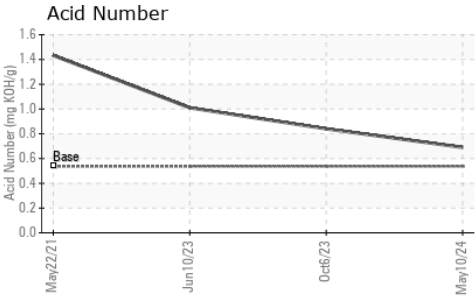





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.56	<b>47.5</b>	47.3	46.0

### SAMPLE IMAGES

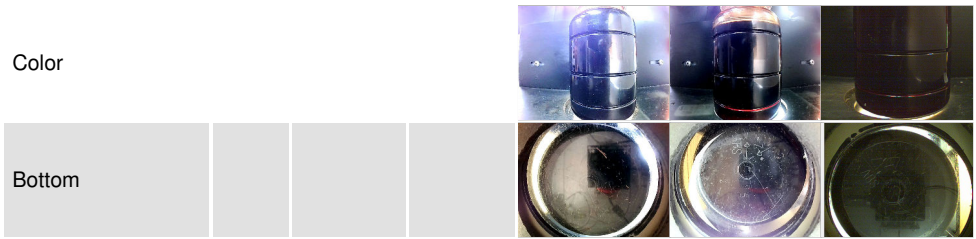

### GRAPHS

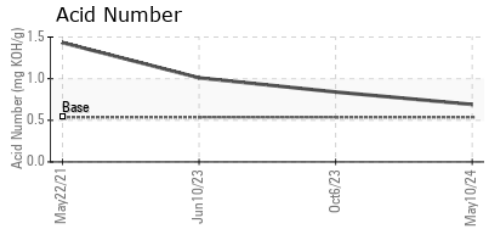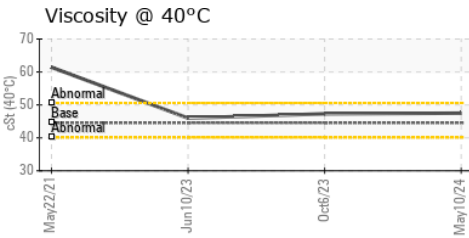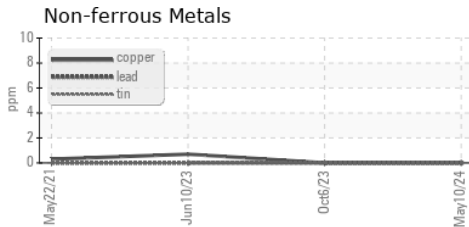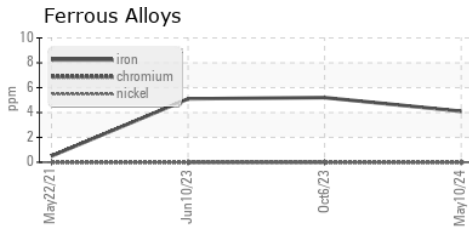

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06197744      **Received** : 03 Jun 2024  
**Lab Number** : **06197744**      **Tested** : 04 Jun 2024  
**Unique Number** : 11059867      **Diagnosed** : 04 Jun 2024 - Wes Davis  
**Test Package** : IND 2

**AIR TECHNOLOGIES INC (CLE)**  
 6500 DAVIS INDUSTRIAL PARKWAY  
 CLEVELAND, OH  
 US 44139  
 Contact: DERRICK PAES  
 DPAES@AIRCOMPRESSORS.COM  
 T: (440)349-3900  
 F: (440)349-0608

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)