


# **OIL ANALYSIS REPORT**

# **PG-46** [285166] PNEUTECH AK100012167 - YAMAZEN

Component Compressor

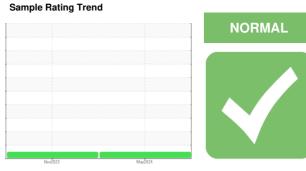

### DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001242	UFD0000414	
Sample Date		Client Info		01 May 2024	27 Nov 2023	
Machine Age	hrs	Client Info		9677	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	<1	2	
Tin	ppm	ASTM D5185m	>15	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		0	0	
Phosphorus	ppm	ASTM D5185m		358	322	
Zinc	ppm	ASTM D5185m		7	0	
Sulfur	ppm	ASTM D5185m		744	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	4	
Sodium	ppm	ASTM D5185m		0	2	
Potassium	ppm	ASTM D5185m	>20	0	0	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.66	0.15	





## **OIL ANALYSIS REPORT**


















Certificate 12367

Laboratory Sample No.

Lab Number : 06197753 Unique Number : 11059876

Test Package : IND 2

: UFD0001242

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 03 Jun 2024 **Tested** : 04 Jun 2024

Diagnosed : 04 Jun 2024 - Wes Davis

Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

**FLUID-AIRE DYNAMICS** 

225 SPRING LAKE DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ITASCA, IL

US 60143