


OIL ANALYSIS REPORT

PG-46 [276965] PNEUTECH IT220201 - SPECIALTY PRINT

Component Compressor

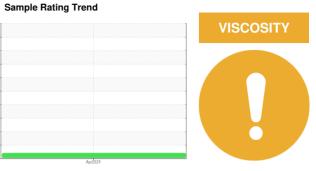

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000903		
Sample Date		Client Info		05 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		173		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		1319		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	15		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.30		



OIL ANALYSIS REPORT






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERTIES		method	limit/base	current	history1	history2


Visc @ 40°C	cSt	ASTM D445	53.3			
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image

Bottom			no image	no image
Bottom			no image	no image



		ion-ferrous Metais	
	10 T		
	8-	copper	
F	6 +	**************************************	
mdd	4-		
	2		
		-	_
			2/6/4
		<	Ĭ,









Certificate 12367

Sample No. : UFD0000903 Lab Number : 06197795 Unique Number : 11059918

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 03 Jun 2024 Tested : 04 Jun 2024

Diagnosed : 04 Jun 2024 - Don Baldridge

US 60143 Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

FLUID-AIRE DYNAMICS

225 SPRING LAKE DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCFLUSCH [WUSCAR] 06197795 (Generated: 06/04/2024 15:18:31) Rev: 1

Test Package : IND 2

Contact/Location: ED DIENER - UCFLUSCH

ITASCA, IL